


ARCHITECT

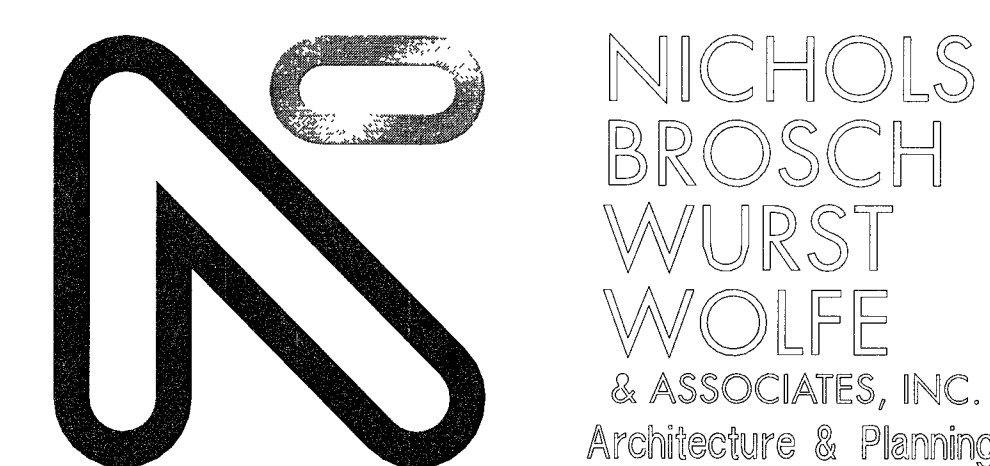

161 ALMERIA AVENUE
CORAL GABLES, FLORIDA 33134
(305) 443-5206 FAX: (305) 446-2872
JAMES P. WURST
ARCHITECT
LIC. 20303

STRUCTURAL ENGINEERING

OPTIMUS STRUCTURAL DESIGN, LLC.
7850 NW 146th STREET, SUITE 305
MIAMI LAKES, FLORIDA 33016
TEL: (305) 512-5860 FAX: (305) 512-5861

MECHANICAL / ELECTRICAL / PLUMBING

LAUREDO ENGINEERING CO.
1941 SW 18th AVENUE
MIAMI, FLORIDA 33145
TEL: (305) 445-9725 FAX: (786) 378-6743

CIVIL ENGINEERING

VSN ENGINEERING, INC.
8550 WEST FLAGLER STREET, SUITE 113
MIAMI, FLORIDA 33144
TEL: (305) 551-6267 FAX: (305) 551-4542

LANDSCAPE ARCHITECT

STANTEC
915 OUTER ROAD, SUITE 200
ORLANDO, FLORIDA 32814
TEL: (407) 237-0669 FAX: (407) 237-0973

INTERIOR DESIGNER

NICOLE HOLLIS
935 NATOMA STREET
SAN FRANCISCO, CALIFORNIA 94103
TEL: (415) 733-9621 FAX: (415) 278-9458

NOTE: LANDSCAPE AND IRRIGATION
PLANS WILL BE SUBMITTED UNDER A
SEPARATE PERMIT TO BE REVIEWED
AND APPROVED BY STAFF PRIOR TO
ISSUANCE OF A TCO.

ADDITION & RENOVATION TO THE

ANGLER'S HOTEL

MIAMI BEACH, FLORIDA

PERMIT ISSUE
OCTOBER 13, 2014



NOTICE: In addition to the requirement of this permit, there may be additional restrictions applicable to this property that may be found in the Public Records of this County and there may be additional permits required from other government entities such as water management districts, state agencies or federal agencies. The City of Miami Beach assumes no responsibility for accuracy of or results from these plans which are approved subject to compliance with all Federal, State, and Local Laws, Rules, and Regulations.


PUBLIC WORKS
PLAN REVIEW NOTICE
Phone 305-673-7030 Fax 305-673-7028
THIS PLAN REVIEW CONSTITUTES APPROVAL FOR
OBTAINING BUILDING PERMITS ONLY.
All construction and/or use of equipment in the right-of-way and/or
encroachments, requires a separate Public Works Department permit prior
to start of construction.
Permit Requirements: Proof of existing sidewalk/slope area conditions
(pictures) and/or posting of sidewalk/roadway bonds
(Public Works Inspection of the right-of-way will be required prior to
final sign-off on the C.C.O.D., or the release of bonds.)
4/19/15
5/5/15

CITY OF MIAMI BEACH
APPROVED FOR PERMIT BY
THE FOLLOWING:
BUILDING: [Signature]
ZONING: [Signature]
PLUMBING: [Signature]
ELECTRICAL: [Signature]
MECHANICAL: [Signature]
FIRE PREVENTION: [Signature]
FLOOD: [Signature]
PUBLIC WORKS: [Signature]
STRUCTURAL: [Signature]
ELECTRICAL: [Signature]
ROUTING: [Signature]

CMB BLDG.DEPT. COMMENTS: 12-16-14.
CMB BLDG.DEPT. COMMENTS: 01-15-15.
CMB BLDG.DEPT. COMMENTS: 03-25-15.

APPROVED
MAY 25 2015
FIRM: [Signature]

ARCHITECT

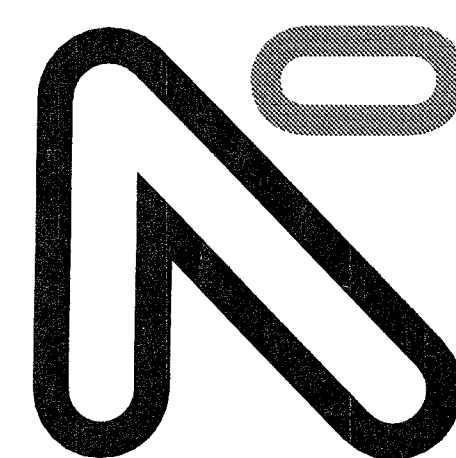

151 ALMERIA AVENUE
CORAL GABLES, FLORIDA 33134
(305) 443-5206 FAX: (305) 446-2872
JAMES P. WURST
ARCHITECT
LIC. 20303

STRUCTURAL ENGINEERING

OPTIMUS STRUCTURAL DESIGN, LLC.

7850 NW 146th STREET, SUITE 305
MIAMI LAKES, FLORIDA 33016
TEL: (305) 512-5860 FAX: (305) 512-5861

MECHANICAL / ELECTRICAL / PLUMBING

LAUREDO ENGINEERING CO.

1941 SW 18th AVENUE
MIAMI, FLORIDA 33145
TEL: (305) 445-9725 FAX: (786) 378-6743

CIVIL ENGINEERING

VSN ENGINEERING, INC.

8550 WEST FLAGLER STREET, SUITE 113
MIAMI, FLORIDA 33144
TEL: (305) 551-6267 FAX: (305) 551-4542

LANDSCAPE ARCHITECT

STANTEC

915 OUTER ROAD, SUITE 200
ORLANDO, FLORIDA 32814
TEL: (407) 237-0669 FAX: (407) 237-0973

INTERIOR DESIGNER

NICOLE HOLLIS

935 NATOMA STREET
SAN FRANCISCO, CALIFORNIA 94103
TEL: (415) 733-9621 FAX: (415) 278-9458

B1500350

ADDITION & RENOVATION TO THE

ANGLER'S HOTEL

MIAMI BEACH, FLORIDA

PERMIT ISSUE
OCTOBER 13, 2014




OFFICE COPY	
CITY OF MIAMI BEACH	
APPROVED FOR PERMIT BY	
THE FOLLOWING:	
BUILDING:	
ZONING:	
PLUMBING:	
ELECTRICAL:	
MECHANICAL:	
FIRE PREVENTION:	
FLOOD:	
PUBLIC WORKS:	
STRUCTURAL:	
ELEVATOR:	
ROOFING:	

CMB BLDG. DEPT. COMMENTS. 12-16-14. 1
CMB BLDG. DEPT. COMMENTS. 01-15-15. 2.

REVIEWED
CITY OF MIAMI BEACH
FIRE DEPARTMENT

JAN 15 2015

HISTORIC PRESERVATION BOARD CITY OF MIAMI BEACH, FLORIDA FINAL ORDER FOR THE ANGLER'S HOTEL

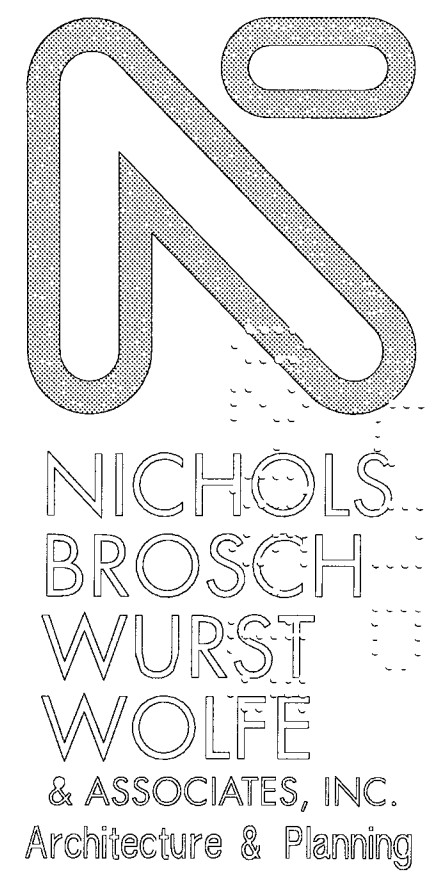

ANGLER'S HOTEL
600 WASHINGTON AVENUE, MIAMI BEACH, FLORIDA 33139
DEVELOPED BY: Angler's Boutique Resort LLC

JAN 15 2015

Permit Issue		
10-13-14		
REVISIONS		
#	Description	Date
2	CMB Bkg. Dept. comments	01/15/15

12064

A0.00.1
NEW SHEET

HISTORIC PRESERVATION BOARD
City of Miami Beach, Florida

MEETING DATE: June 10, 2014

FILE NO: 7419

PROPERTY: 680 Washington Avenue

LEGAL: Parcel 1
Lots 3, 4 and 5, Block 47, "Ocean Beach Addition No. 3", according to the
Plat thereof recorded in Plat Book 2, page 81 of the Public Records of
Miami-Dade County, Florida.
Parcel 2
Lots 6, 7 and 8, Block 47, "Ocean Beach Addition No. 3", according to the
Plat thereof recorded in Plat Book 2, page 81 of the Public Records of
Miami-Dade County, Florida.

IN RE: The Application for a Certificate of Appropriateness for the construction of a
new 5-story ground level addition, as part of a new hotel development.

ORDER

The applicant, Angler's Boutique Resort, LLC, filed an application with the City of Miami Beach
Planning Department for a Certificate of Appropriateness.

The City of Miami Beach Historic Preservation Board makes the following FINDINGS OF FACT,
based upon the evidence, information, testimony and materials presented at the public hearing
and which are part of the record for this matter:

- The subject structure is classified as "Contributing" in the Miami Beach Historic Preservation
Database and is located within the Flamingo Park Historic District and the National
Architectural District.
- Based on the plans and documents submitted with the application, testimony and
information provided by the applicant, and the reasons set forth in the Planning Department
Staff Report, the project as submitted is consistent with the Certificate of Appropriateness

CFH 2014RO476150
OR 30-22719 FG 1069-10691 (6p99)
RECORDED 07/07/2014 15:22:22
HARVEY BROWN, CLERK OF COURT
MIAMI-DADE COUNTY, FLORIDA

CERTIFICATION
THIS IS TO CERTIFY THAT THE ATTACHED DOCUMENT
IS A TRUE AND ACCURATE COPY OF THE ORIGINAL ON
FILE IN THE OFFICE OF THE CLERK OF COURT,
CITY OF MIAMI BEACH.
Notary Public, State of Florida
My Commission Expires: 06/16/2016
This document contains: 0 pages.

Page 2 of 6
HPB File No. 7419
Meeting Date: June 10, 2014

Criteria in Section 118-564(a)(1) of the Miami Beach Code, is not consistent with Certificate
of Appropriateness Criteria "a", "c" & "d" in Section 118-564(a)(2) of the Miami Beach Code,
and is not consistent with Certificate of Appropriateness Criteria "a", "b", "c", "e", "h" & "o" in
Section 118-564(a)(3) of the Miami Beach Code.

C. The project would be consistent with the criteria and requirements of section 118-564 if the
following conditions are met:

- Revised elevation, site plan and floor plan drawings shall be submitted to and approved by
staff, at a minimum, such drawings shall incorporate the following:
 - The maximum FAR for one project site shall not exceed 2.0
 - The open aluminum frame element located at the corner above the roof level shall
be removed, in a manner to be reviewed and approved by staff consistent with the
Certificate of Appropriateness Criteria and/or the directions from the Board.
 - Final details of all exterior surface finishes and materials, including samples, shall
be submitted, in a manner to be reviewed and approved by staff consistent with the
Certificate of Appropriateness Criteria and/or the directions from the Board.
 - Final details of all proposed storefront systems and associated details shall be
provided for all of the structures on the project site, in a manner to be reviewed
and approved by staff consistent with the Certificate of Appropriateness Criteria
and/or the directions from the Board.
 - The final design and details of all exterior lighting shall be provided, in a manner
to be reviewed and approved by staff consistent with the Certificate of
Appropriateness Criteria and/or the directions from the Board. Interior lighting
shall be designed in a manner to not have an adverse overwhelming impact upon
the surrounding historic district.
 - The final design and details of all railings shall be provided, in a manner to be
reviewed and approved by staff consistent with the Certificate of Appropriateness
Criteria and/or the directions from the Board.
 - The interior walls of the first level of the parking garage entrance and ramps shall
be fully detailed on revised plans. Such interior areas shall consist of high quality,
non-silico surface materials which have a well finished appearance
commensurate with the primary facade of the building, in a manner to be reviewed
and approved by staff consistent with the Certificate of Appropriateness Criteria
and/or the directions from the Board.
 - A copy of all pages of the recorded Final Order shall be scanned into the
submitted for building permit, and shall be located immediately after the
cover page of the permit plans.
- Applicant agrees that in the event Code Compliance receives complaints of unreasonable
loud noise from mechanical and/or electrical equipment, and determines the complaint

Page 3 of 6
HPB File No. 7419
Meeting Date: June 10, 2014

be valid, even if the equipment is operating pursuant to manufacturer specifications, the
applicant shall take such steps to mitigate the noise with noise attenuating materials as
reviewed and verified by an acoustic engineer, in a manner to be reviewed and approved by
staff consistent with the Certificate of Appropriateness Criteria and/or the directions from the
Board.

- A revised landscape plan, prepared by a Professional Landscape Architect, registered in the
State of Florida, and corresponding site plan, shall be submitted to and approved by staff.
The species type, quantity, dimensions, spacing, location and overall height of all plant
material shall be clearly delineated and in a manner to be reviewed and approved by staff
consistent with the directions from the Board and/or the Certificate of Appropriateness
Criteria. At a minimum, such plan shall incorporate the following:
 - The material palette for the proposed landscape plan shall be simplified, in a manner
to be reviewed and approved by staff consistent with the Certificate of
Appropriateness Criteria and/or the directions from the Board.
 - Washingtonian Palms shall be incorporated into the landscape plan and shall be
located at the southeast corner of the property, as proposed, in a manner to be
reviewed and approved by staff consistent with the Certificate of Appropriateness
Criteria and/or the directions from the Board.
 - The proposed paving within the required front yard along Washington Avenue shall
be substantially reduced and replaced with landscape material including the
introduction of shade trees, in a manner to be reviewed and approved by staff
consistent with the Certificate of Appropriateness Criteria and/or the directions from
the Board.
 - Hedge material shall not be permitted within the required front yard along
Washington Avenue or within the required side yard along 6th Street. All understory
and accent plan material proposed within the required front yard or side yard along
6th Street, shall consist of plant material that does not exceed approximately 24" in
height at maturity. The final selection of perimeter landscaping shall be submitted,
in a manner to be reviewed and approved by staff consistent with the Certificate of
Appropriateness Criteria and/or the directions from the Board.
 - The landscape plan for the rear yard shall be further developed and include a variety
of native species at varying heights, in a manner to be reviewed and approved by
staff consistent with the Certificate of Appropriateness Criteria and/or the directions
from the Board.
 - Street trees shall be required along Washington Avenue, placed with a minimum 36"
clear space between the tree trunk and the back of curb, in a manner to be reviewed
and approved by staff consistent with the Certificate of Appropriateness Criteria
and/or the directions from the Board.
 - Silva Cells in tree pits, with the City Standard black and white bound aggregate
system and fertilization trench, irrigation, and two (2) up-lights per City standards,
shall be required for all street and shade trees, in a manner to be reviewed and

Page 5 of 6
HPB File No. 7419
Meeting Date: June 10, 2014

this condition. This condition vests jurisdiction independent of any
other condition hereof.

- Satisfaction of all conditions is required for the Planning Department to give its approval on
a Certificate of Occupancy, a Temporary Certificate of Occupancy or Partial Certificate of
Occupancy may also be conditionally granted Planning Departmental approval.
- The Final Order shall be recorded in the Public Records of Miami-Dade County, prior to the
issuance of a Building Permit.
- The Final Order is not severable, and if any provision or condition hereof is held void or
unconstitutional in a final decision by a court of competent jurisdiction, the order shall be
returned to the Board for reconsideration as to whether the order meets the criteria for
approval absent the stricken provision or condition, and/or it is appropriate to modify the
remaining conditions or impose new conditions.
- The conditions of approval herein are binding on the applicant, the property's owners,
operators, and all successors in interest and assigns.
- Nothing in this order authorizes a violation of the City Code or other applicable law, nor
allows a relaxation of any requirement or standard set forth in the City Code.

IT IS HEREBY ORDERED, based upon the foregoing findings of fact, the evidence, information,
testimony and materials presented at the public hearing, which are part of the record for this
matter, and the staff report and analysis, which are adopted herein, including the staff
recommendations, which were amended by the Board, that the Certificate of Appropriateness is
GRANTED for the above-referenced project subject to those certain conditions specified in
paragraph C of the Findings of Fact (Condition Nos. 1-9 inclusive) hereof, to which the applicant
has agreed.

PROVIDED, the applicant shall build substantially in accordance with the plans approved by the
Historic Preservation Board, as determined by staff, entitled "The Angler's Hotel", as prepared
by Nichols Brosch Wurst Wolfe & Associates, Inc., dated April 25, 2014.

When requesting a building permit, the plans submitted to the Building Department for permit
shall be consistent with the plans approved by the Board, modified in accordance with the
conditions set forth in this Order. No building permit may be issued unless and until all
conditions of approval that must be satisfied prior to permit issuance, as set forth in this Order,
have been met.

The issuance of a Certificate of Appropriateness does not relieve the applicant from obtaining all
other required Municipal, County and/or State reviews and permits, including final zoning
approval. If adequate handicapped access is not provided on the Board-approved plans, the
approval does not mean that such handicapped access is not required. When requesting a
building permit, the plans submitted to the Building Department for permit shall be consistent
with the plans approved by the Board, modified in accordance with the conditions set forth in
this Order.

Page 4 of 6
HPB File No. 7419
Meeting Date: June 10, 2014

approved by staff consistent with the Certificate of Appropriateness Criteria and/or
the directions from the Board.

- The utilization of root barriers and/or Silva Cells, as applicable, shall be clearly
delineated on the revised landscape plan.
- A fully automatic irrigation system with 100% coverage and an automatic rain sensor
in order to render the system inoperative in the event of rain. Right-of-way areas
shall also be incorporated as part of the irrigation system.
- FPL transformers or vault rooms, backflow preventers and all other related devices
and fixtures shall not be permitted within any required yard or any area fronting a
street or sidewalk. Their location and how they are screened with landscape
material from the right-of-way, shall be clearly indicated on the site and landscape
plans in a manner to be reviewed and approved by staff consistent with the
Certificate of Appropriateness Criteria and/or the directions from the Board.
- The Applicant agrees to the following operational conditions for any and all
permitted main and accessory uses and shall bind itself, lessees, permittees,
concessionaires, renters, guests, users, and successors and assigns and all
successors in interest in whole or in part to comply with the following operational
requirements and/or limitations.

OUTDOOR CONDITIONS

- The applicant shall ensure through appropriate contracts,
assignments and management rules that these restrictions are
enforced. Owner agrees to include the rules and regulations set forth
in these conditions in any contract or assignment.
- All rooftop facilities shall cease operation at 12:00 am, 7 days a week.
Special Events pursuant to the Miami Beach City Code shall not
exceed the permitted hours of operation.
- All facilities located within the west courtyard shall cease operation at
10:00 p.m., 7 days a week. Special Events pursuant to the Miami
Beach City Code shall not exceed the permitted hours of operation.

NOISE CONDITIONS

- The Historic Preservation Board (HPB) or the Planning Director shall
retain the right to call the owners and/or operators back before the
HPB, at the expense of the owners and/or operators, to impose
and/or modify the hours of operation, should there be a valid violation
(as determined by Code Compliance) about loud, excessive,
unnecessary, or unusual noise or other conditions of this approval.
An adverse adjudication of a violation against the owner or operator
not necessary for the board to have jurisdiction over the matter under

OR BK 20219 FG 1069
LAST PAGE

Page 6 of 6
HPB File No. 7419
Meeting Date: June 10, 2014

If the Full Building Permit for the project is not issued within eighteen (18) months of the meeting
date at which the original Certificate of Appropriateness was granted, the Certificate of
Appropriateness will expire and become null and void. If the Full Building Permit for the project
should expire for any reason (including but not limited to construction not commencing and
continuing, with required inspections, in accordance with the applicable Building Code), the
Certificate of Appropriateness will expire and become null and void.

In accordance with Section 118-561 of the City Code, the violation of any conditions and
safeguards that are a part of this Order shall be deemed a violation of the land development
regulations of the City Code. Failure to comply with this Order shall subject the Certificate of
Appropriateness to Section 118-564, City Code, for revocation or modification of the Certificate
of Appropriateness.

Dated this 13th day of JUNE, 2014

HISTORIC PRESERVATION BOARD
THE CITY OF MIAMI BEACH, FLORIDA

BY: Thomas R. Mooney, AICP
DESIGN AND PRESERVATION MANAGER
FOR THE CHAIR

STATE OF FLORIDA)
COUNTY OF MIAMI-DADE)

STATE OF FLORIDA, COUNTY OF DADE
I HEREBY CERTIFY that the foregoing is a true and correct copy of the original as
signed and filed in the office of the Clerk of Court, Miami-Dade County, Florida,
this 13th day of June, 2014.
Notary Public, State of Florida
My Commission Expires: 12-2-17

The foregoing instrument was acknowledged before me this 13th day of
June, 2014 by Thomas R. Mooney, Design and Preservation Manager,
Planning Department, City of Miami Beach, Florida, a Florida Municipal Corporation, on behalf
of the corporation. He is personally known to me.


TERRA MARA
NOTARY PUBLIC
MIAMI-DADE COUNTY, FLORIDA
EXPIRES December 2, 2017
Elected Notary Public History Services

Approved As To Form:
Legal Department: [Signature]

Filed with the Clerk of the Historic Preservation Board on 6-16-14 (WJR)
F:\PLANS\HPB\1415\Jun14\7419-Jun14 FG.docx

REVIEWED
CITY OF MIAMI BEACH
FILE DEPARTMENT

ARCHITECT

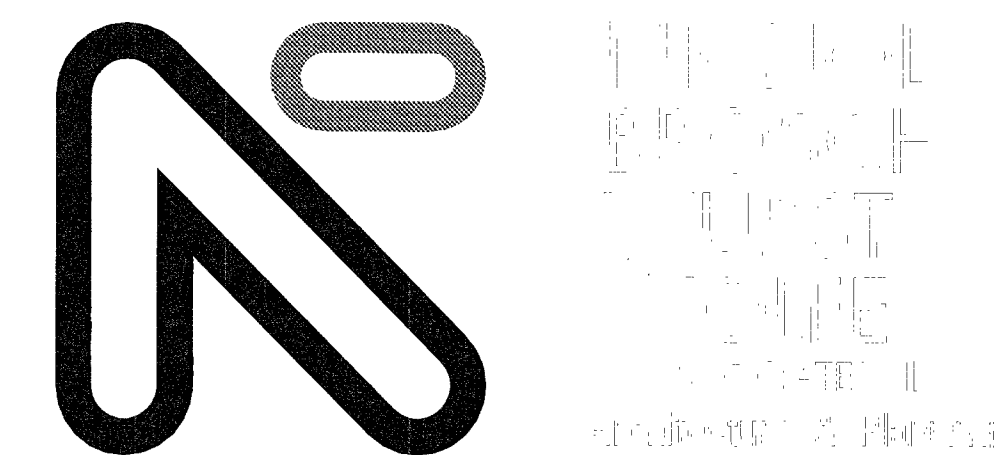

161 ALMERIA AVENUE
CORAL GABLES, FLORIDA 33134
(305) 443-5206 FAX: (305) 446-2872
JAMES P. WURST
ARCHITECT
LIC.20303

STRUCTURAL ENGINEERING

OPTIMUS STRUCTURAL DESIGN, LLC.

7850 NW 146th STREET, SUITE 305
MIAMI LAKES, FLORIDA 33016
TEL: (305) 512-5860 FAX: (305) 512-5861

MECHANICAL / ELECTRICAL / PLUMBING

LAUREDO ENGINEERING CO.

1941 SW 18th AVENUE
MIAMI, FLORIDA 33145
TEL: (305) 445-9725 FAX: (786) 378-6743

CIVIL ENGINEERING

VSN ENGINEERING, INC.

8550 WEST FLAGLER STREET, SUITE 113
MIAMI, FLORIDA 33144
TEL: (305) 551-6267 FAX: (305) 551-4542

LANDSCAPE ARCHITECT

STANTEC

915 OUTER ROAD, SUITE 200
ORLANDO, FLORIDA 32814
TEL: (407) 237-0669 FAX: (407) 237-0973

INTERIOR DESIGNER

NICOLE HOLLIS

935 NATOMA STREET
SAN FRANCISCO, CALIFORNIA 94103
TEL: (415) 733-9621 FAX: (415) 278-9458

DRAWING INDEX - ARCHITECTURE				
NUMBER	SHEET NAME	10/13/14 PERMIT ISSUE	12/16/14 CMB Comments	01/15/15 CMB Comments-Rev2
A0.00	COVER	.	.	.
A0.00.1	HISTORIC PRESERVATION BOARD	.	.	.
A0.01	INDEX	.	.	.
A0.02	GENERAL NOTES AND SYMBOLS	.	.	.
A0.03	F.A.R. CALCULATION	.	.	.
A0.03.1	FAR-EXISTING BUILDINGS	.	.	.
A0.03.2	FAR-EXISTING BUILDING-1	.	.	.
A0.04	GROSS AREA CALCULATION	.	.	.
A0.04.1	DEMOLITION PLAN	.	.	.
A1.00	SITE PLAN	.	.	.
A2.00	LIFE SAFETY GENERAL NOTES AND LEGENDS	.	.	.
A2.01	LIFE SAFETY GARAGE LEVEL	.	.	.
A2.02	LIFE SAFETY LEVEL 100	.	.	.
A2.03	LIFE SAFETY LEVEL 200	.	.	.
A2.04	LIFE SAFETY LEVEL 300	.	.	.
A2.05	LIFE SAFETY LEVEL 400	.	.	.
A2.06	LIFE SAFETY LEVEL 500	.	.	.
A2.07	LIFE SAFETY POOL DECK	.	.	.
A3.00	OVERALL REFERENCE PLAN - LEVEL 100	.	.	.
A4.00	BASEMENT LEVEL FLOOR PLAN	.	.	.
A4.01	LEVEL 100 FLOOR PLAN	.	.	.
A4.01.1	LEVEL 100 FLOOD BARRIER PLAN	.	.	.
A4.02	LEVEL 200 FLOOR PLAN	.	.	.
A4.03	LEVEL 300 FLOOR PLAN	.	.	.
A4.04	LEVEL 400 FLOOR PLAN	.	.	.
A4.05	LEVEL 500 FLOOR PLAN	.	.	.
A4.06	RECREATION / POOL DECK FLOOR PLAN	.	.	.
A4.07	UPPER ROOF PLAN	.	.	.
A5.00	ENLARGED UNIT PLANS	.	.	.
A5.01	ENLARGED UNIT PLANS	.	.	.
A5.02	ENLARGED UNIT PLANS	.	.	.
A5.03	ENLARGED UNIT PLANS	.	.	.
A5.04	ENLARGED UNIT PLANS	.	.	.
A5.05	ENLARGED FLOOR PLANS	.	.	.
A5.06	LOBBY BAR - LEVEL 100	.	.	.
A6.00	BASEMENT-REFLECTED CEILING PLAN	.	.	.
A6.01	LEVEL 100 REFLECTED CEILING PLAN	.	.	.
A6.02	LEVEL 200 REFLECTED CEILING PLAN	.	.	.
A6.03	LEVEL 300 REFLECTED CEILING PLAN	.	.	.
A6.04	LEVEL 400 REFLECTED CEILING PLAN	.	.	.
A6.05	LEVEL 500 REFLECTED CEILING PLAN	.	.	.
A6.06	UPPER POOL DECK REFLECTED CEILING PLAN	.	.	.
A7.00	ENLARGED CORE PLANS	.	.	.
A7.01	ENLARGED CORE PLANS	.	.	.
A7.02	SECTION - ELEVATOR CORE	.	.	.
A7.03	ENLARGED STAIR PLANS	.	.	.
A7.04	STAIR SECTIONS	.	.	.
A7.05	ENLARGED STAIR PLANS AND SECTION	.	.	.
A7.06	ENLARGED STAIR PLANS AND SECTIONS	.	.	.
A7.07	ENLARGED STAIR PLANS AND SECTIONS	.	.	.
A7.08	ENLARGED STAIR/RAMP PLANS AND SECTIONS	.	.	.
A8.00	BUILDING ELEVATIONS	.	.	.
A8.01	BUILDING ELEVATIONS	.	.	.
A8.02	BUILDING ELEVATIONS	.	.	.
A8.03	ALLOWED OPENINGS CALCULATION	.	.	.


DRAWING INDEX - ARCHITECTURE				
NUMBER	SHEET NAME	10/13/14 PERMIT ISSUE	12/16/14 CMB Comments	01/15/15 CMB Comments-Rev2
A10.00	BUILDING SECTIONS	.	.	.
A10.01	BUILDING SECTIONS	.	.	.
A10.02	WALL SECTIONS	.	.	.
A10.03	WALL SECTIONS	.	.	.
A10.04	WALL SECTIONS	.	.	.
A10.05	WALL SECTIONS	.	.	.
A10.06	WALL SECTIONS	.	.	.
A10.07	PARTIAL BUILDING SECTIONS	.	.	.
A11.00	STOREFRONT ELEVATIONS	.	.	.
A11.01	WINDOW ELEVATIONS / SCHEDULE	.	.	.
A11.02	WINDOW ELEVATIONS / SCHEDULE	.	.	.
A12.00	WALL TYPES	.	.	.
A12.01	WALL TYPES	.	.	.
A12.02	WALL TYPES	.	.	.
A12.03	DETAILS	.	.	.
A12.04	UL DETAILS	.	.	.
A12.04.1	UL DETAILS	.	.	.
A12.05	UL DETAILS	.	.	.
A12.06	DETAILS	.	.	.
A12.07	DETAILS	.	.	.
A12.08	DETAILS	.	.	.
A12.09	DETAILS	.	.	.
A12.10	DETAILS	.	.	.
A12.11	DETAILS	.	.	.
A12.12	DETAILS	.	.	.
A12.13	DETAILS	.	.	.
A12.14	DETAILS	.	.	.
A12.15	DETAILS	.	.	.
A12.15.1	DETAILS	.	.	.
A12.16	DETAILS	.	.	.
A12.17	DETAILS	.	.	.
A12.18	DETAILS	.	.	.
A12.19	DETAILS	.	.	.
A12.20	DETAILS	.	.	.
A12.21	DETAILS	.	.	.
A12.22	DETAILS	.	.	.
A12.23	DETAILS	.	.	.
A12.24	DETAILS	.	.	.
A12.25	DETAILS	.	.	.
A12.26	DETAILS	.	.	.
A13.00	ROOM FINISH SCHEDULE	.	.	.
A14.00	DOOR SCHEDULE	.	.	.
A14.01	DOOR SCHEDULE	.	.	.
A15.00	NOA APPROVED PRODUCTS	.	.	.
ADA-1	ADA DETAILS	.	.	.
ADA-2	ADA DETAILS	.	.	.
ADA-3	ADA DETAILS	.	.	.
ADA-4	ADA DETAILS	.	.	.
ADA-5	ADA DETAILS	.	.	.
ADA-6	ADA DETAILS	.	.	.

REVIEWED
CITY OF MIAMI DEPT
FIRE DEPARTMENT
APPROVED


JAN 15 2015

[Signature]


F.A.R. CALCULATION		
Level	Name	Area
LEVEL 100	F.A.R. AREA	11,820 SF
LEVEL 200	F.A.R. AREA	7,999 SF
LEVEL 300	F.A.R. AREA	9,575 SF
LEVEL 400	F.A.R. AREA	9,575 SF
LEVEL 500	F.A.R. AREA	9,575 SF
UPPER POOL DECK	F.A.R. AREA	1,268 SF
		49,803 SF

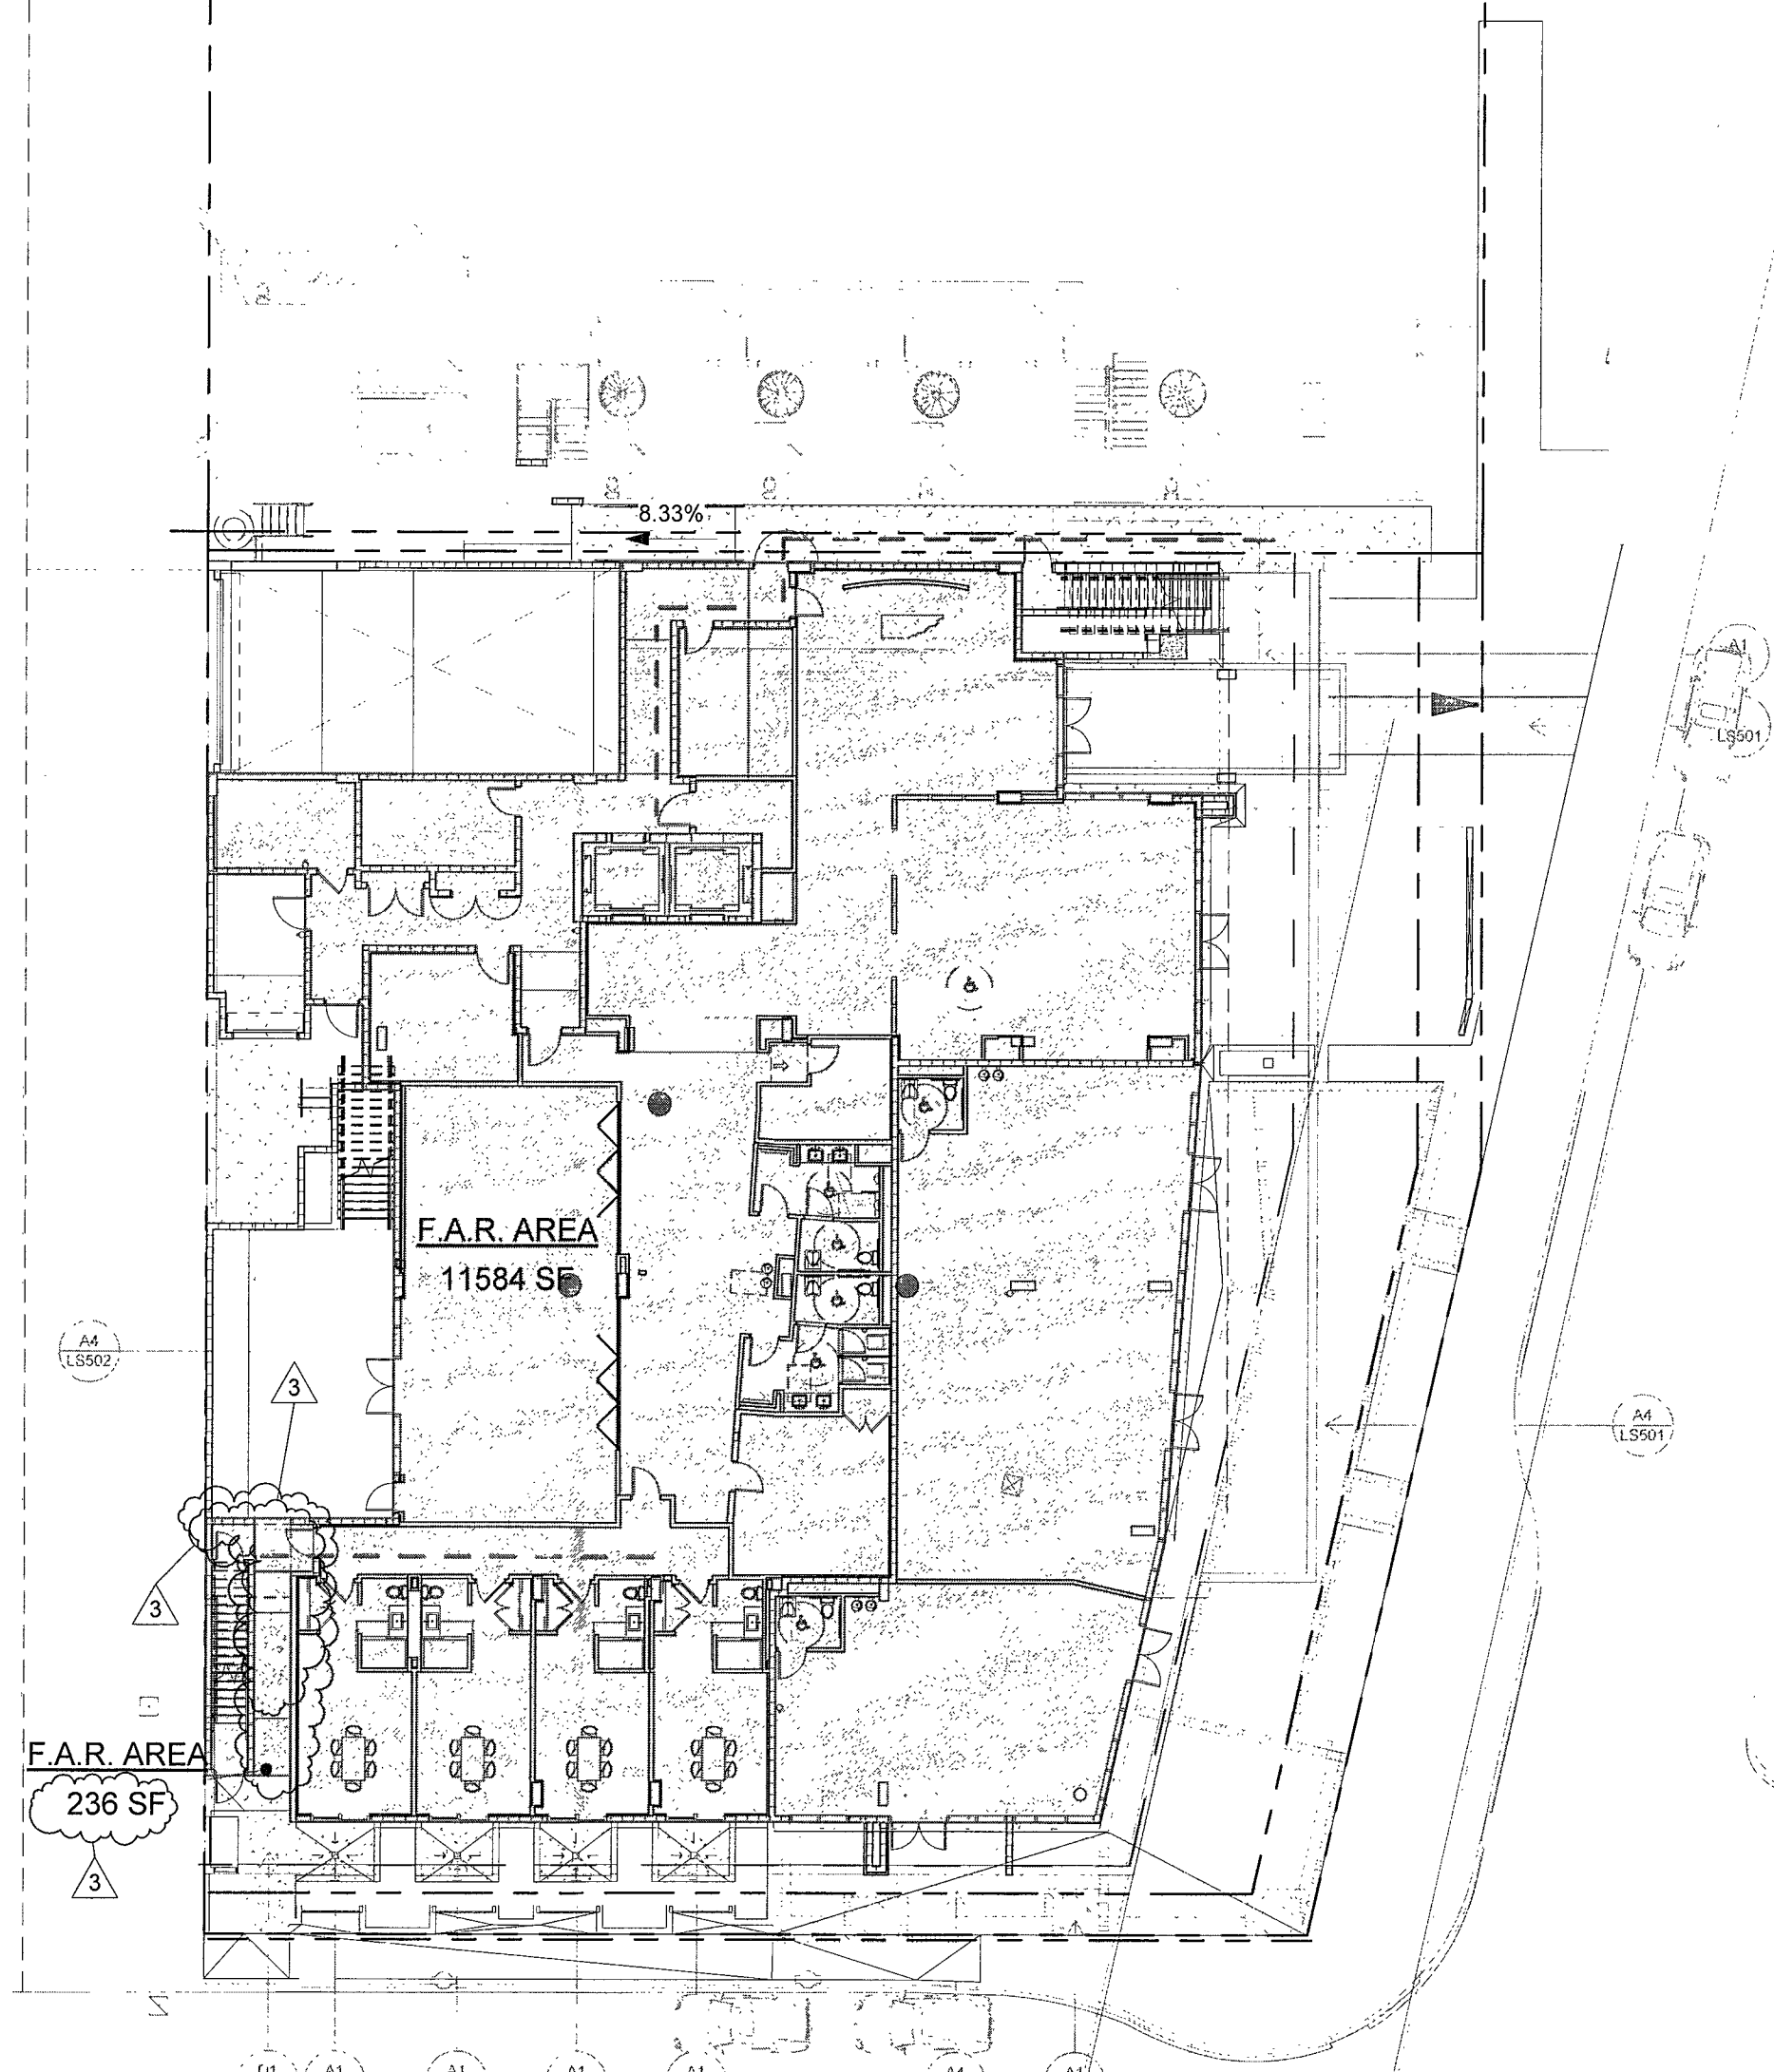


1 LEVEL 100
A0.03 1" = 20'-0"

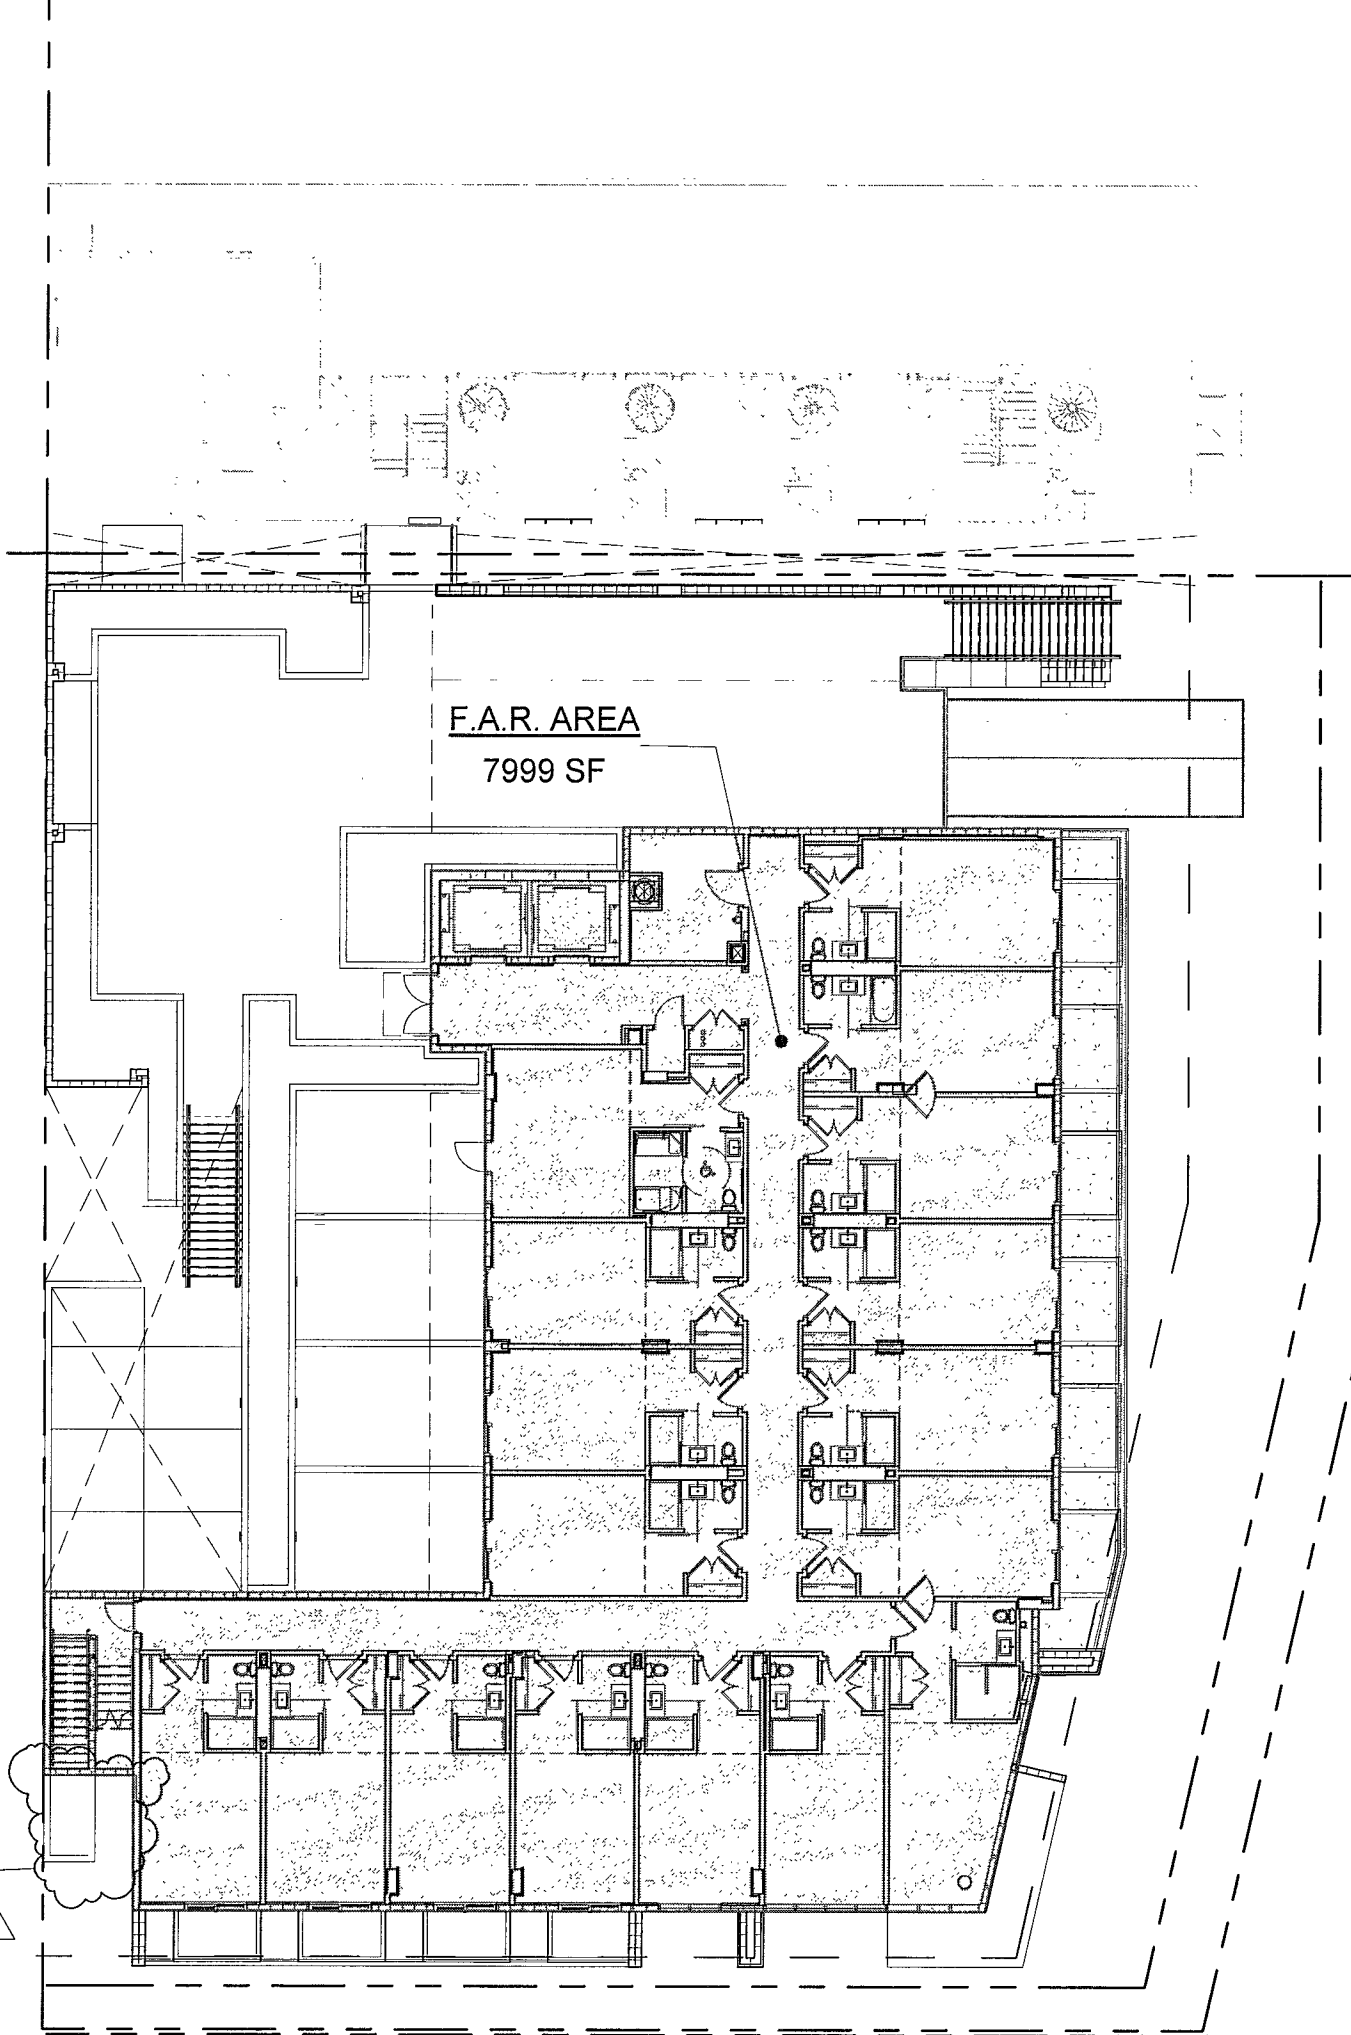


2 LEVEL 200
A0.03 1" = 20'-0"

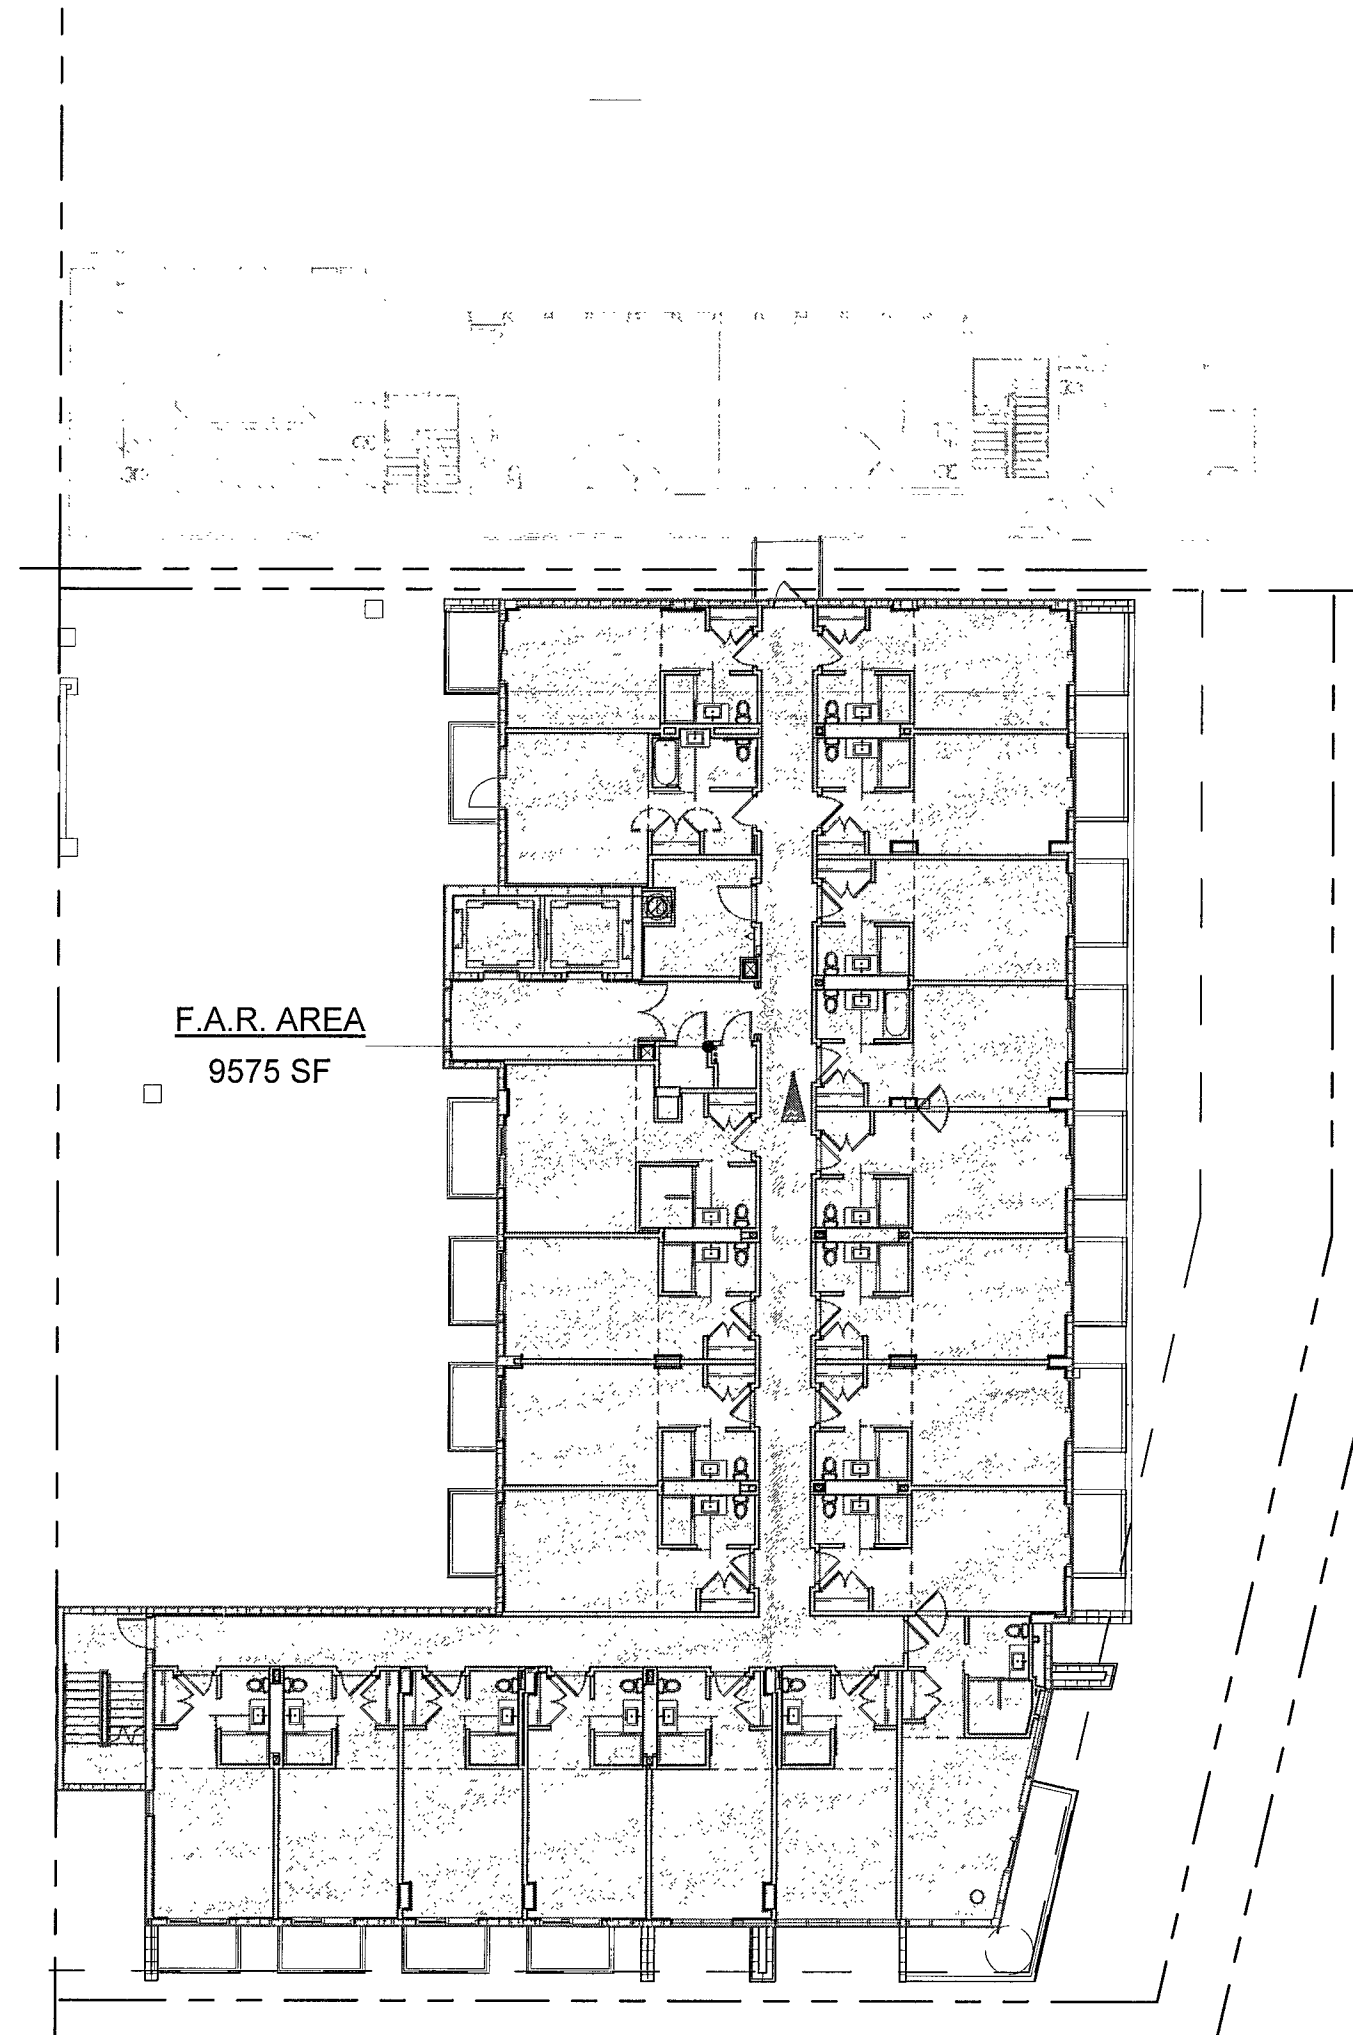


3 LEVEL 300
A0.03 1" = 20'-0"

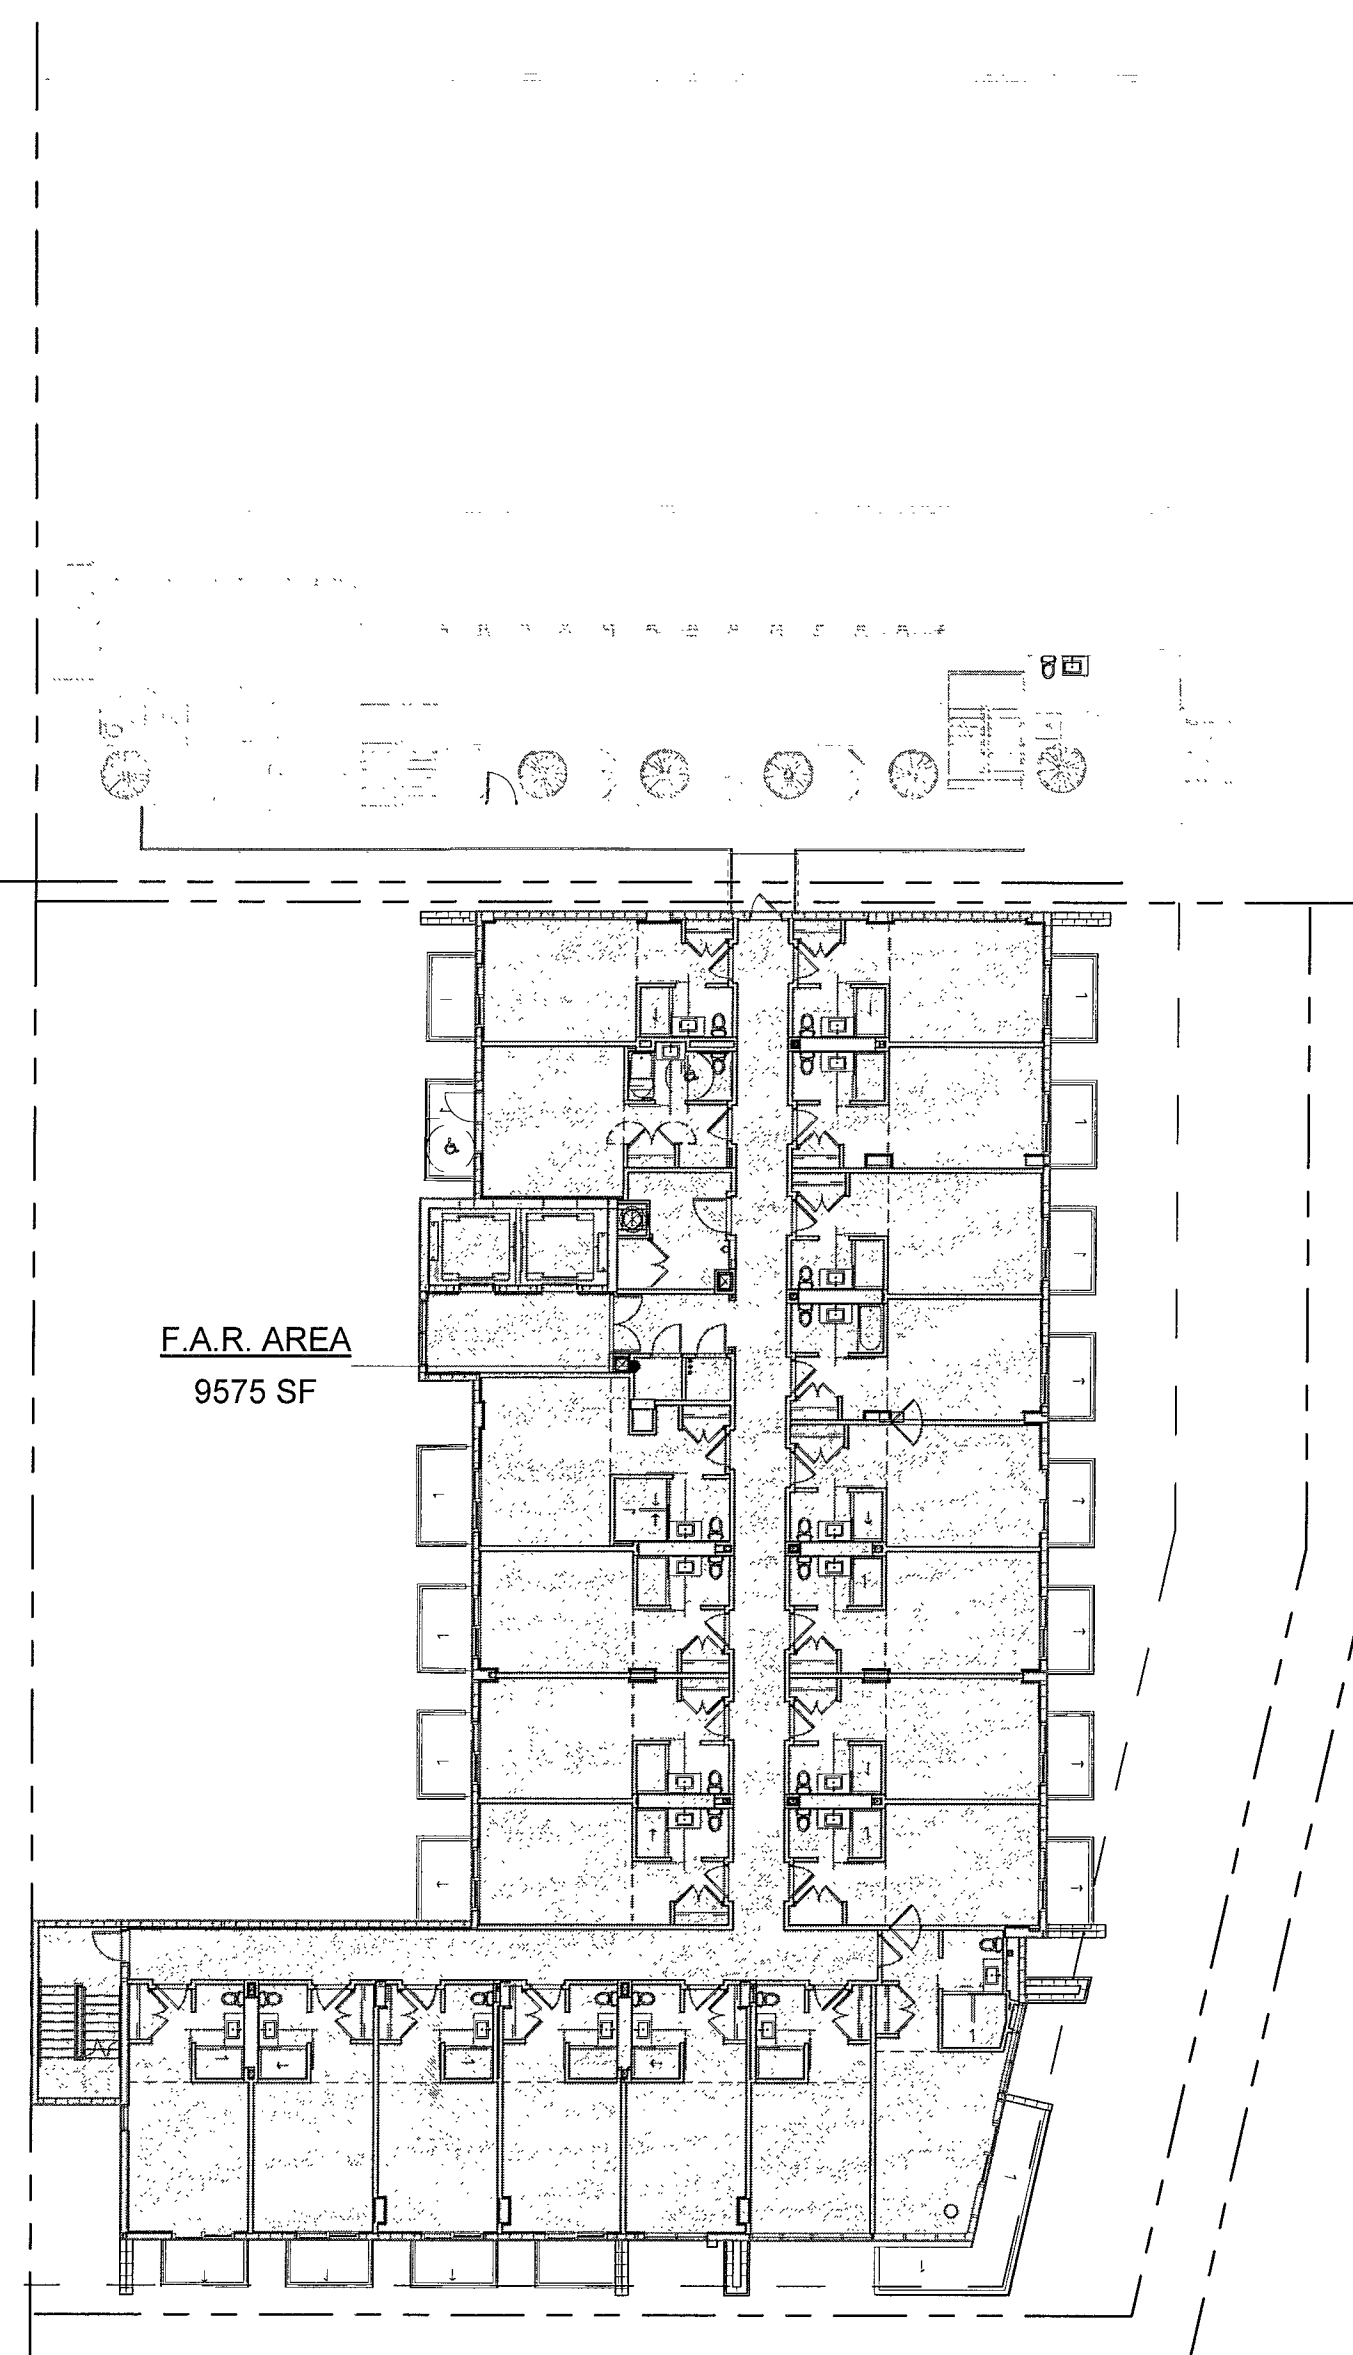

4 LEVEL 400
A0.03 1" = 20'-0"

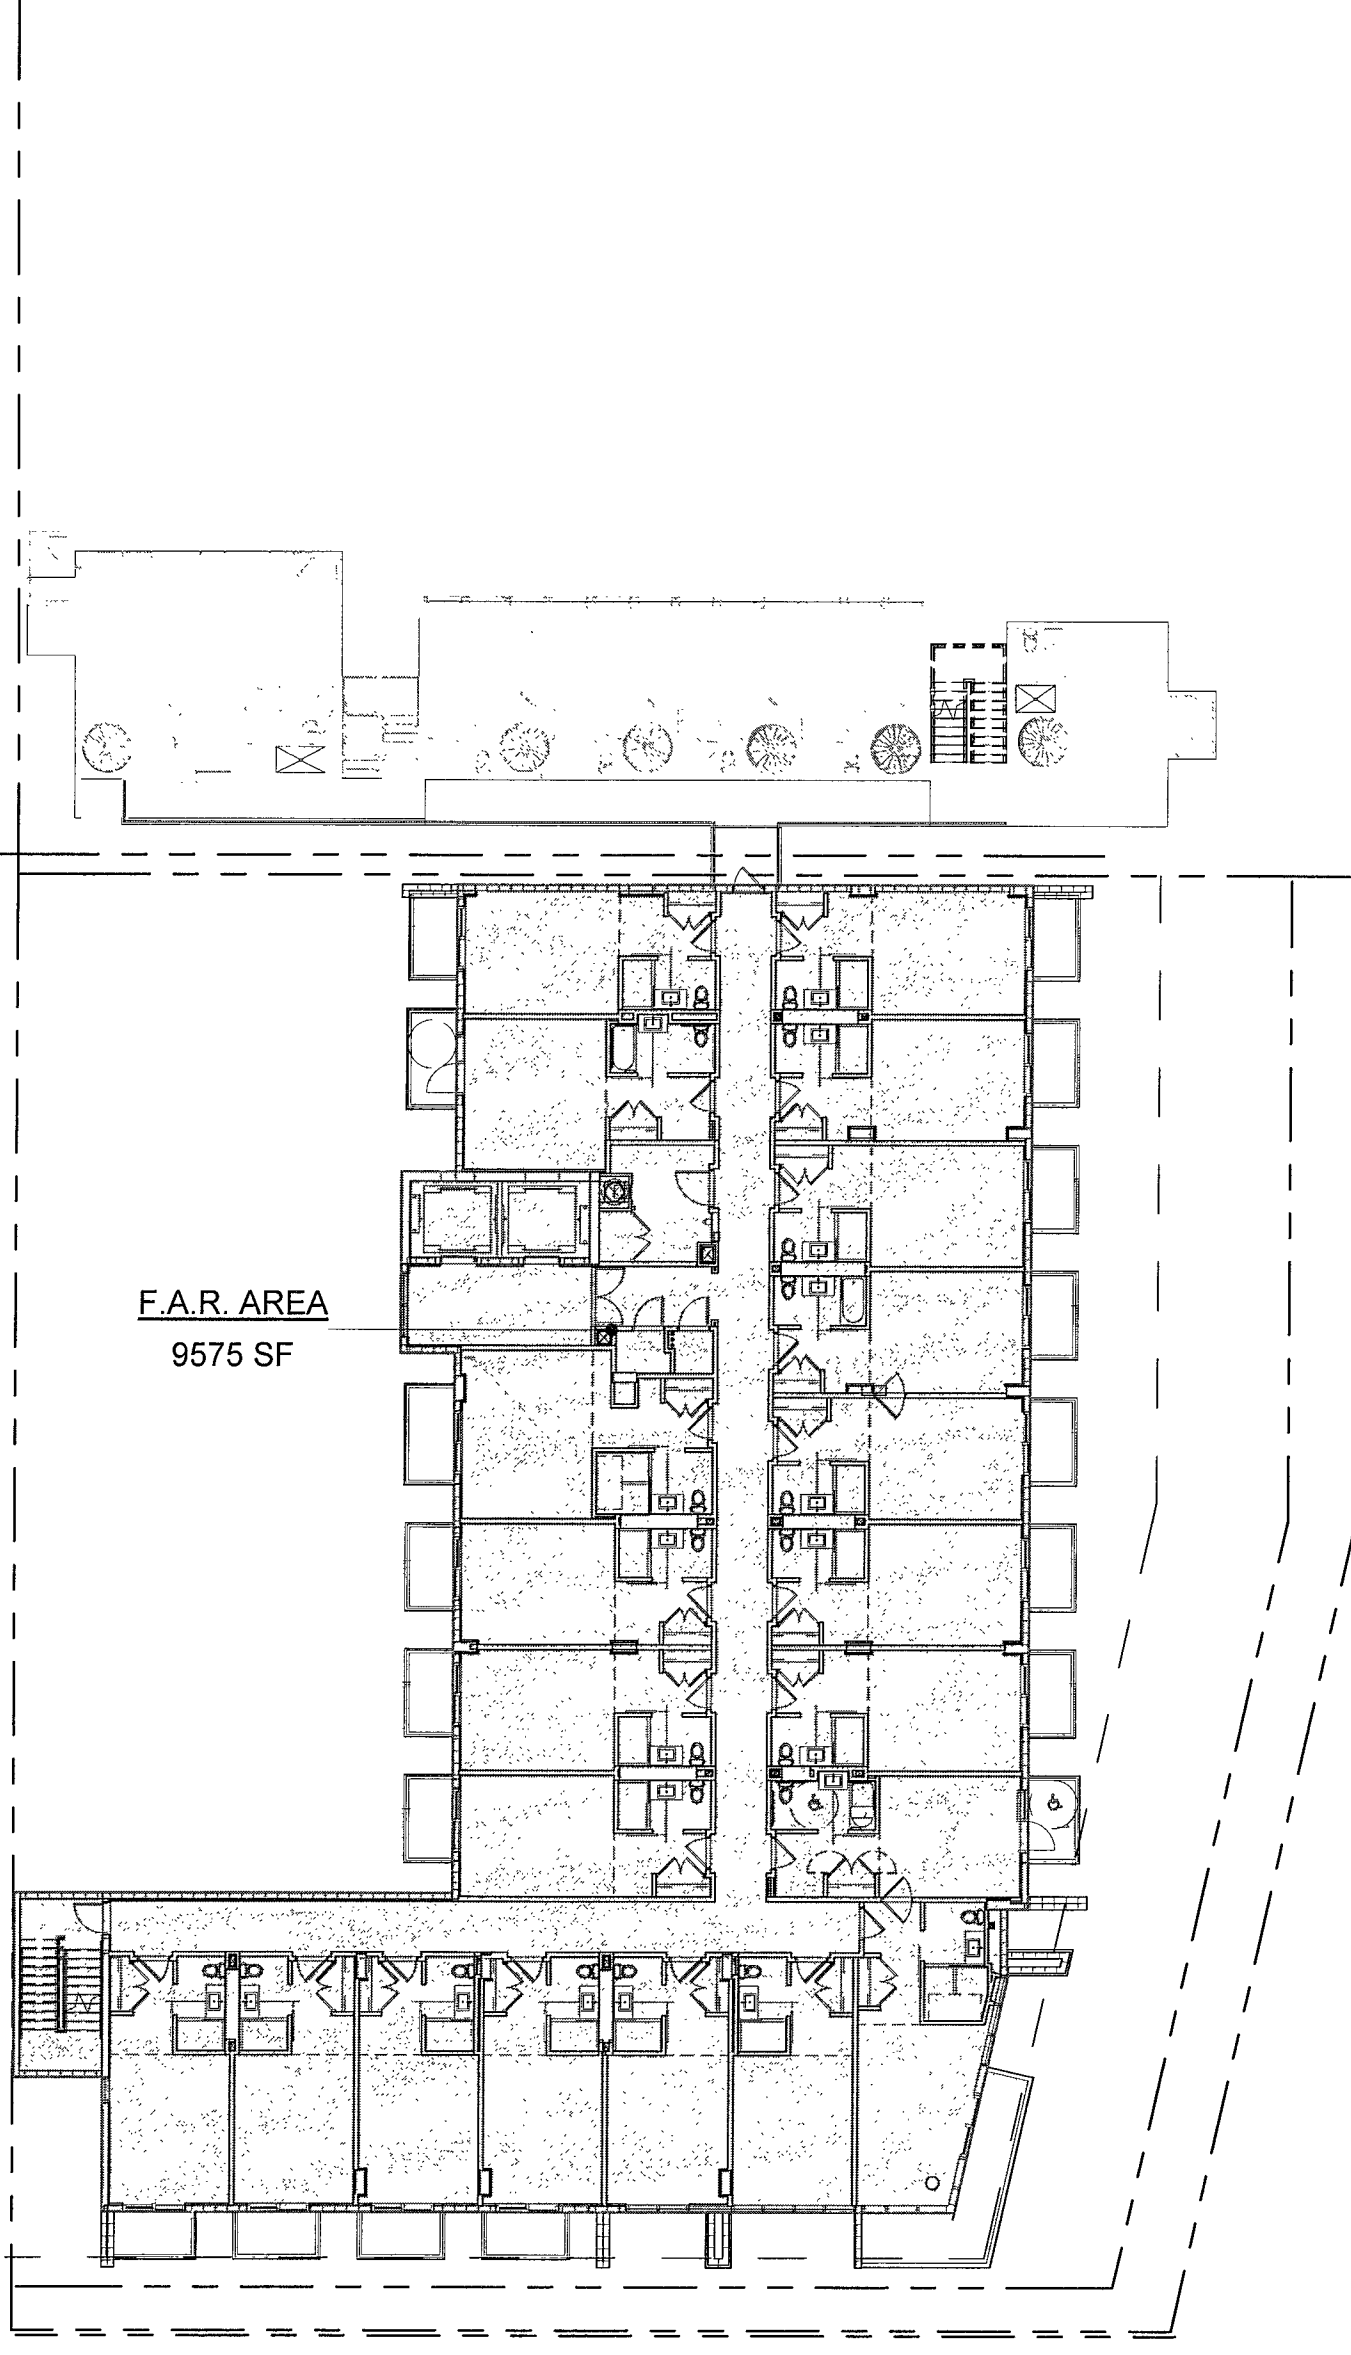

5 LEVEL 500
A0.03 1" = 20'-0"

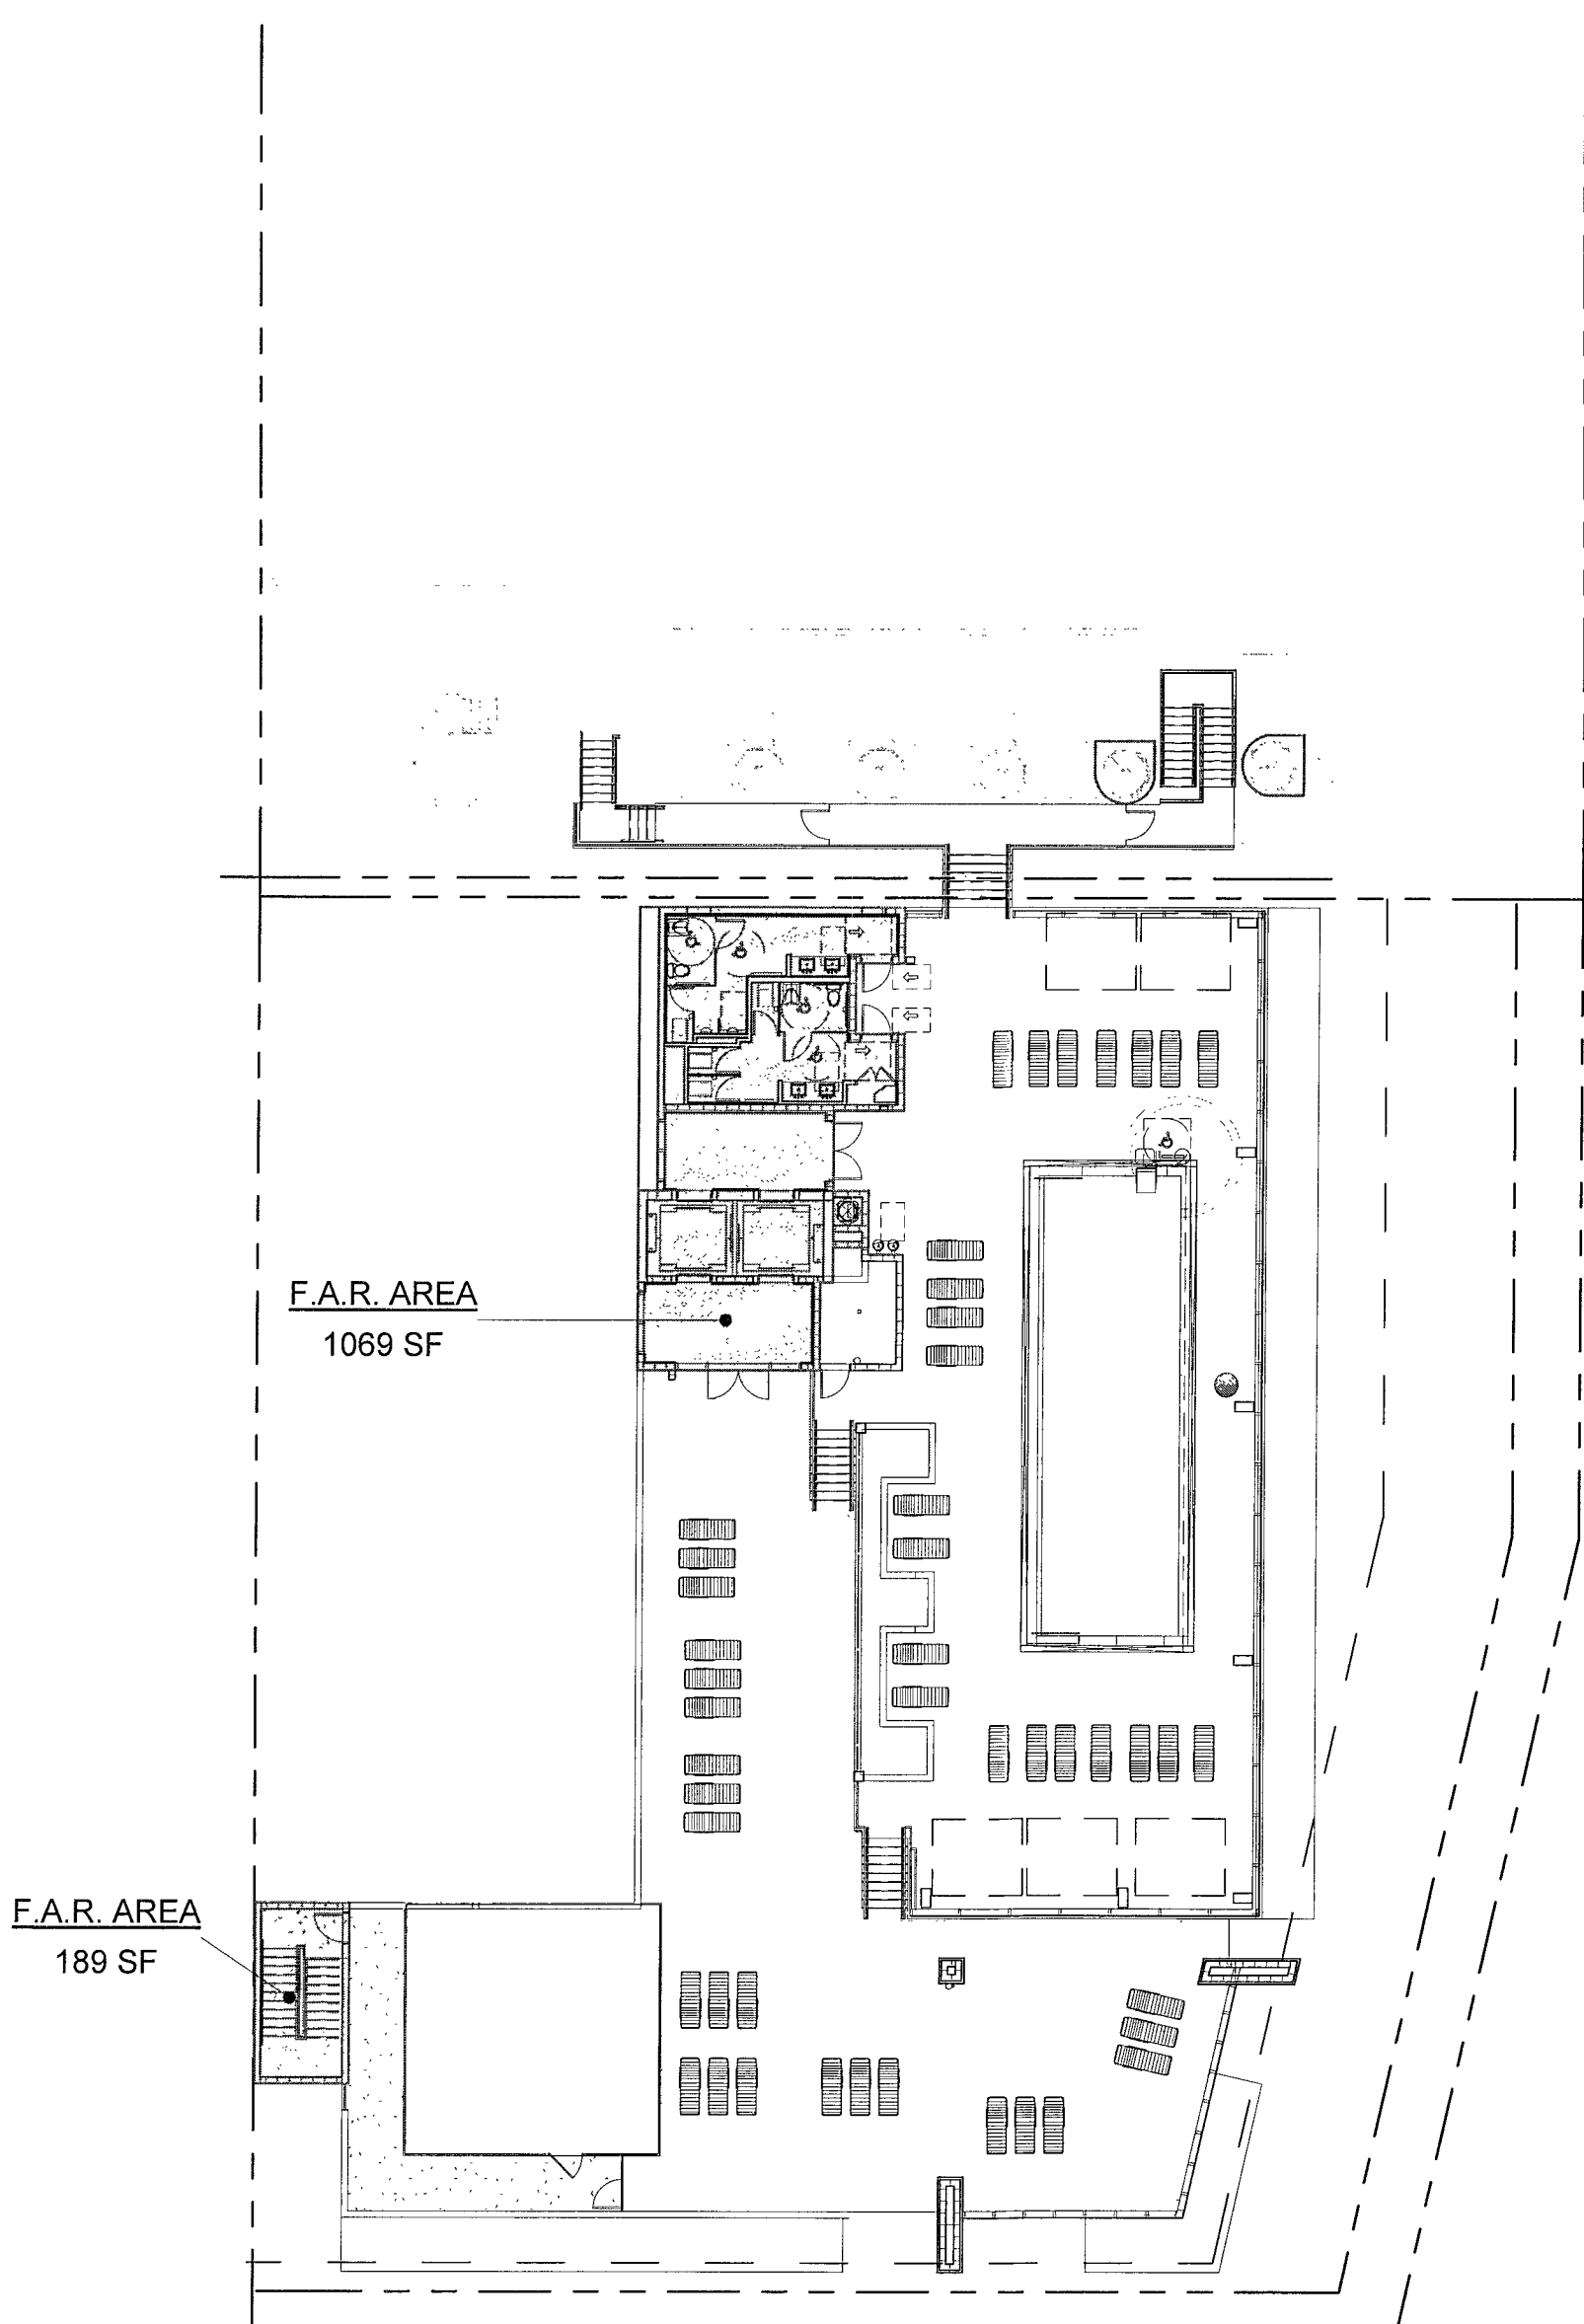


6 UPPER POOL DECK
A0.03 1" = 20'-0"

25 JUN 15

REVISIONS		
#	Description	Date
2	CMB Bldg Dept. Comments	01/15/15
3	CMB Bldg Dept. Comments	02/25/15


12064

A0.03.1
NEW SHEET

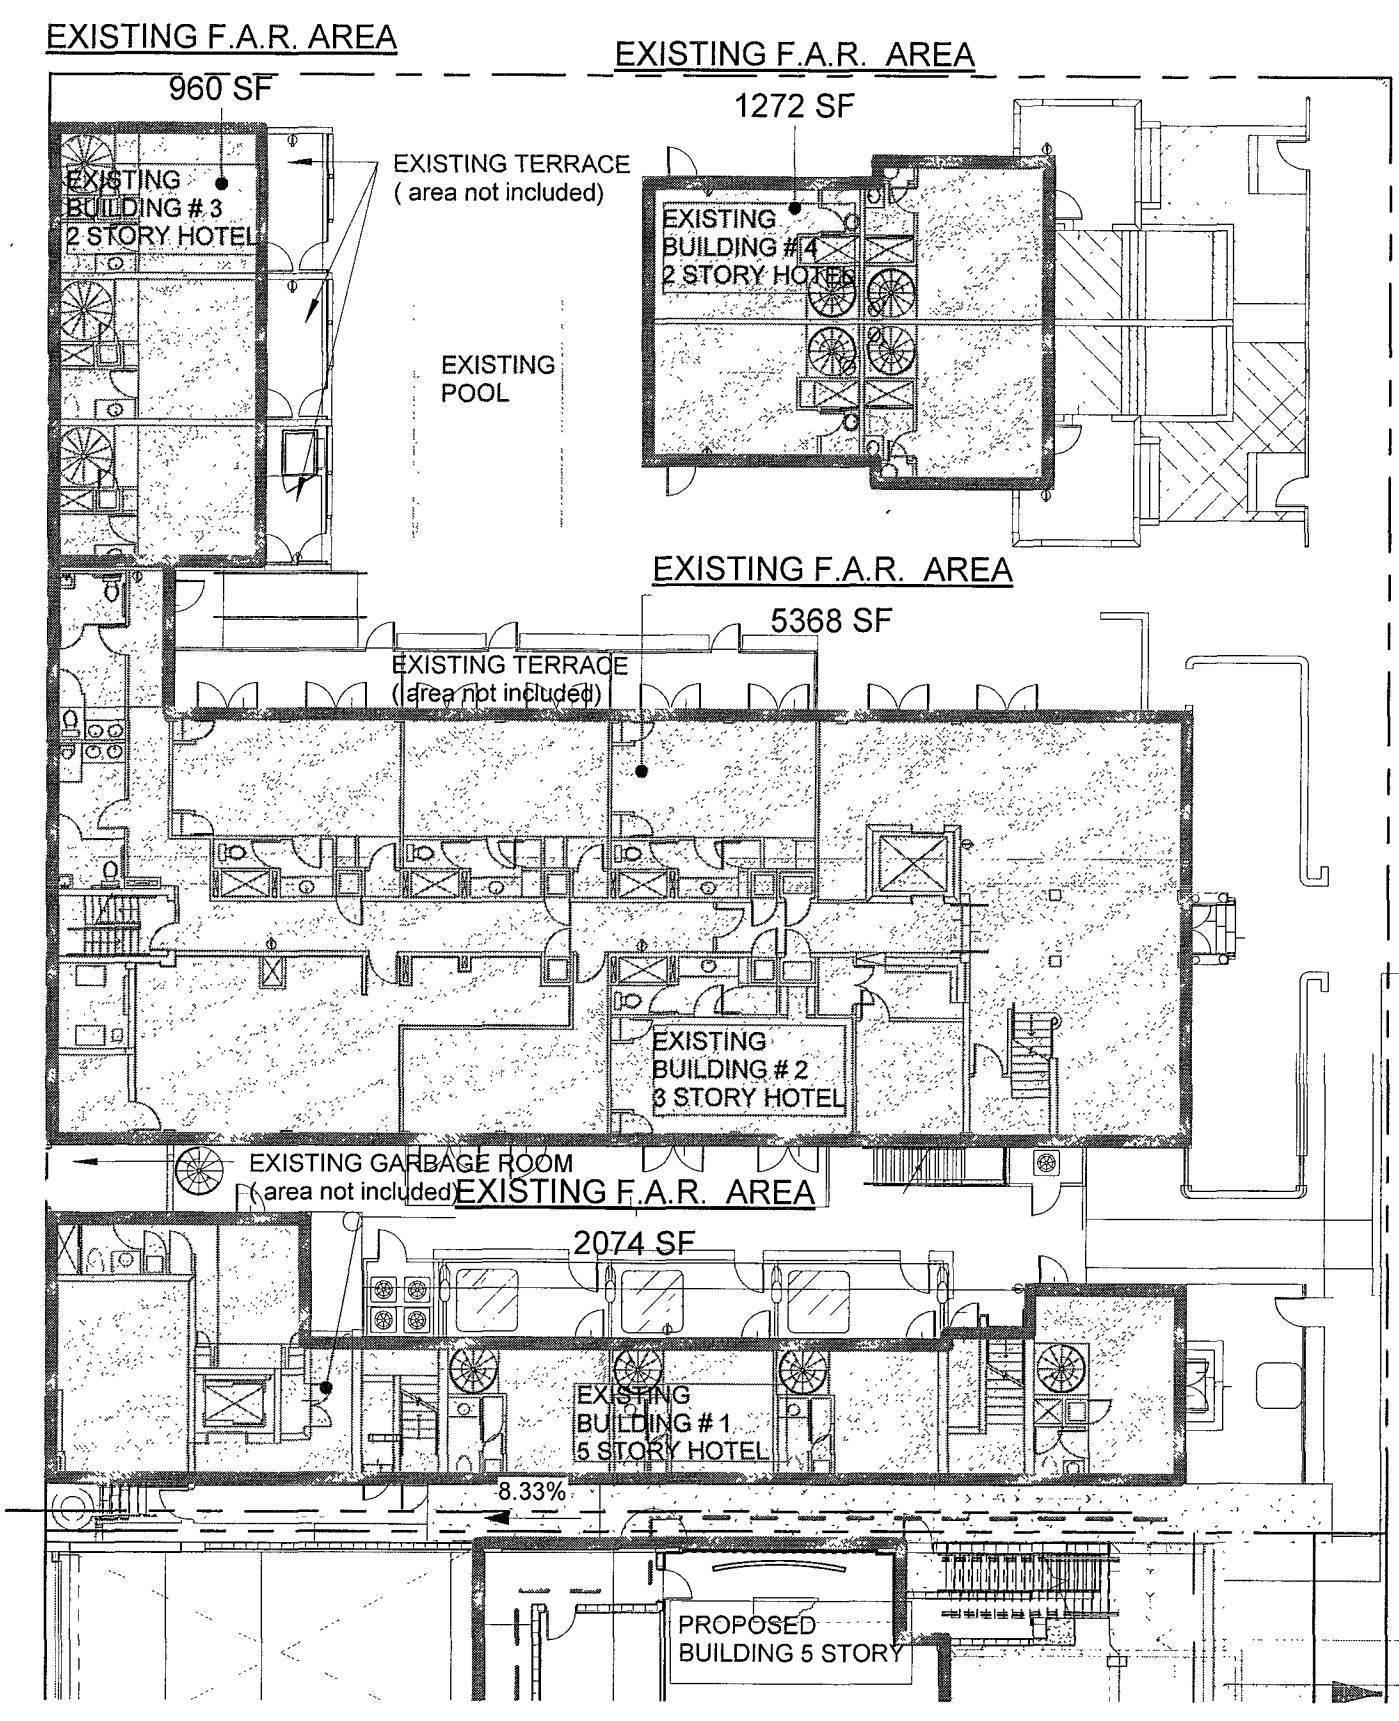


1 F.A.R. LEVEL 100 EXISTING BUILDINGS 1,2,3 AND 4
A0.03.1 1" = 20'-0"

Existing Angler's Hotel F.A.R. Calculation-100 Level-Buildings 1,2,3 and 4		
Level	Name	Area
LEVEL 100	EXISTING F.A.R. AREA	9,674 SF

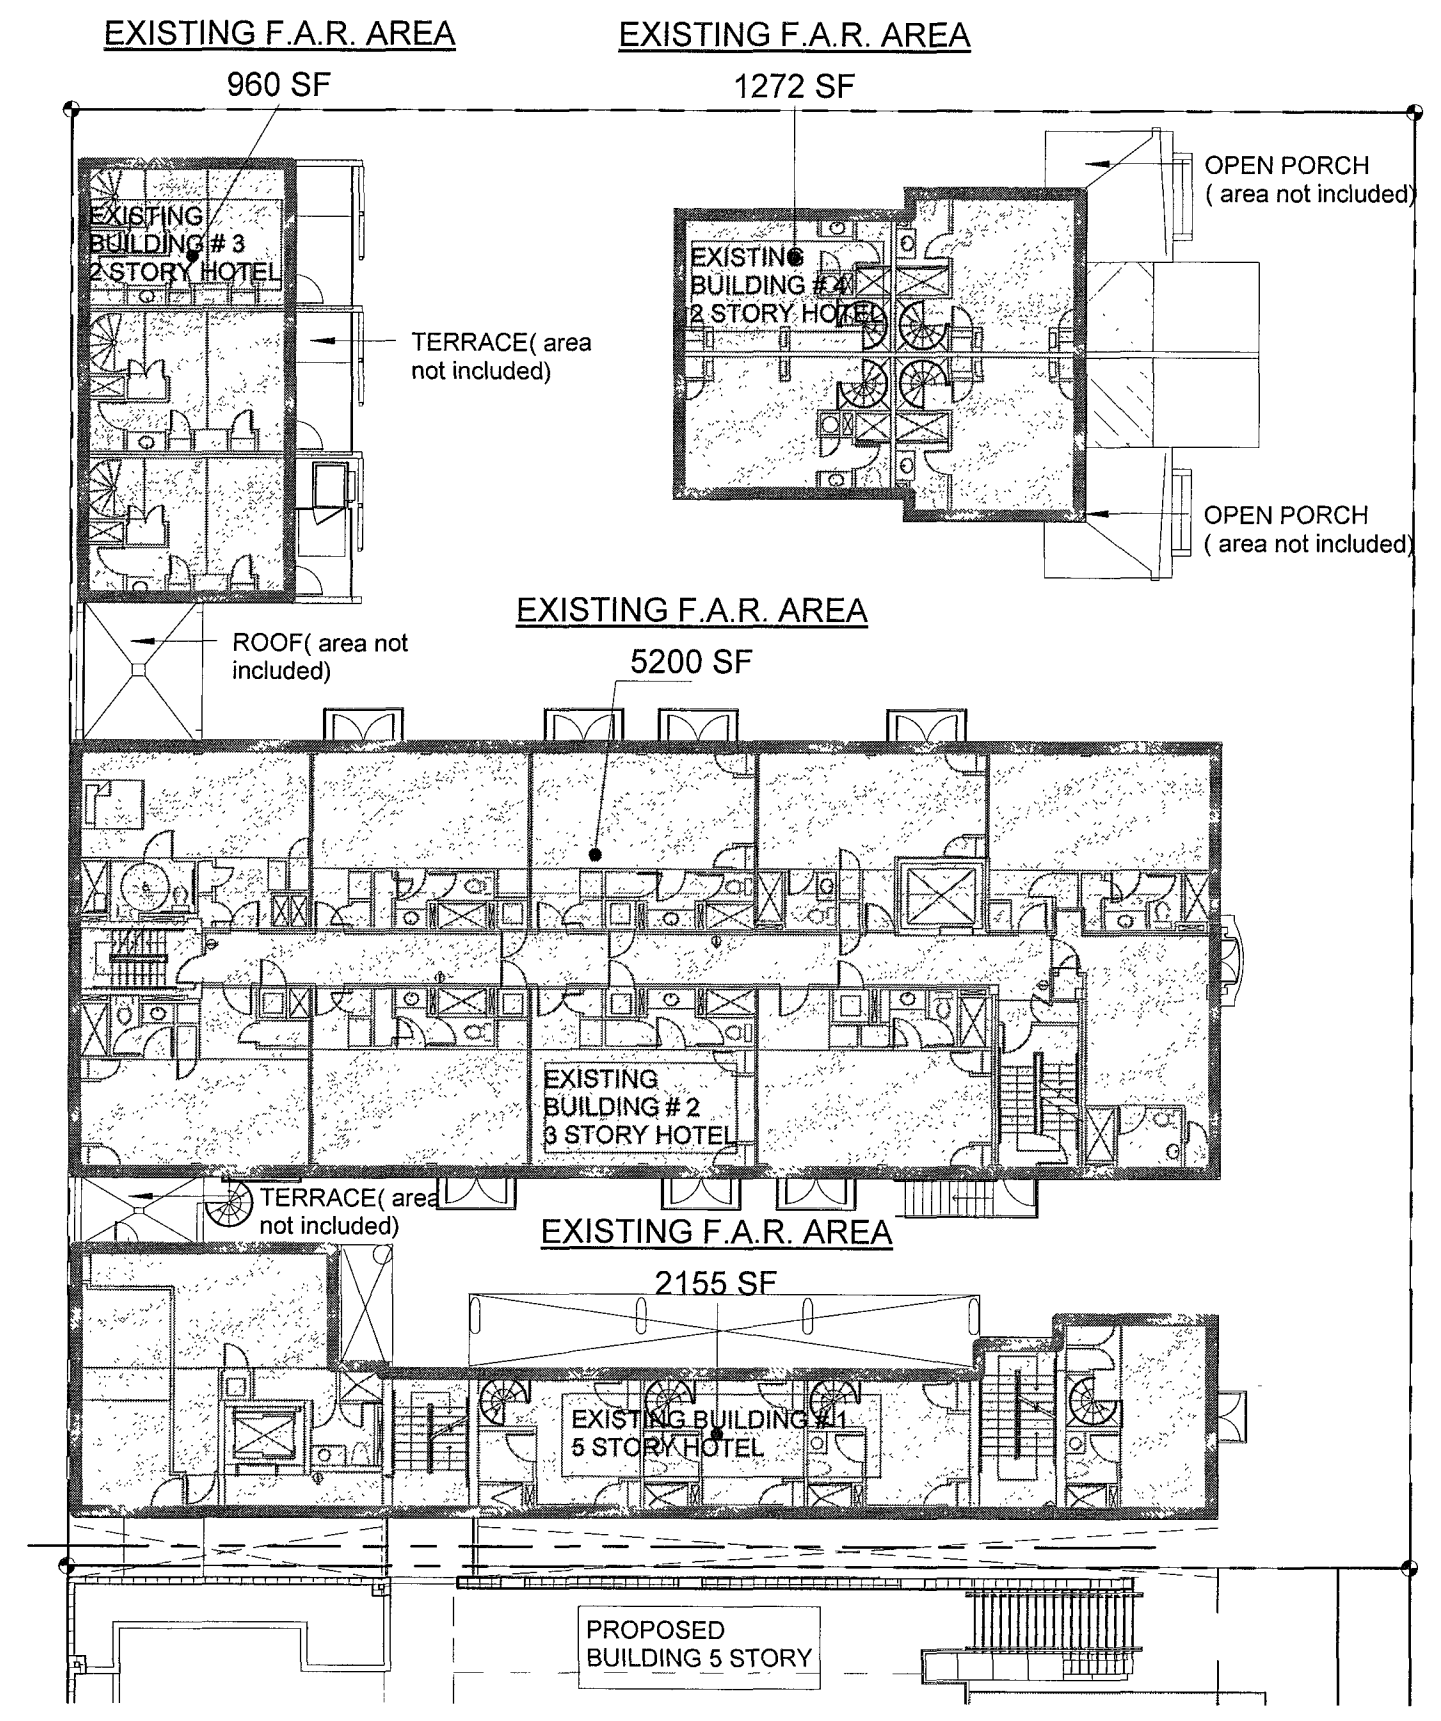


2 F.A.R. LEVEL 200 EXISTING BUILDINGS 1,2,3 AND 4
A0.03.1 1" = 20'-0"

Existing Angler's Hotel F.A.R. Calculation-200 Level Buildings 1,2,3 and 4		
Level	Name	Area
LEVEL 200	EXISTING F.A.R. AREA	9,588 SF

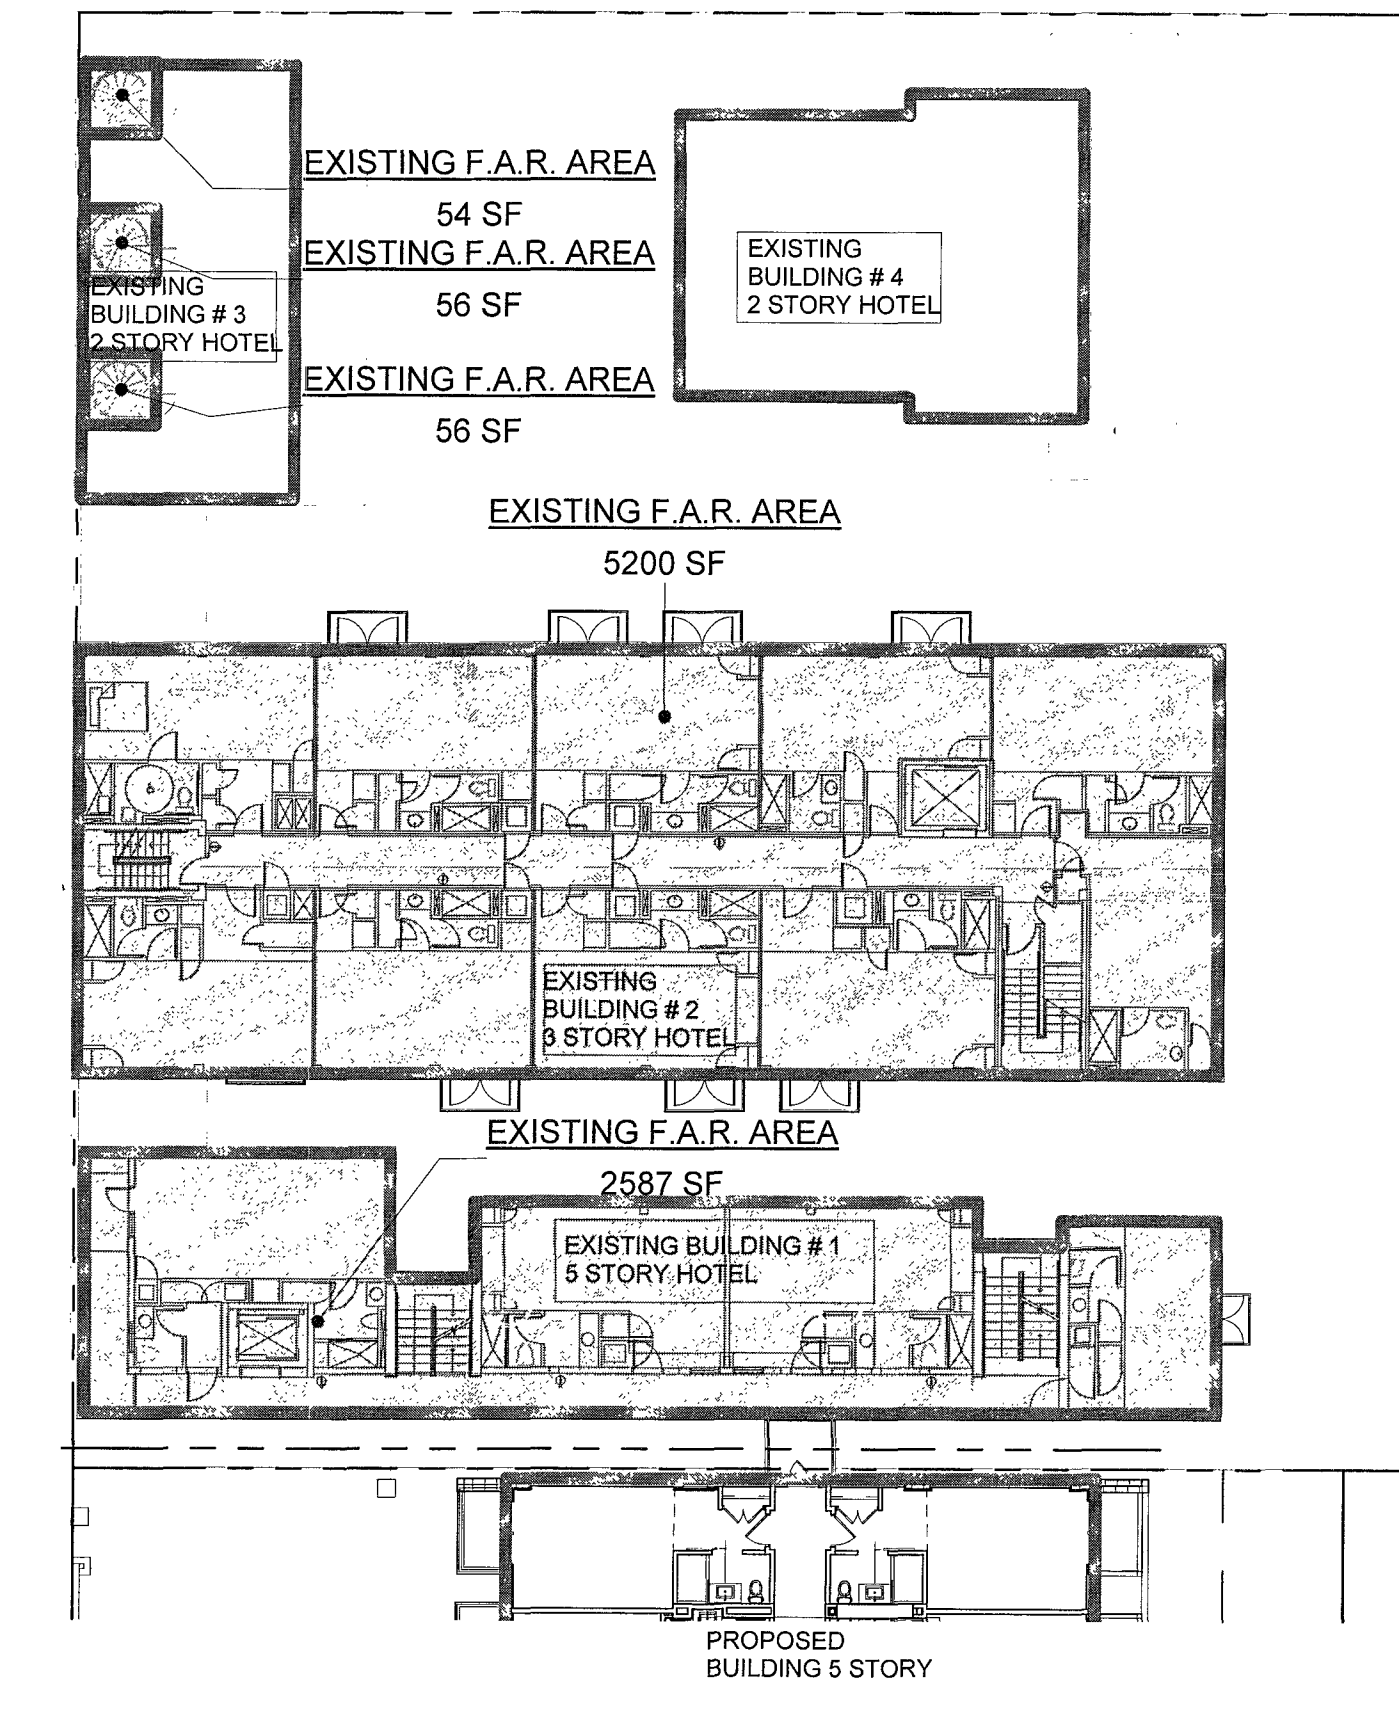


3 F.A.R. LEVEL 300 EXISTING BUILDINGS 1,2,3 AND 4
A0.03.1 1" = 20'-0"

Existing Angler's Hotel F.A.R. Calculation-300 Level Buildings 1,2,3 and 4		
Level	Name	Area
LEVEL 300	EXISTING F.A.R. AREA	7,953 SF

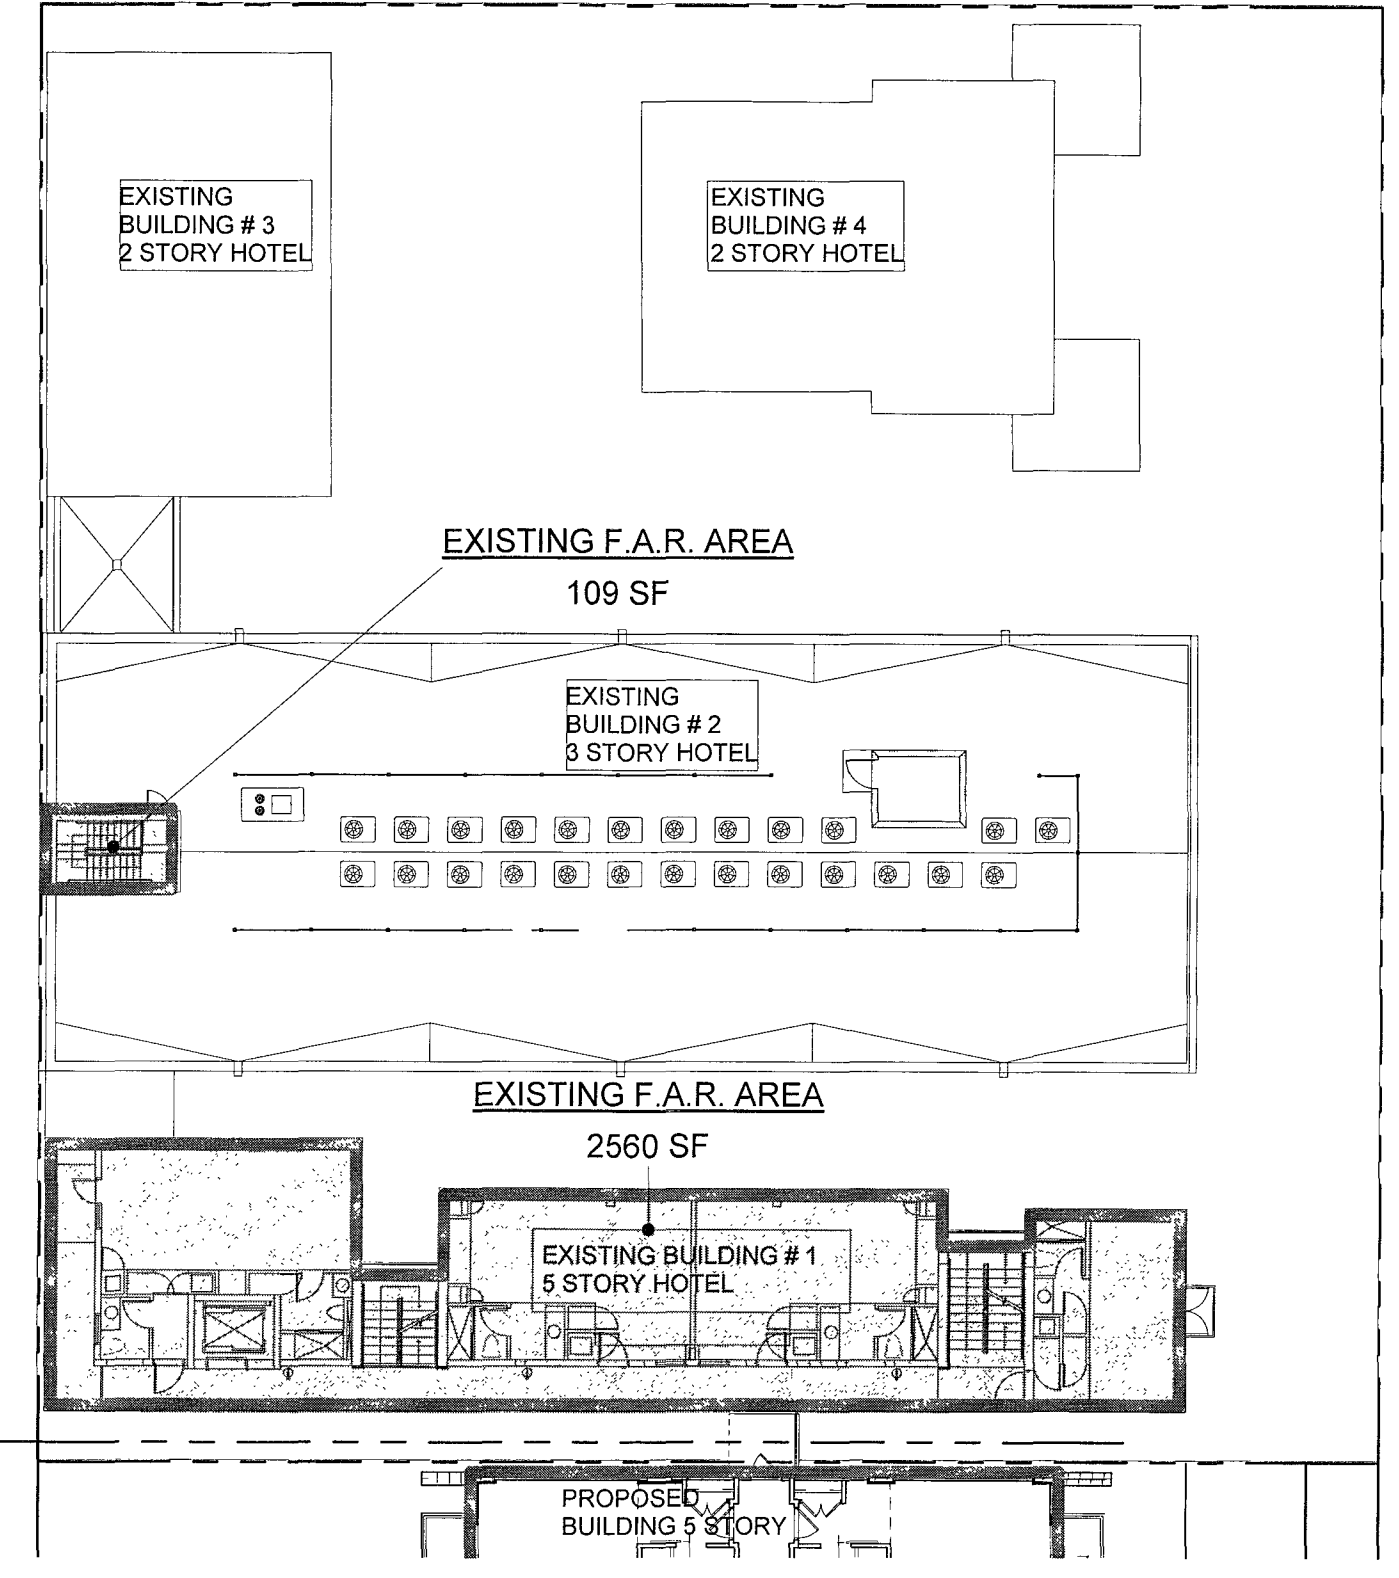


4 F.A.R. LEVEL 400 EXISTING BUILDINGS 1,2,3 AND 4
A0.03.1 1" = 20'-0"

Existing Angler's Hotel F.A.R. Calculation-400 Level Buildings 1,2,3 and 4		
Level	Name	Area
LEVEL 300	EXISTING F.A.R. AREA	7,953 SF

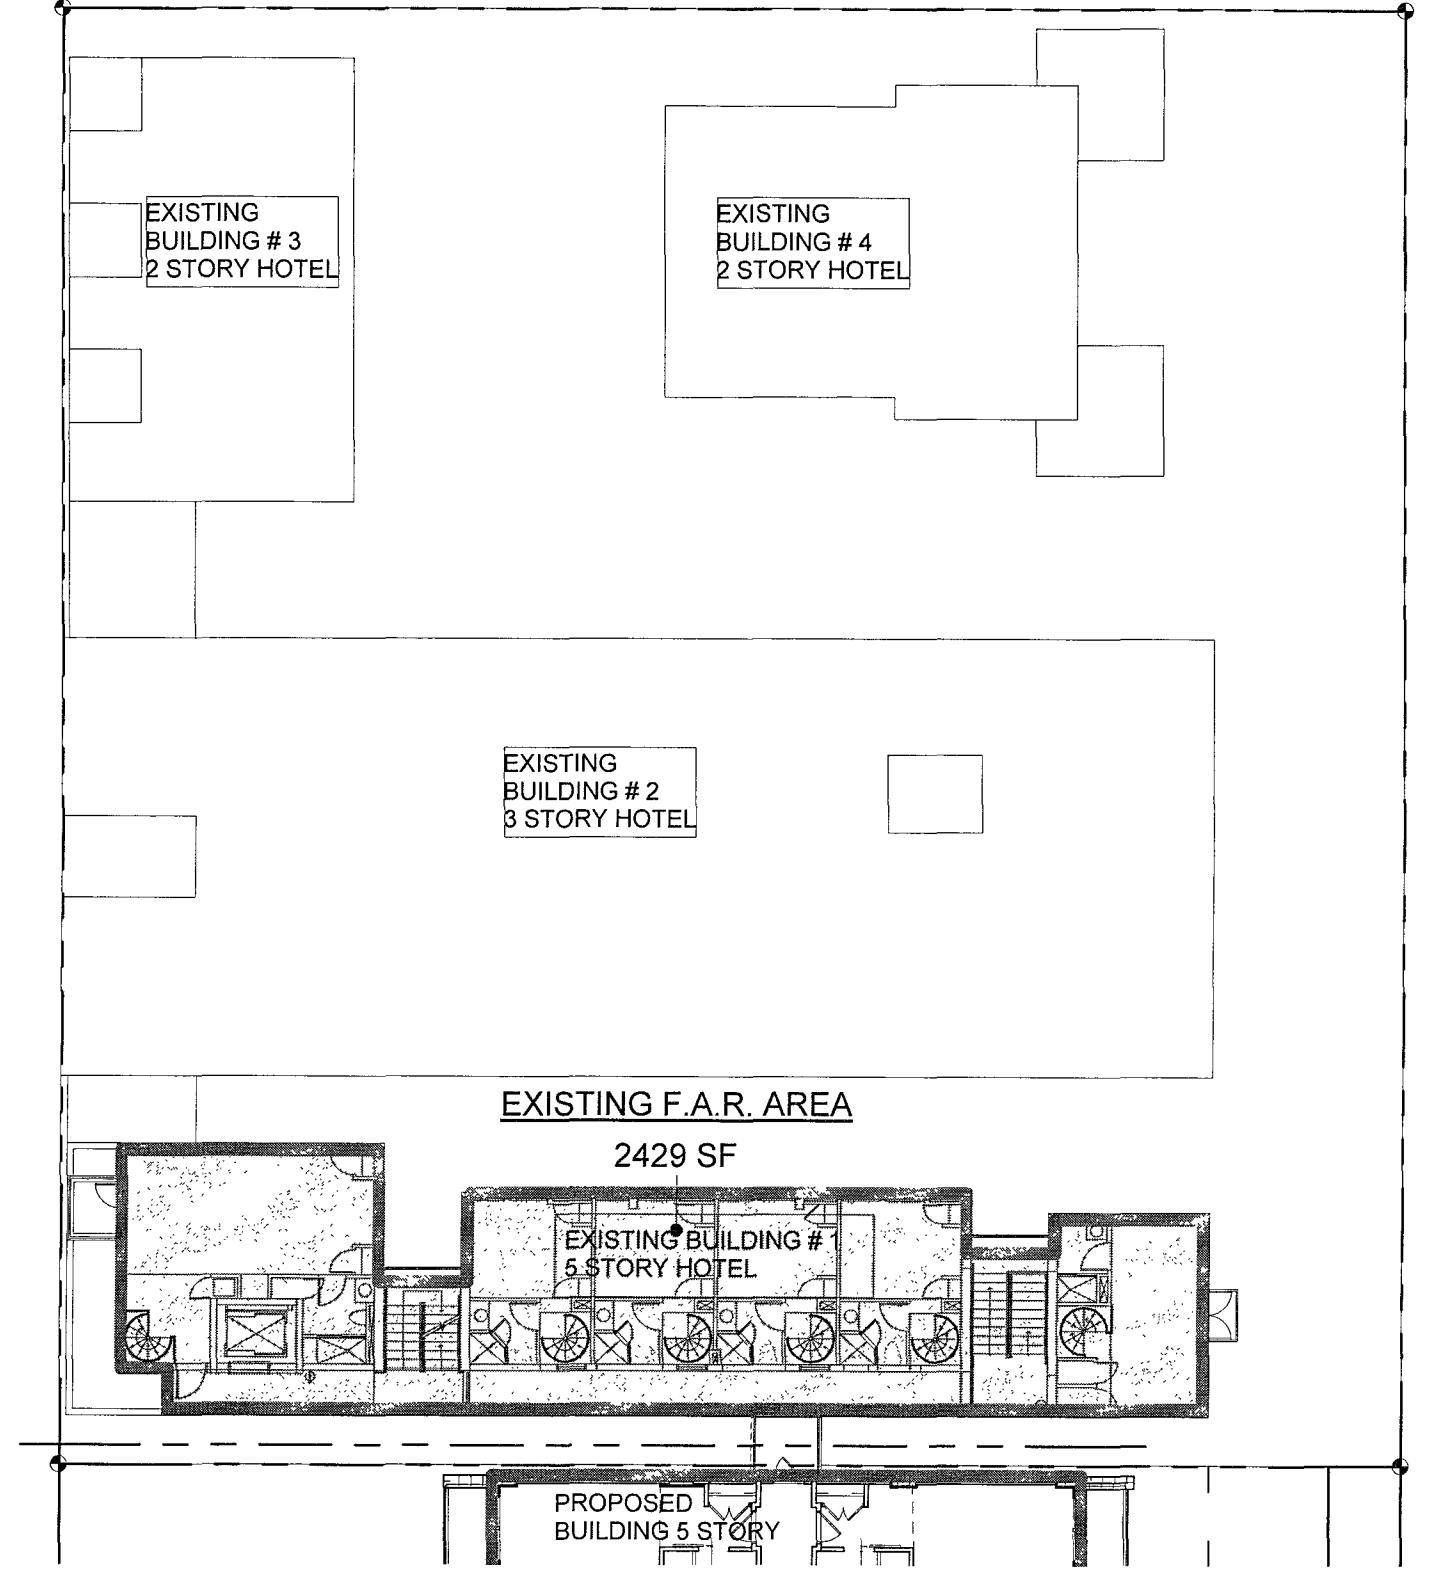

5 F.A.R. LEVEL 500-EXISTING BUILDINGS 1,2,3 AND 4
A0.03.1 1" = 20'-0"

Existing Angler's Hotel F.A.R. Calculation -500 Level Buildings 1,2,3 and 4		
Level	Name	Area
LEVEL 300	EXISTING F.A.R. AREA	7,953 SF

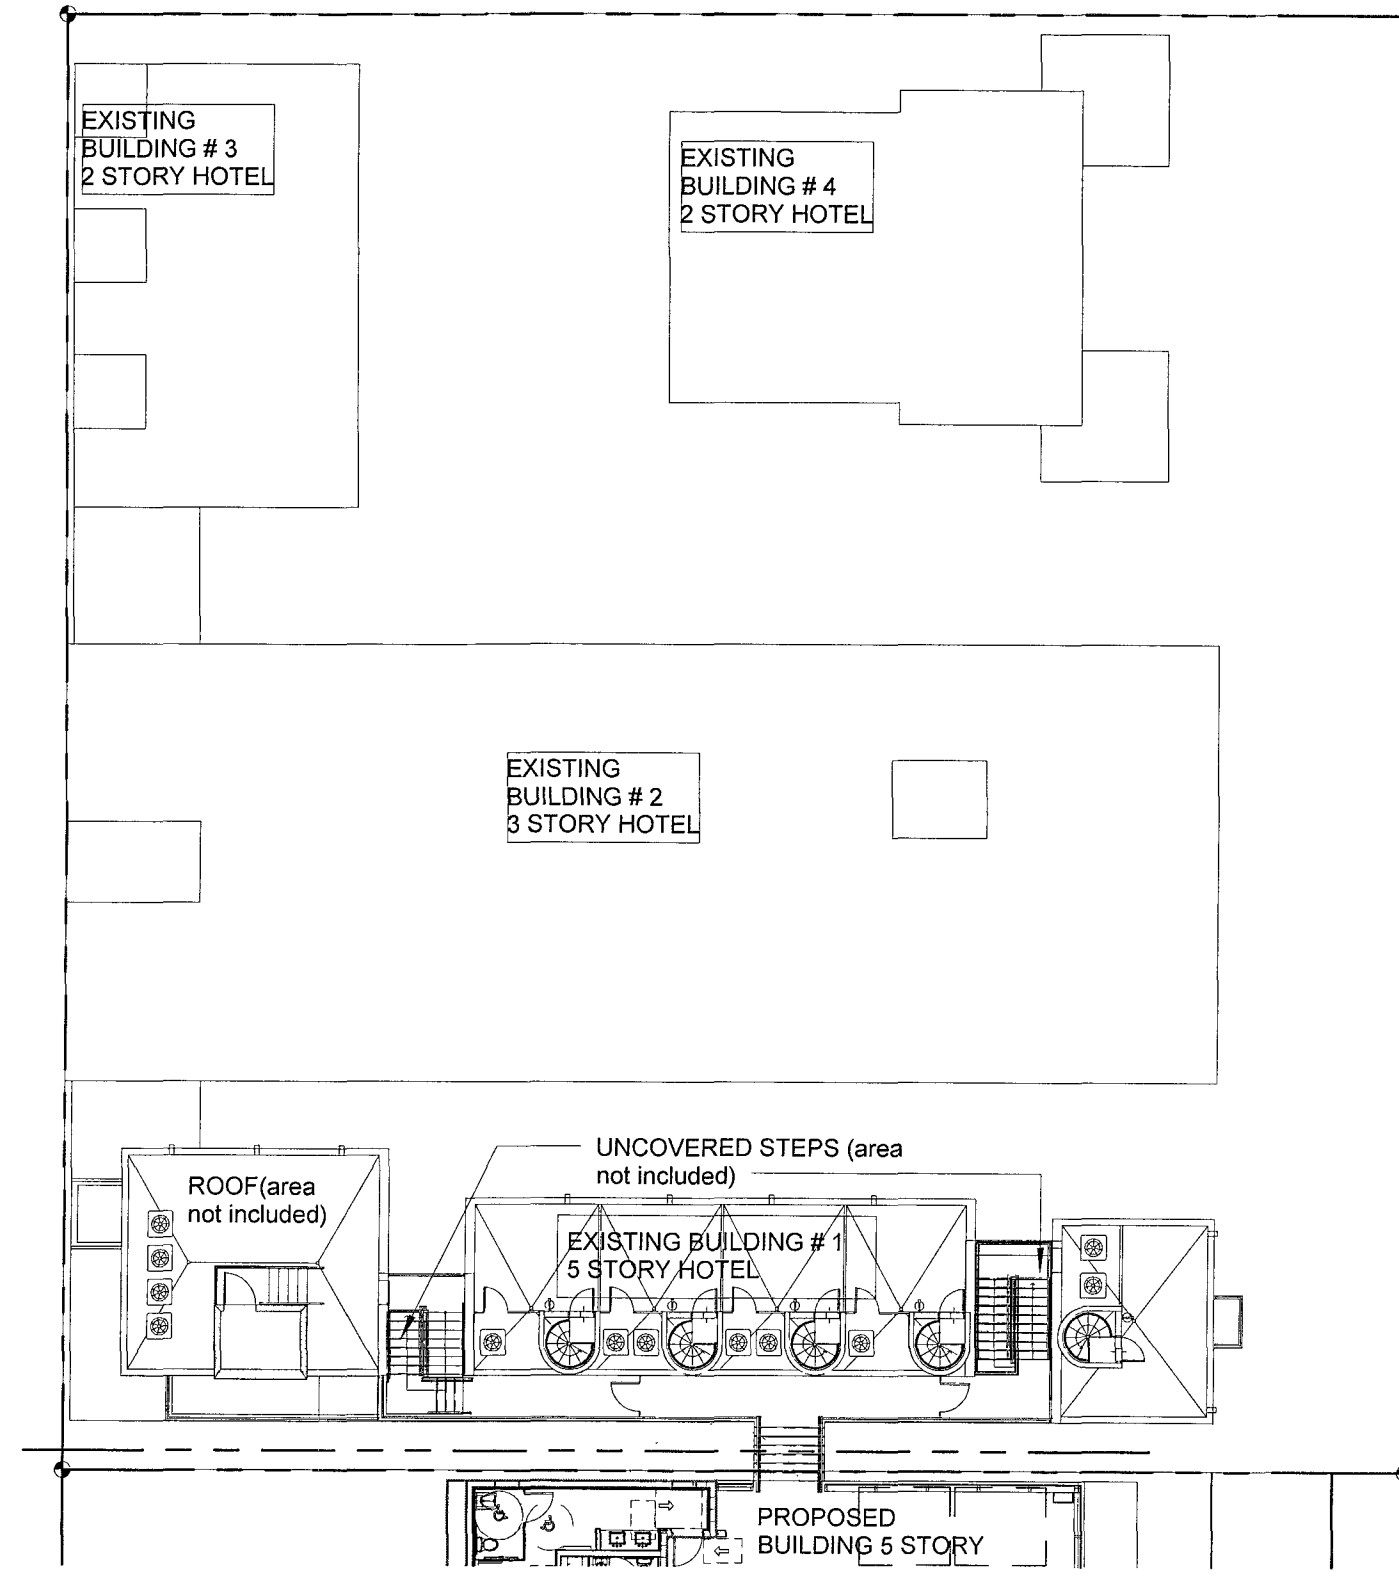


6 F.A.R. LEVEL 600 EXISTING BUILDINGS 1,2,3 AND 4
A0.03.1 1" = 20'-0"


Existing Angler's Hotel F.A.R. Calculation -600 Level Buildings 1,2,3 and 4		
Level	Name	Area
UPPER POOL DECK	EXISTING F.A.R. AREA	0 SF

Grand Total Existing Angler's Hotel F.A.R. CALCULATION-LEVEL...		
Level	Name	Area
Not Placed	EXISTING F.A.R. AREA	0 SF
LEVEL 100	EXISTING F.A.R. AREA	9,674 SF
LEVEL 200	EXISTING F.A.R. AREA	9,588 SF
LEVEL 300	EXISTING F.A.R. AREA	7,953 SF
LEVEL 400	EXISTING F.A.R. AREA	2,669 SF
LEVEL 500	EXISTING F.A.R. AREA	2,429 SF
UPPER POOL DECK	EXISTING F.A.R. AREA	0 SF
		32,312 SF


NOTE:
THE ASBUILT AREAS ARE BASED UPON TRIANGLE SURVEYING DRAWINGS
AND AREA SURVEYING DOCUMENTS PROVIDED 4/2/15 AND 4/3/15 OF THE
EXISTING BUILDING.

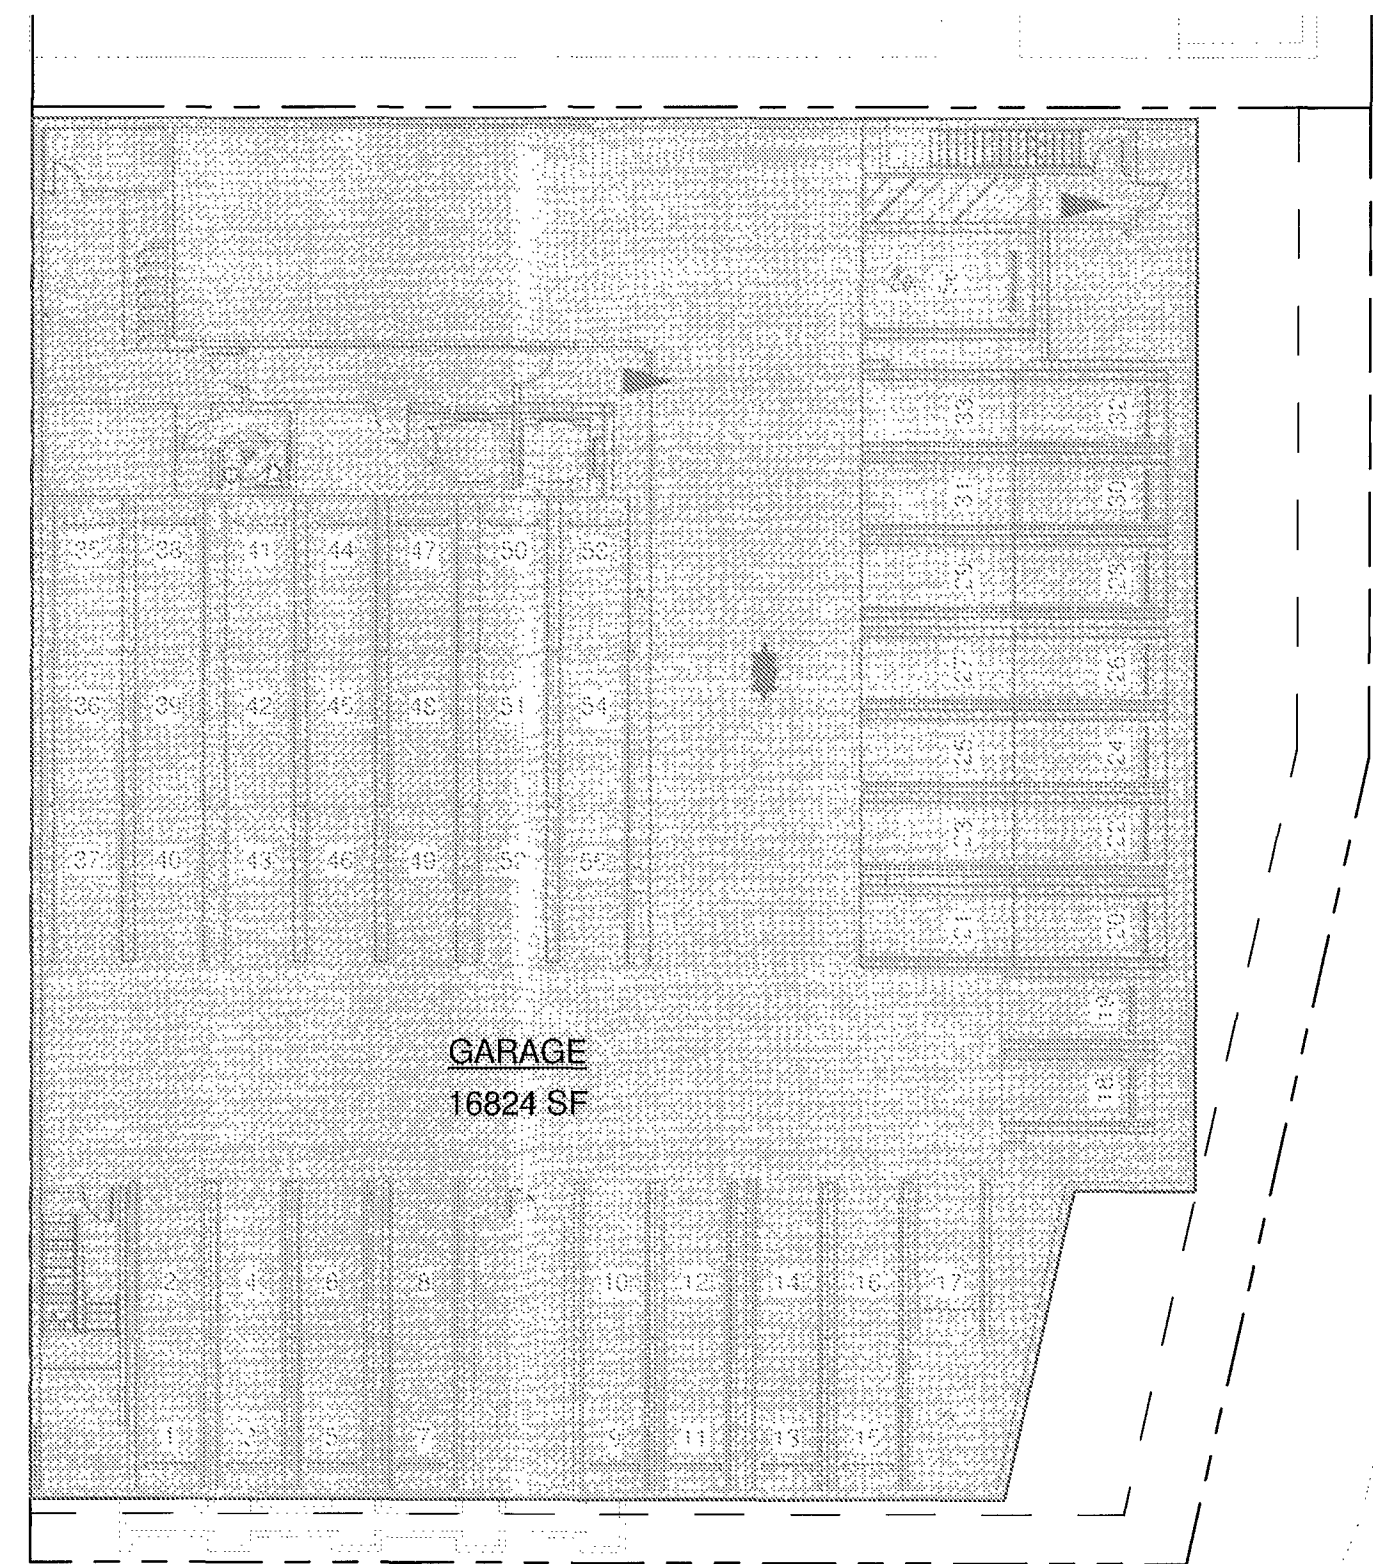


1
A0.04
BASEMENT
1" = 20'-0"

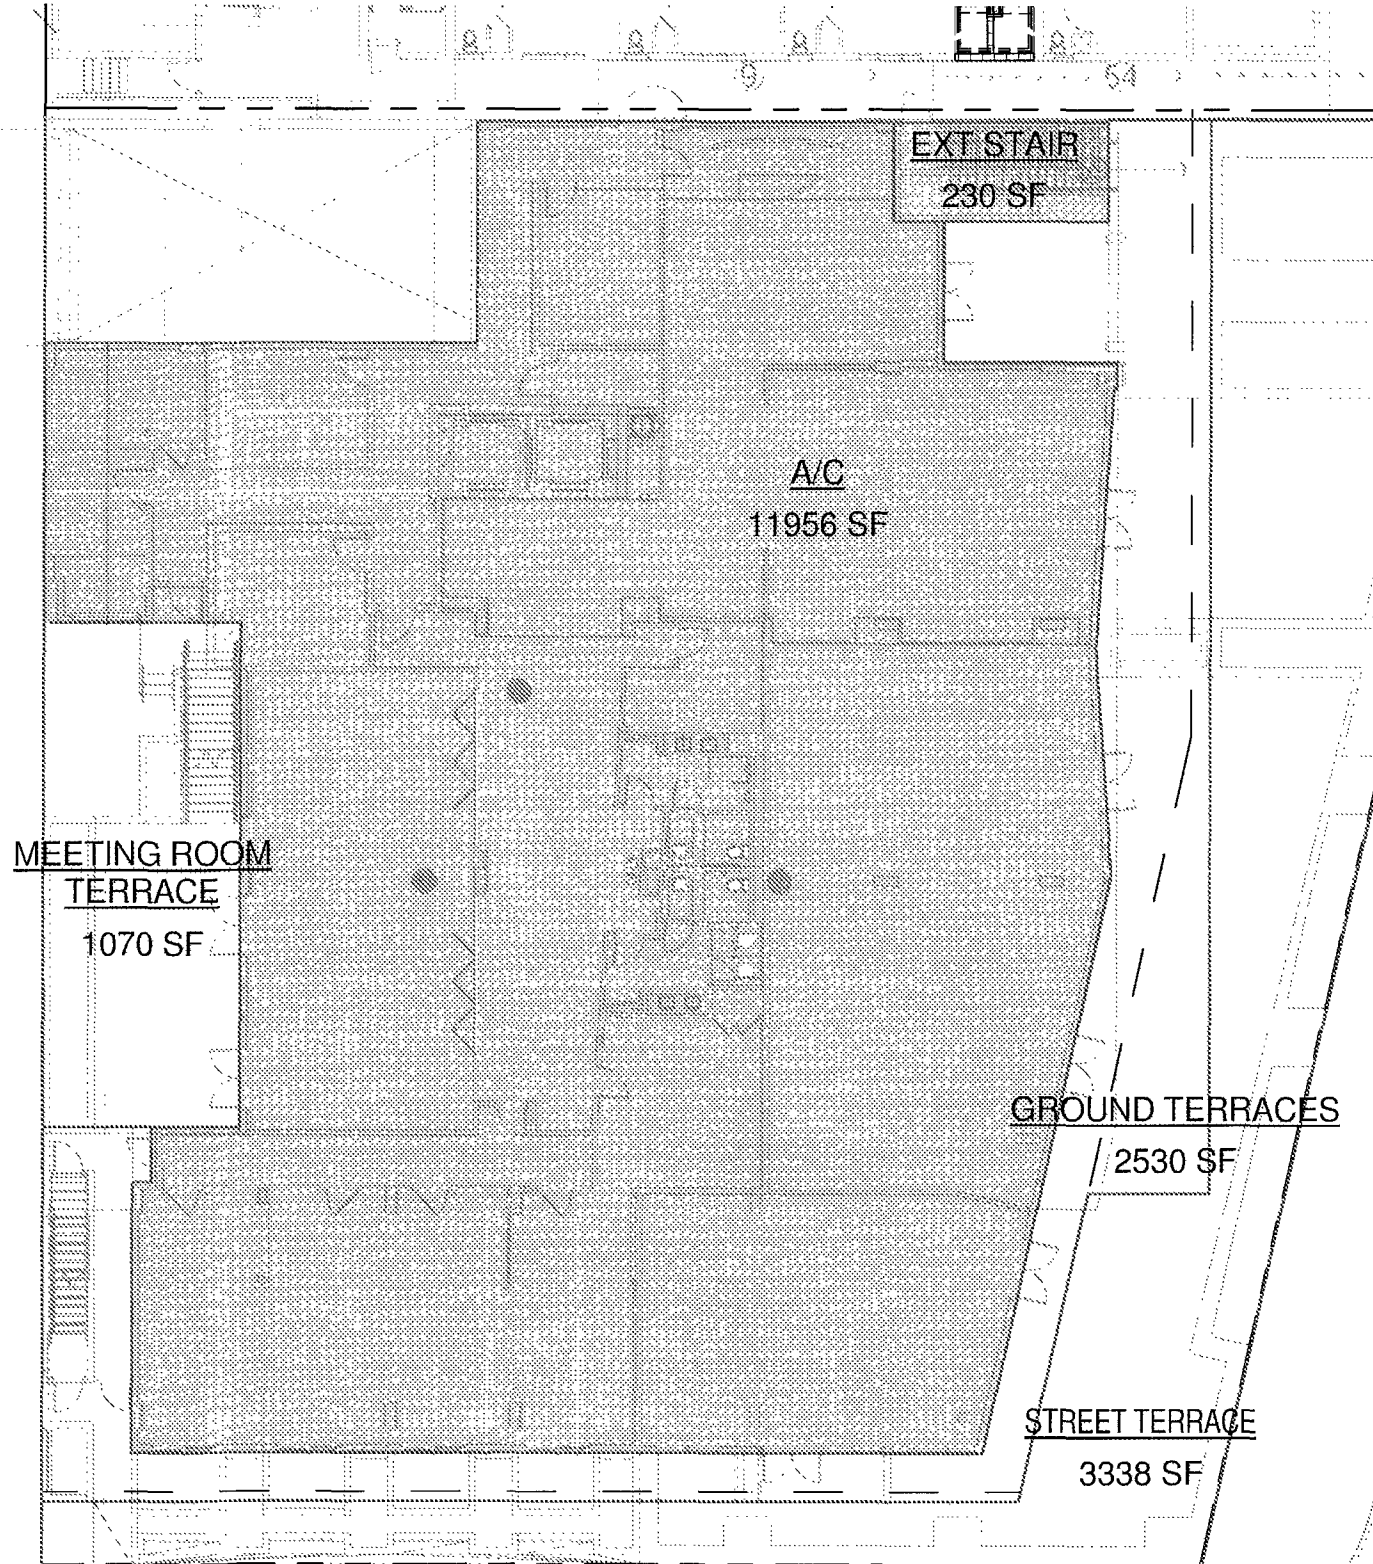


2
A0.04
LEVEL 100
1" = 20'-0"

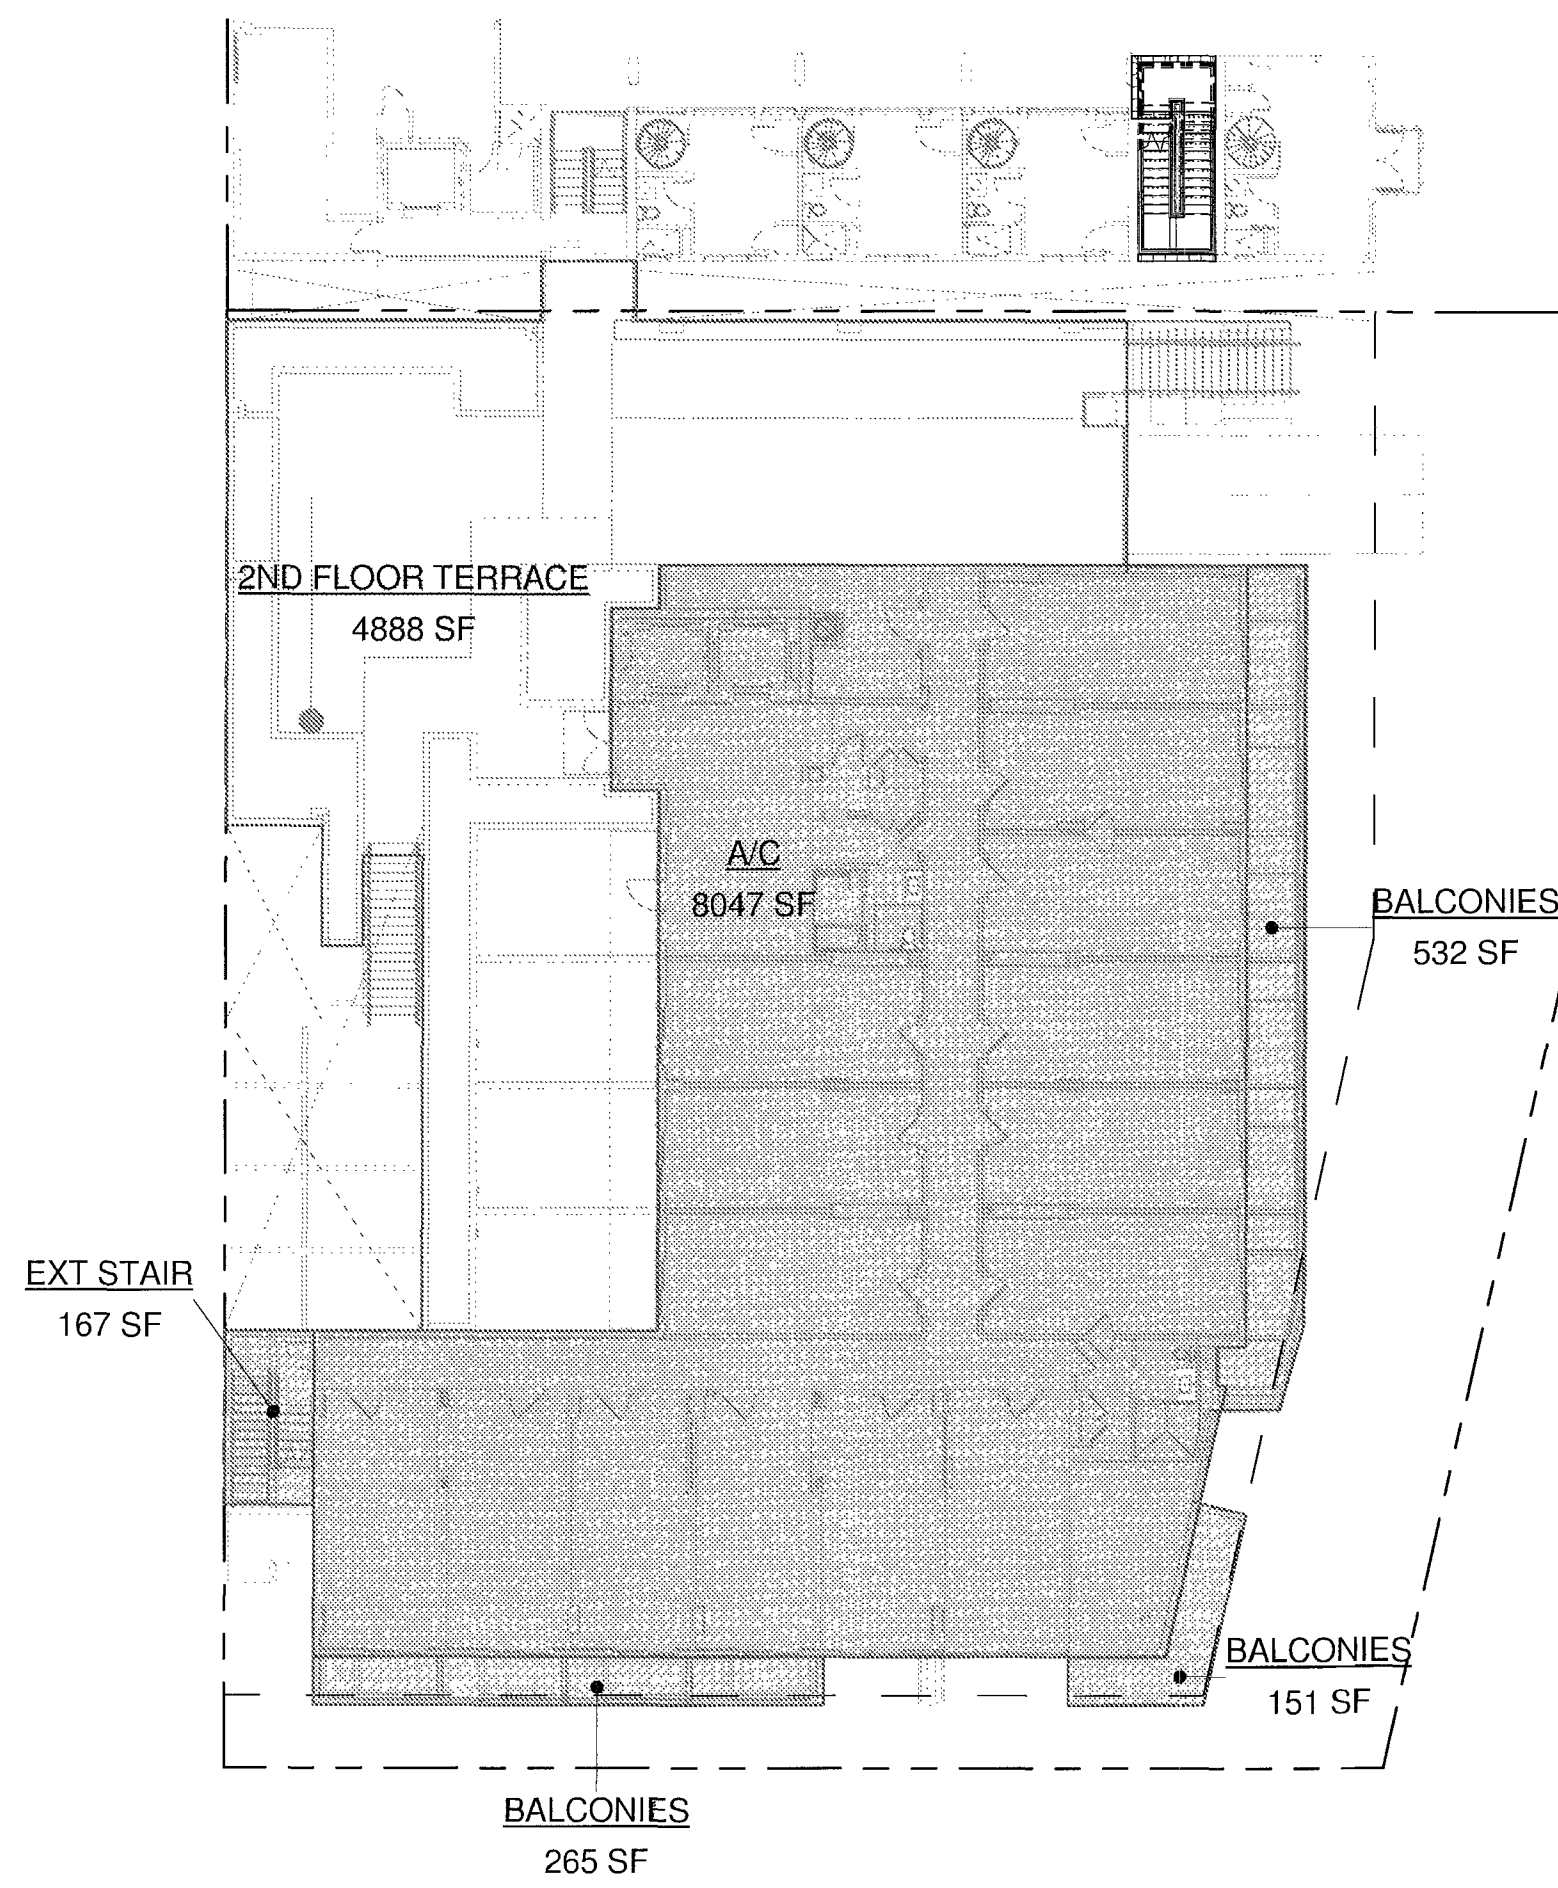


3
A0.04
LEVEL 200
1" = 20'-0"

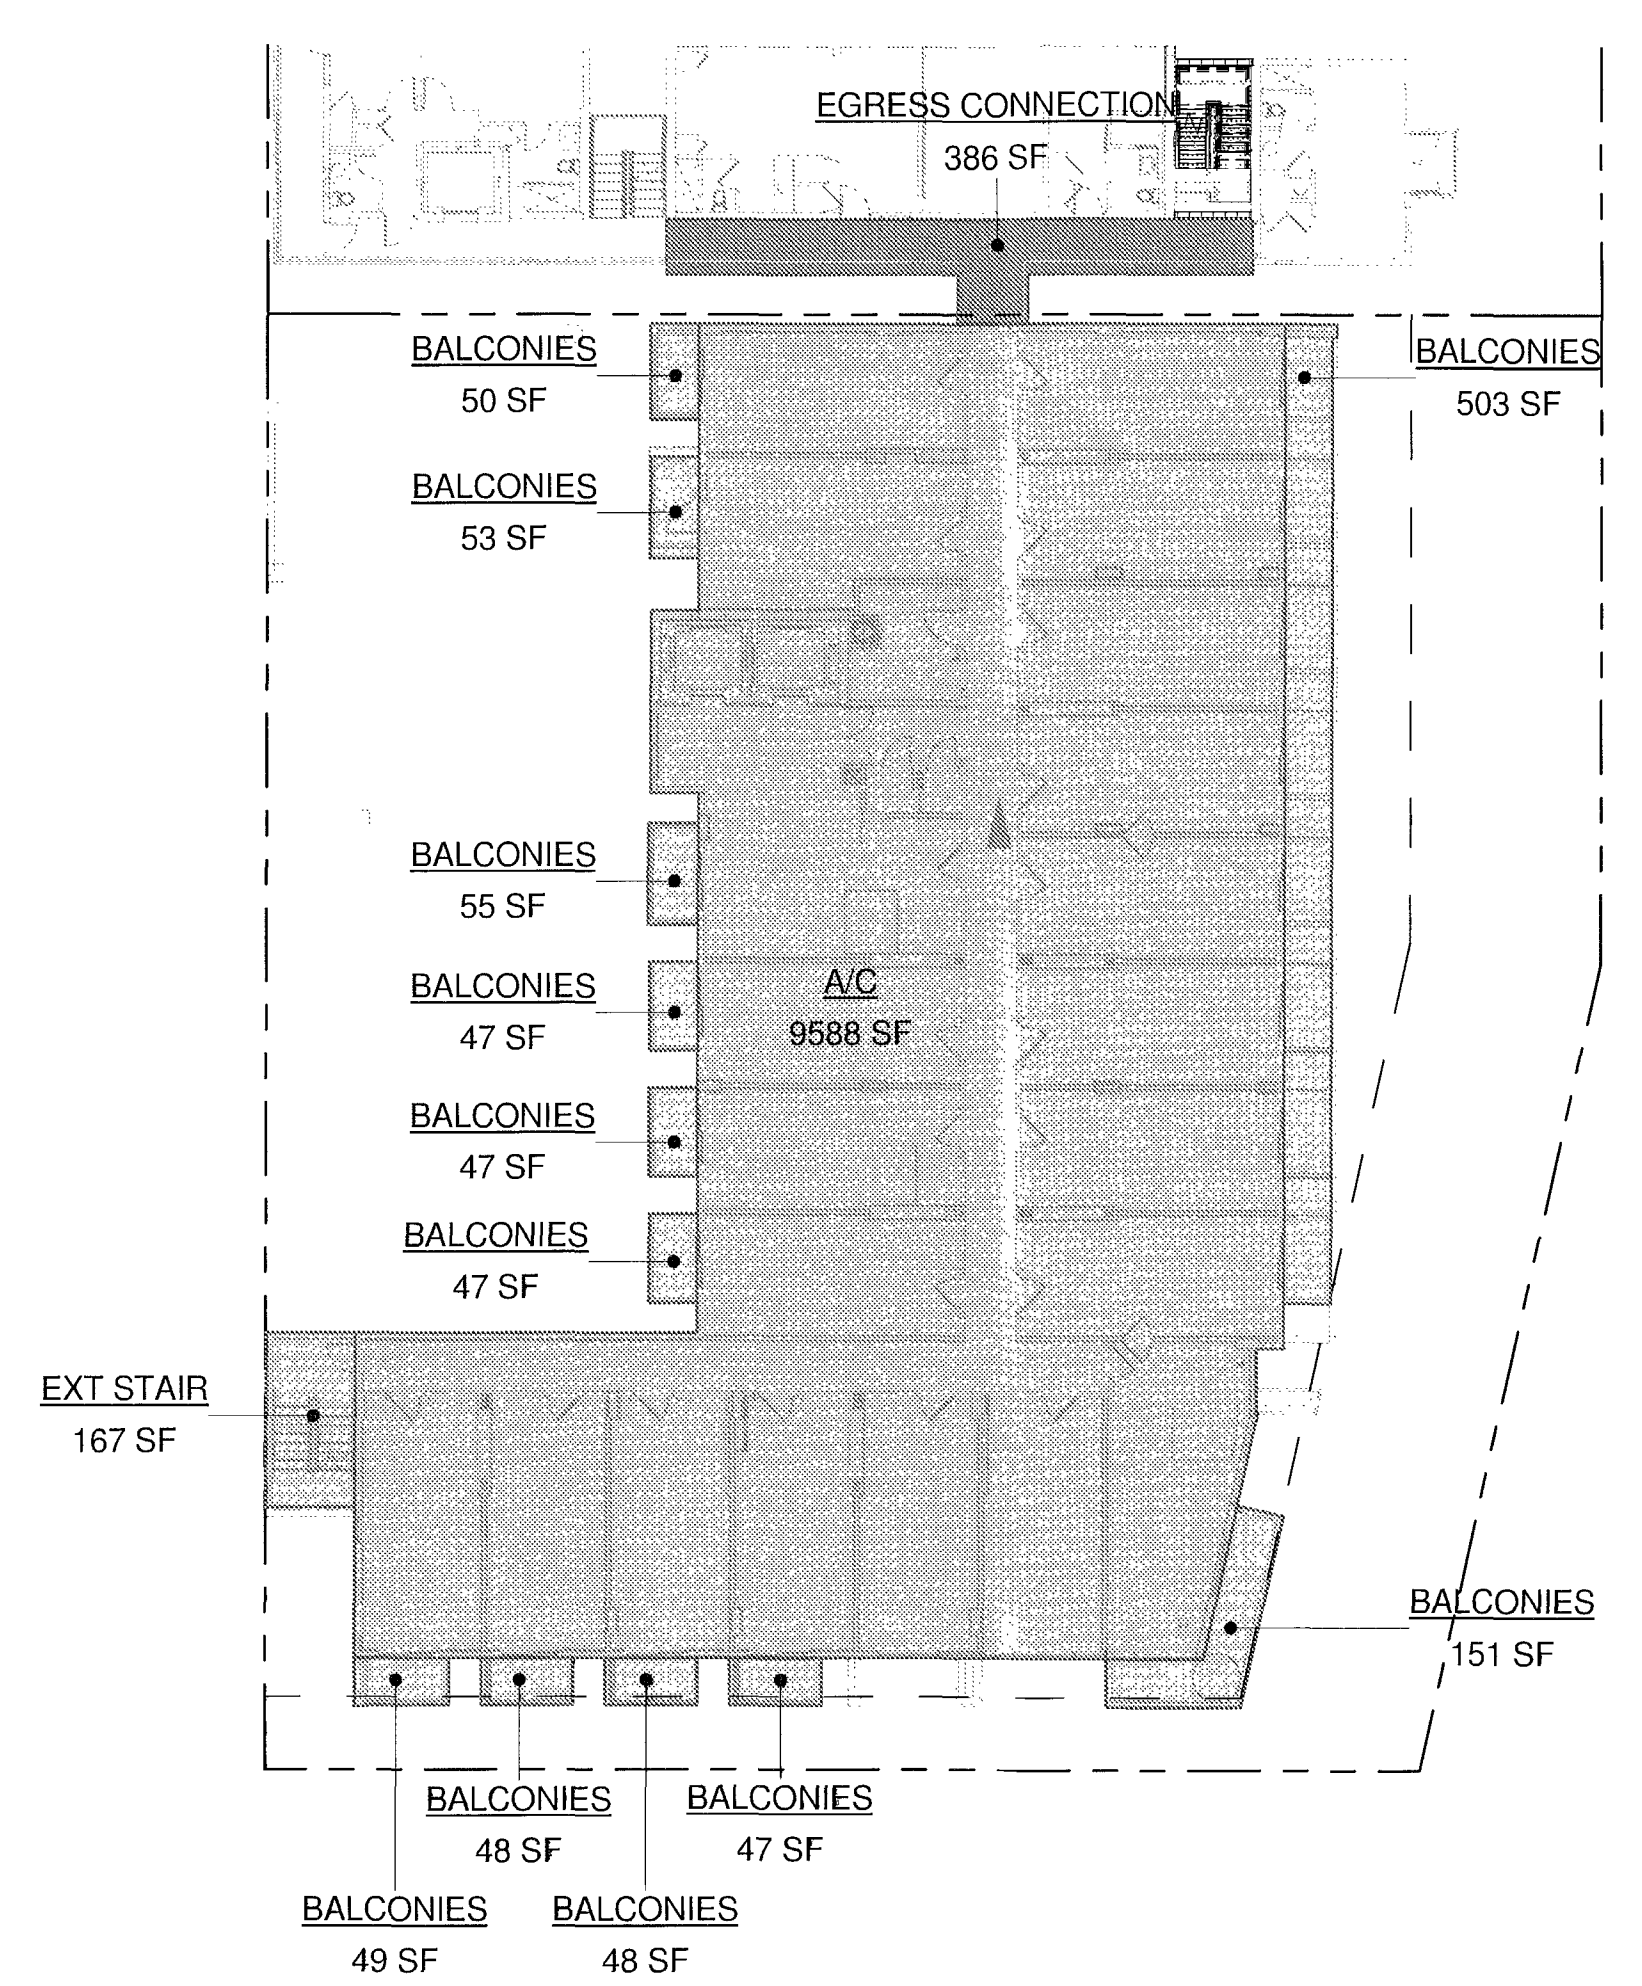


4
A0.04
LEVEL 300
1" = 20'-0"

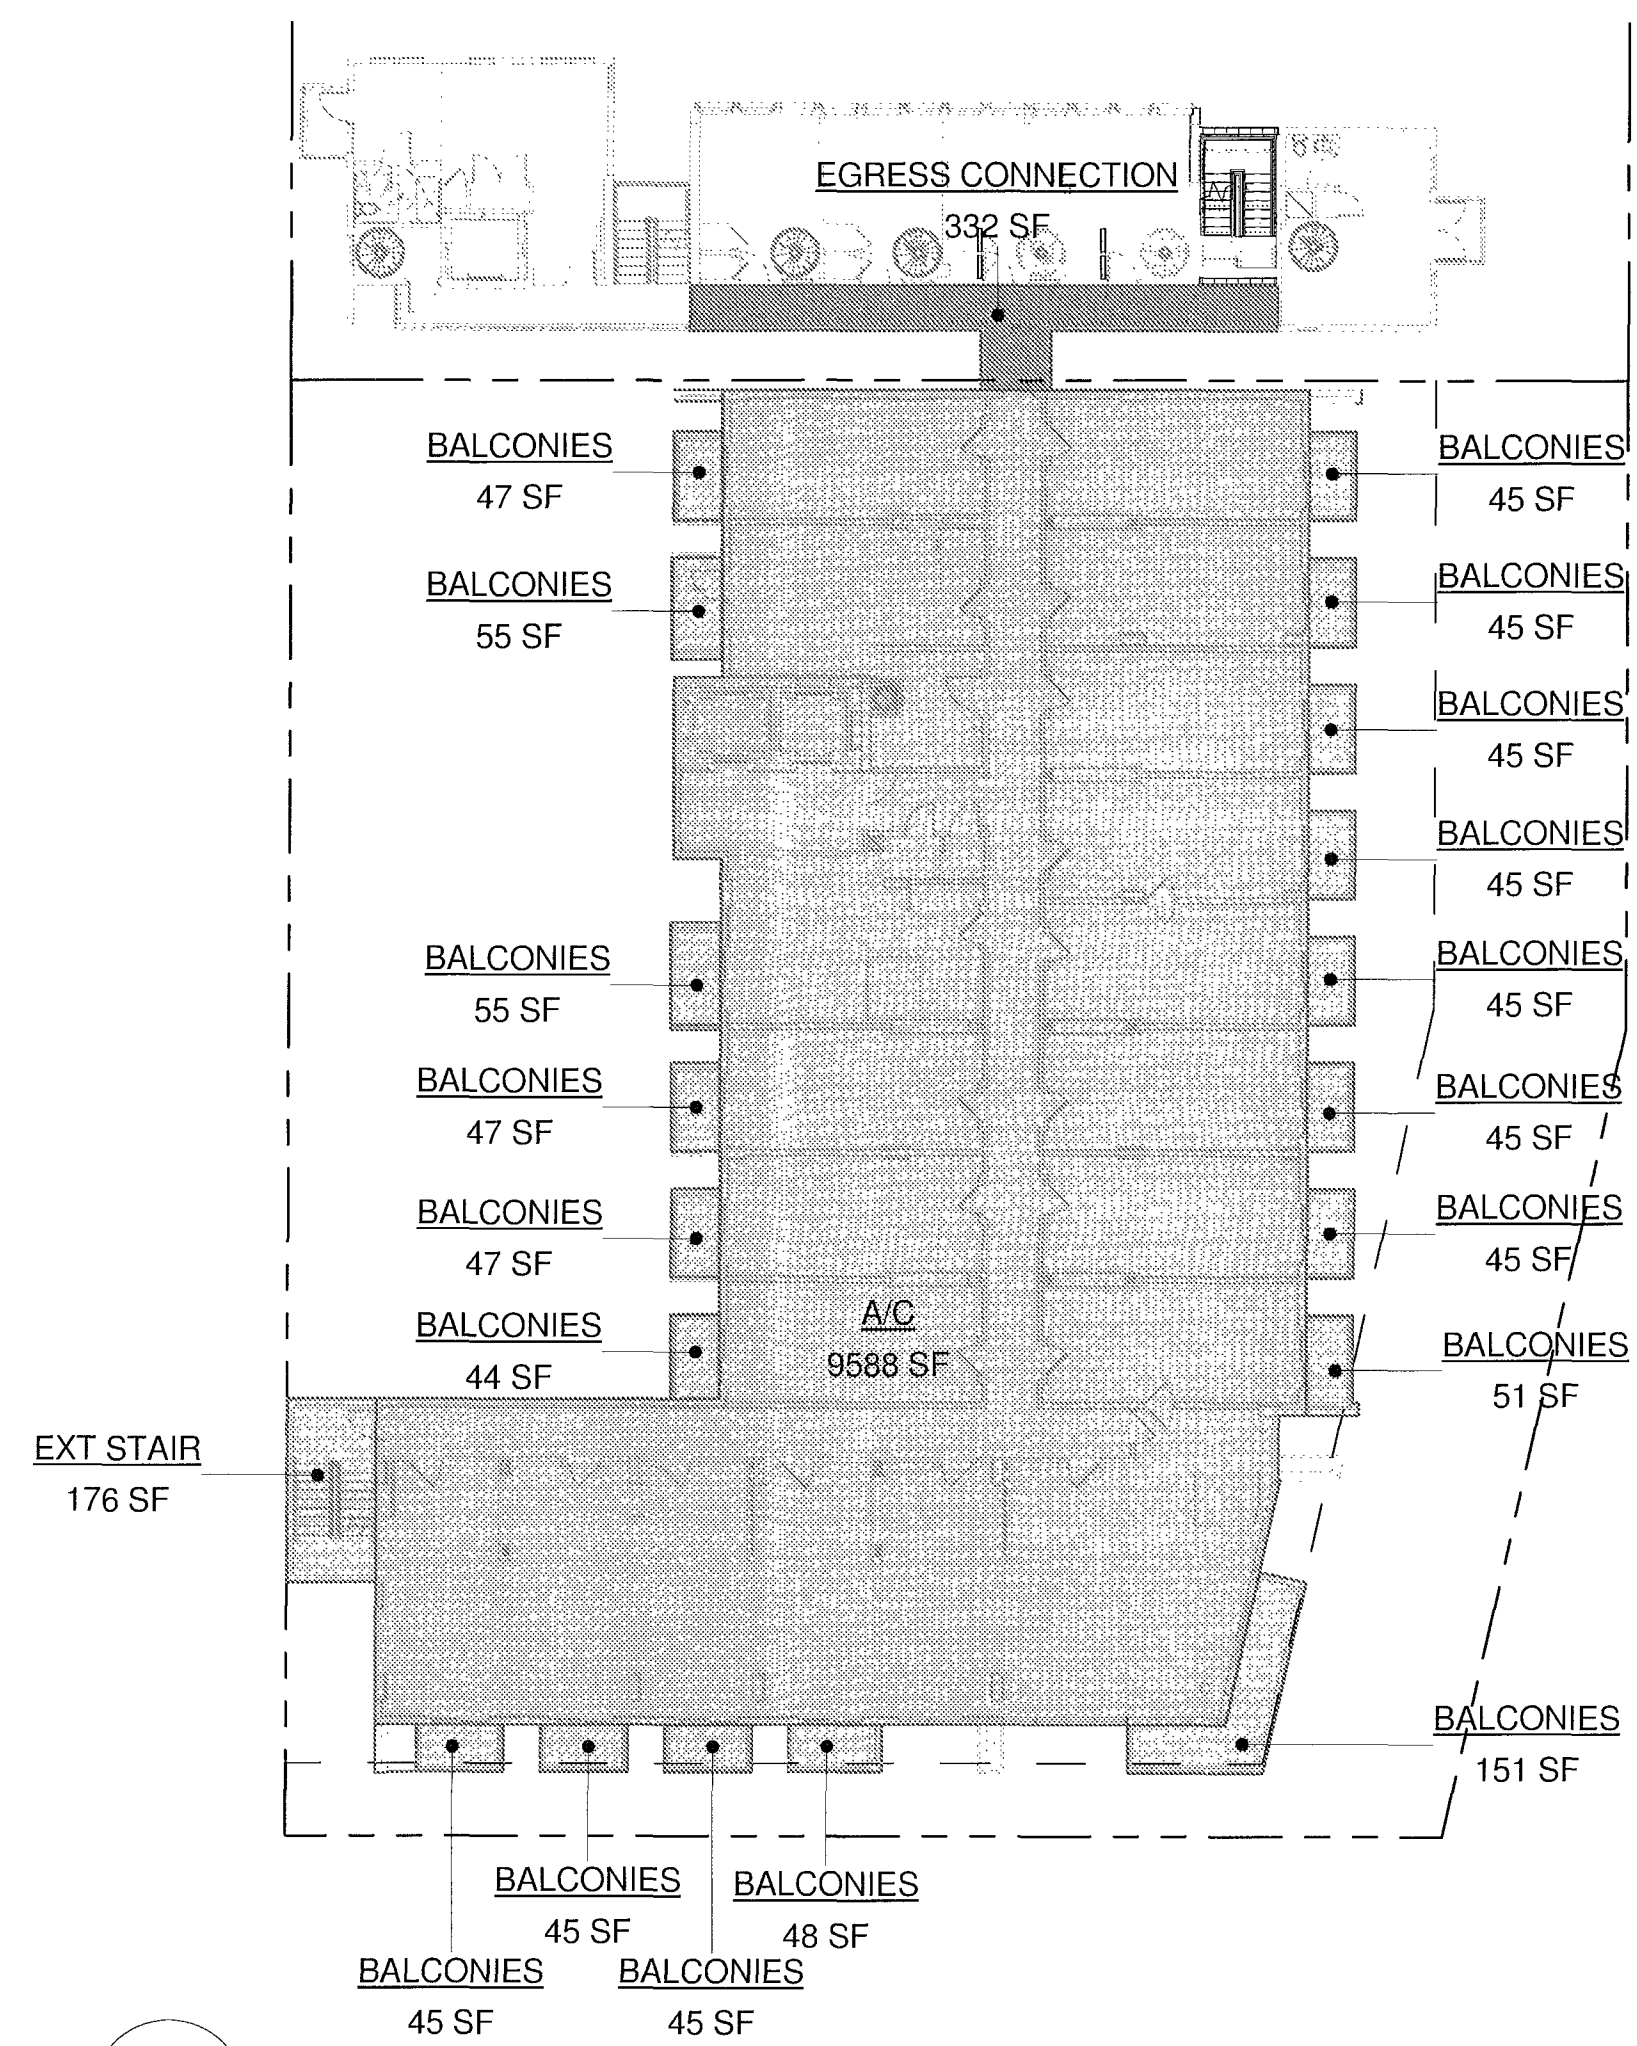


5
A0.04
LEVEL 400
1" = 20'-0"

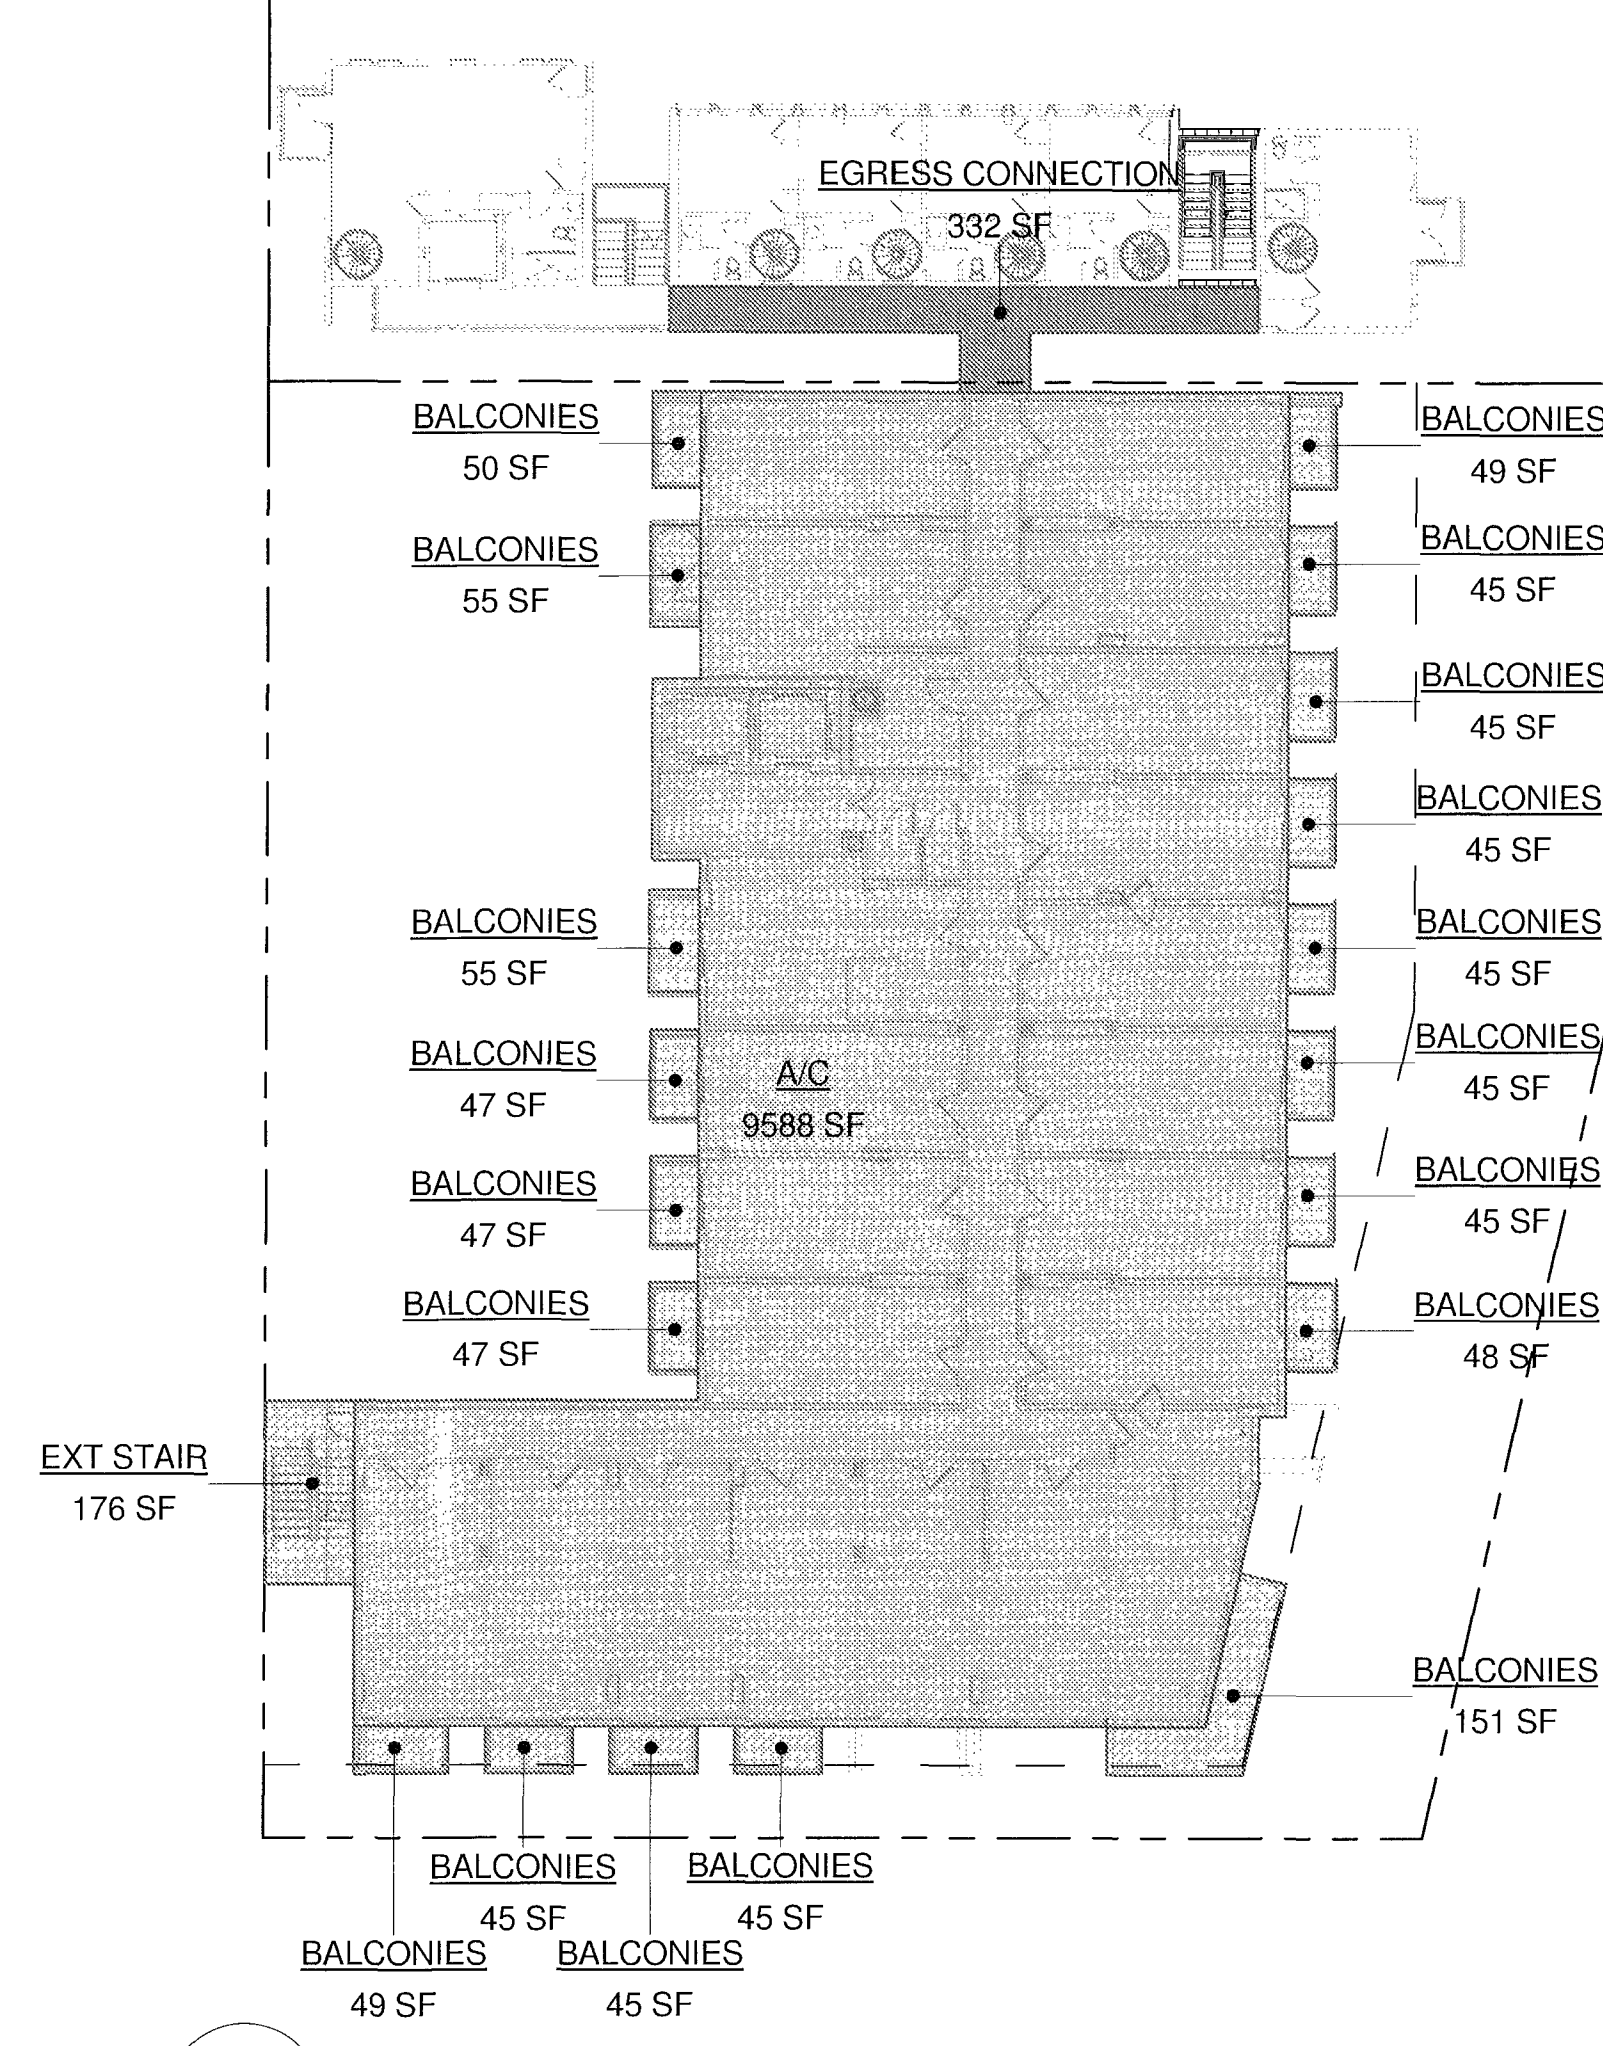


6
A0.04
LEVEL 500
1" = 20'-0"

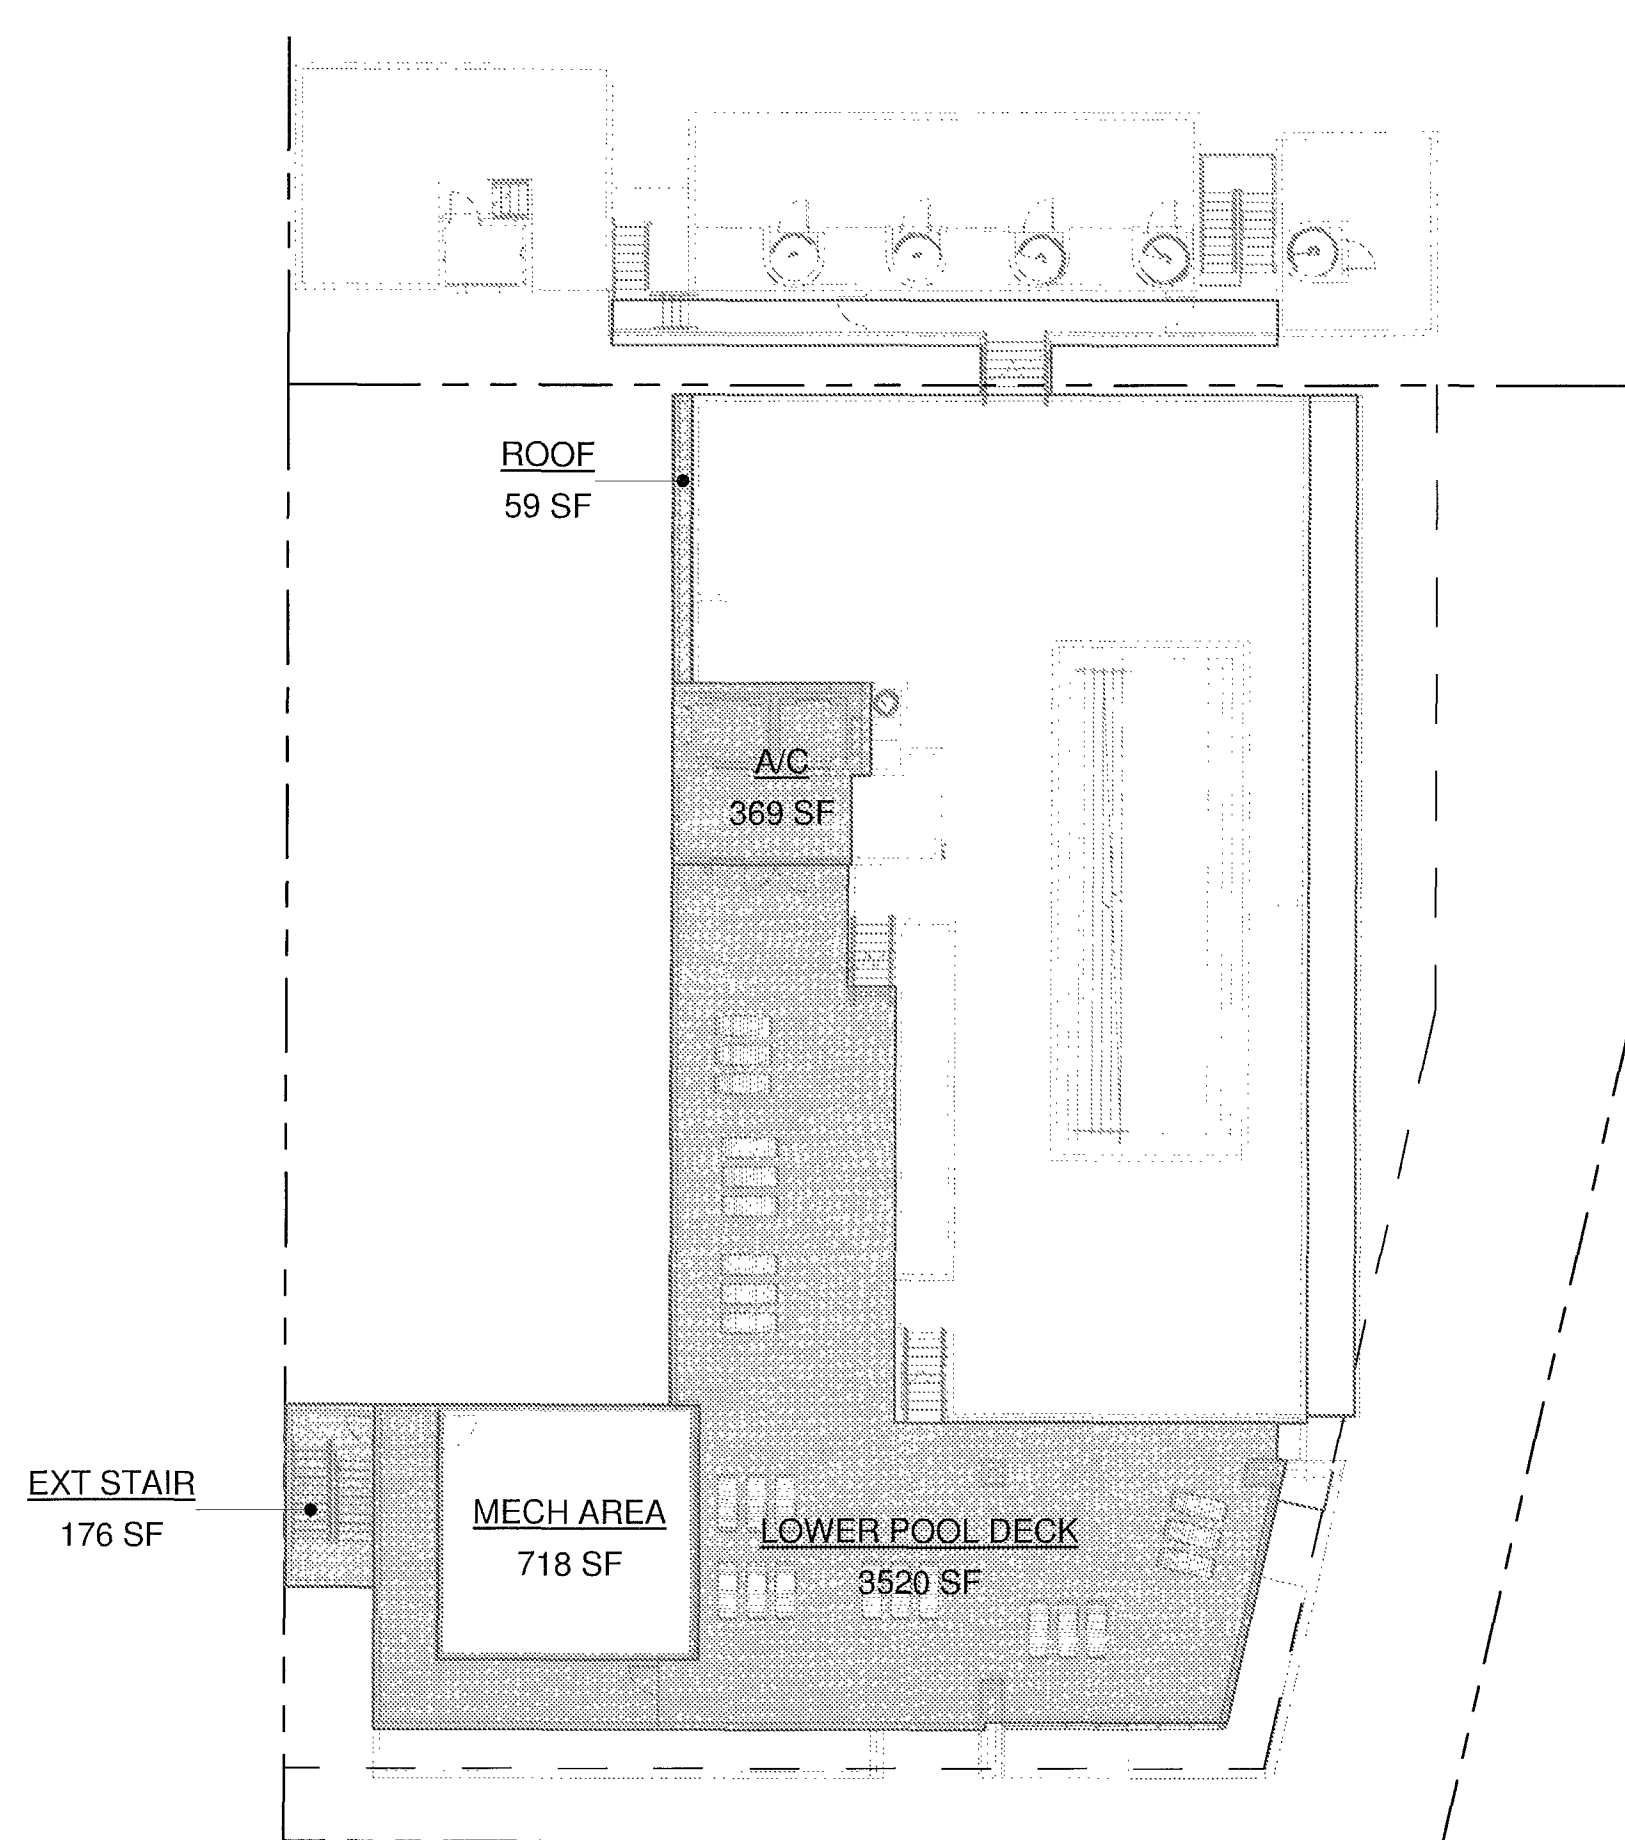

7
A0.04
LOWER POOL DECK
1" = 20'-0"

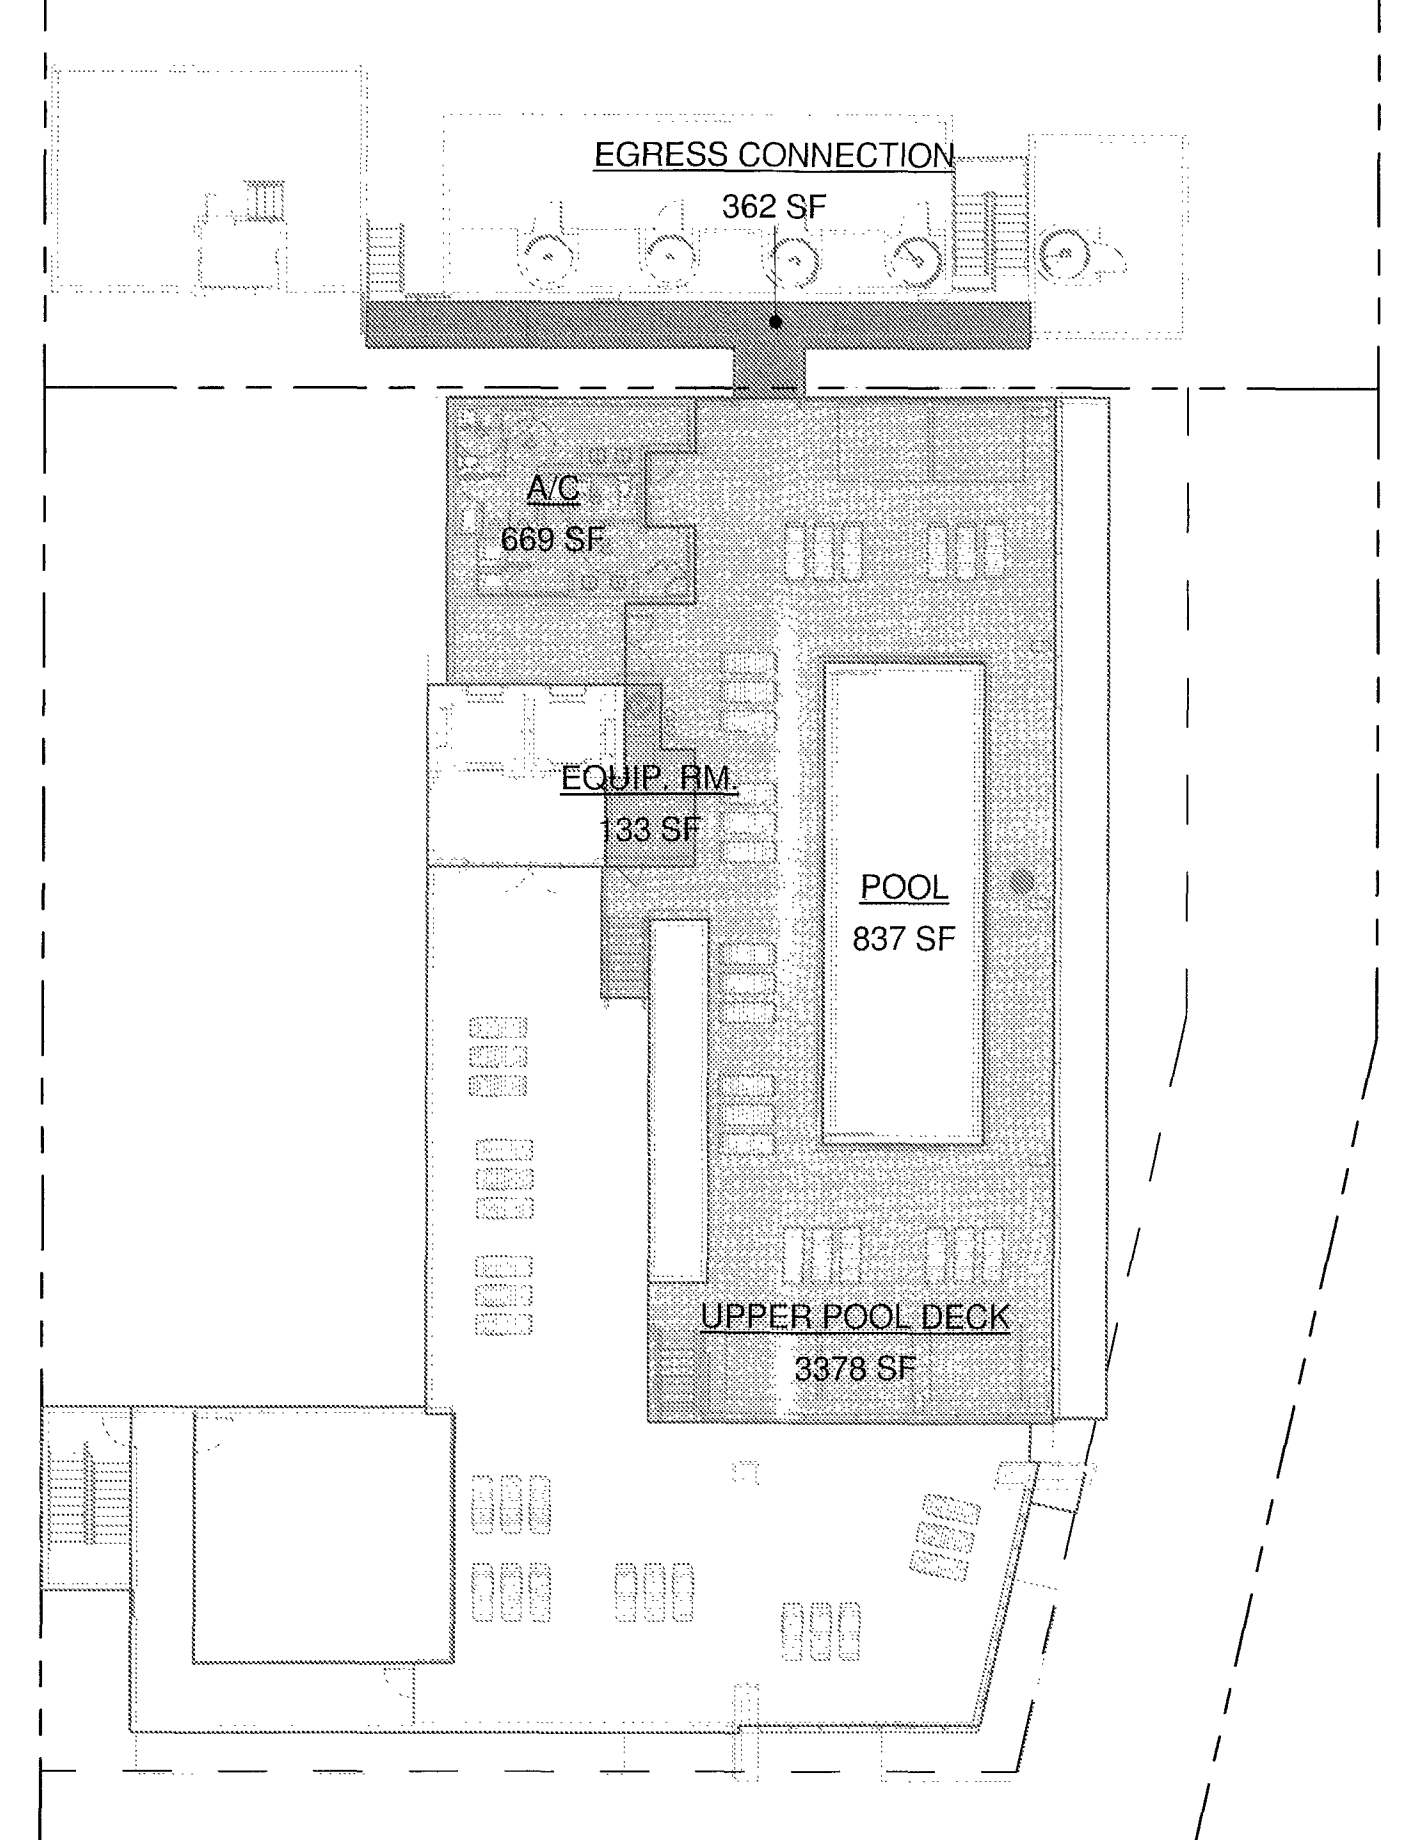


8
A0.04
UPPER POOL DECK
1" = 20'-0"

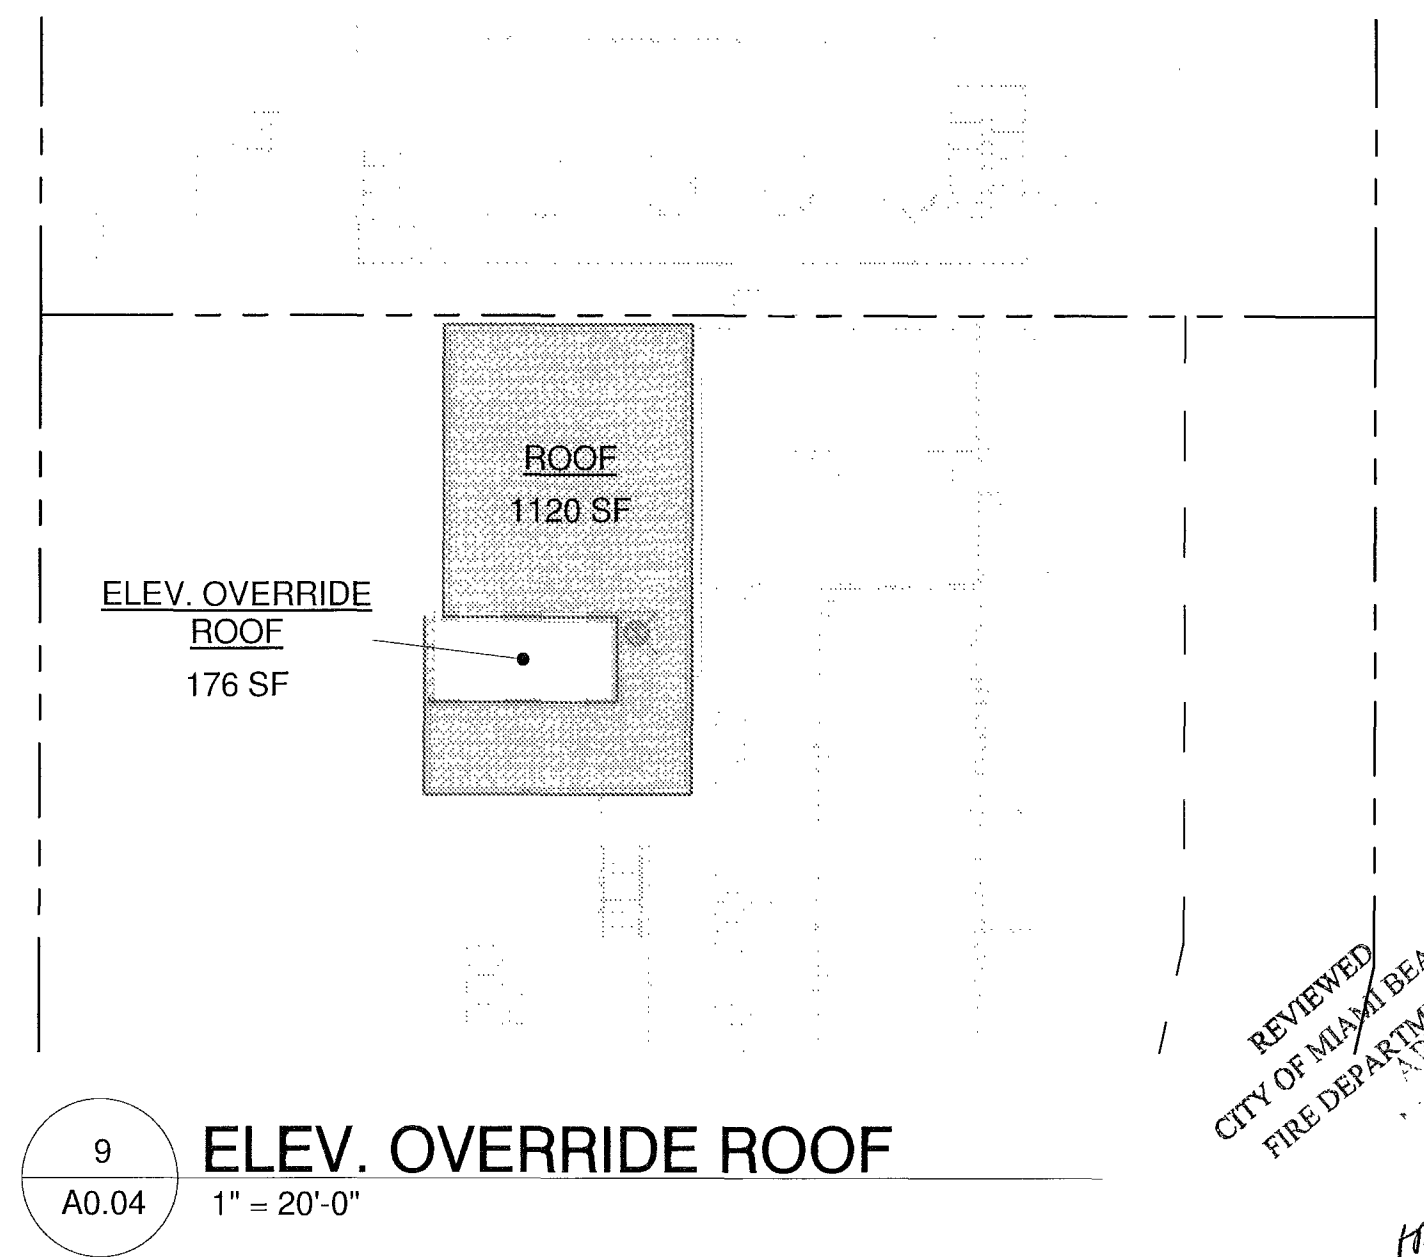

9
A0.04
ELEV. OVERRIDE ROOF
1" = 20'-0"

GROSS AREA CALCULATION	
AREA CATEGORY	AREA
BALCONY	4,090.67 SF
CONNECTION	1,410.61 SF
GARAGE	16,824.12 SF
INTERIOR	49,804.07 SF
MECHANICAL ROOF	850.55 SF
POOL	836.76 SF

GROSS AREA CALCULATION	
AREA CATEGORY	AREA
ROOF	1,355.95 SF
STAIR	1,092.27 SF
STREET TERRACE	3,338.03 SF
TERRACE	15,386.31 SF
Grand total	94,989.34 SF

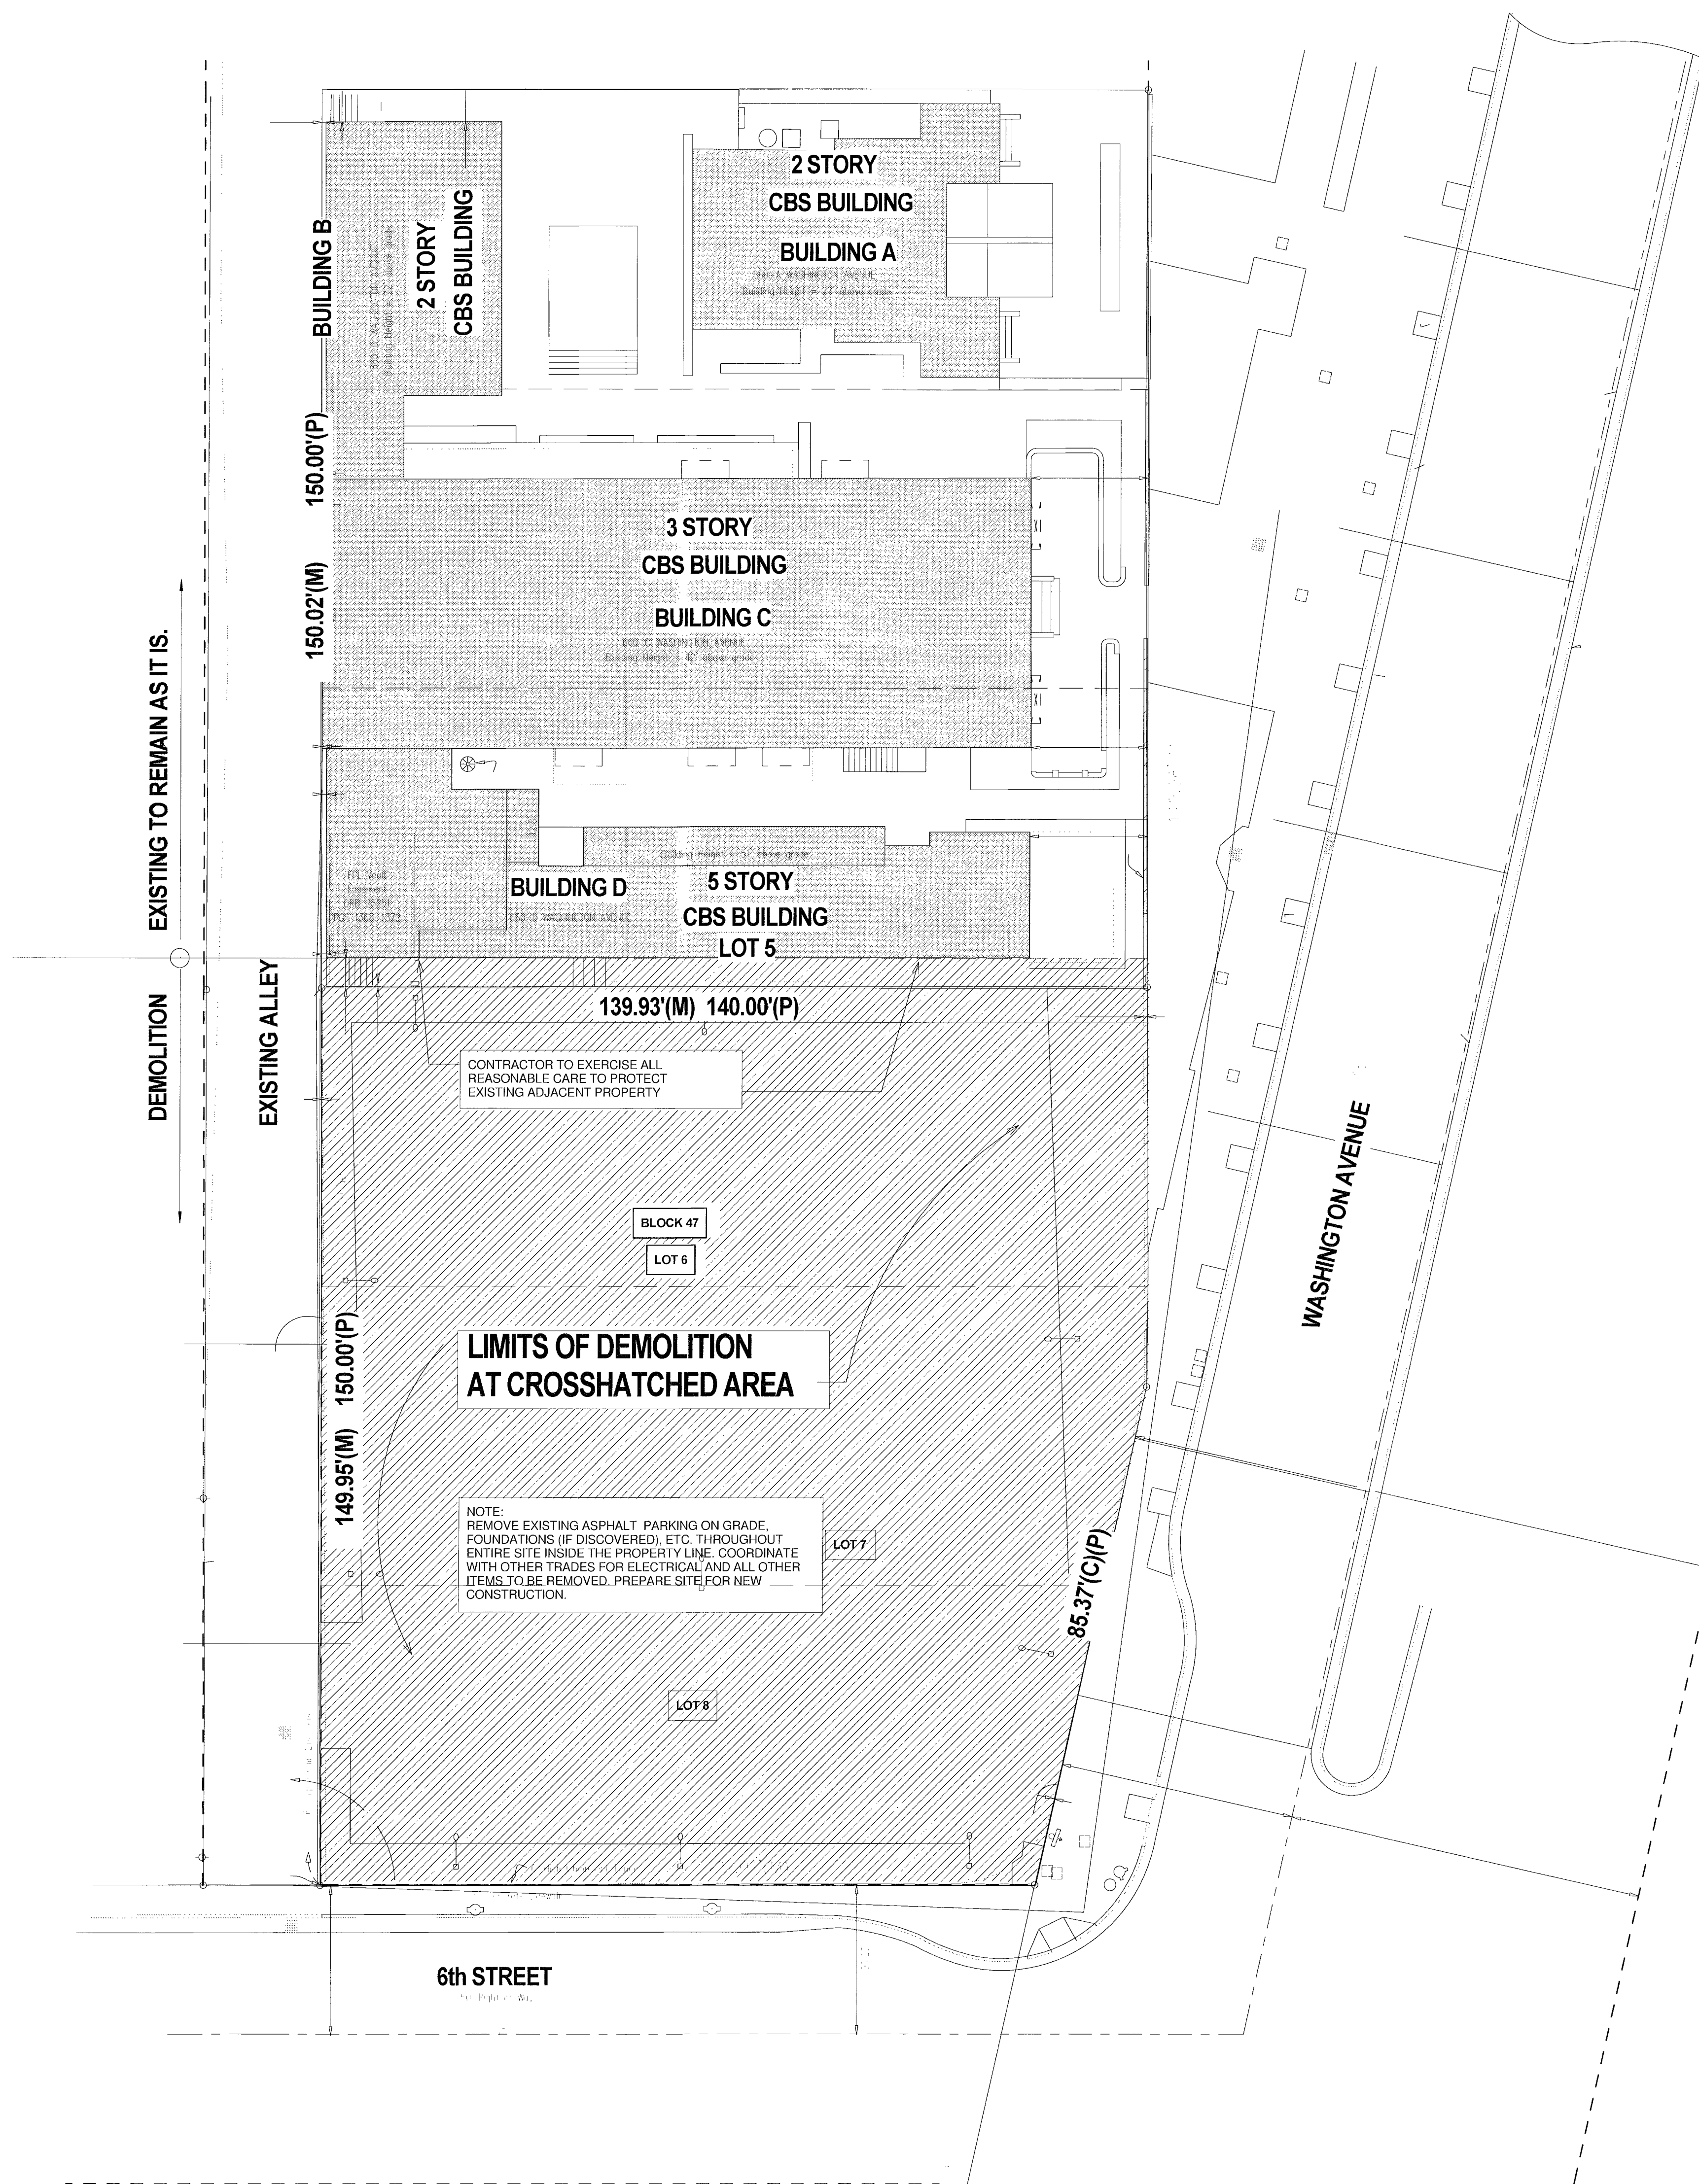

1
A0.D.01
DEMOLITION PLAN
1/16" = 1'-0"

DEMOLITION NOTES

1. ALL WORK SHALL COMPLY WITH THE REQUIREMENTS OF THE LOCAL BUILDING CODE AND ACCIDENT AND FIRE PREVENTION REGULATIONS.
2. CONTRACTOR'S STAFF IS RESPONSIBLE FOR THE DEMOLITION AND SHALL BE EXPERIENCED IN THIS TYPE OF WORK. EQUIPMENT SHALL BE SUITABLE TYPE, IN GOOD WORKING CONDITION, AND OPERATED BY SKILLED MECHANICS.
3. ALL WORK SHALL BE DONE IN A SAFE AND CAUTIOUS MANNER IN ORDER TO AND OTHER FORMS OF PROTECTION AS REQUIRED TO PROTECT OWNER'S AVOID ACCIDENTS AND PROPERTY DAMAGE. PROVIDE TEMPORARY BARRICADES PERSONNEL AND GENERAL PUBLIC FROM INJURY.
4. OWNER SHALL HAVE FIRST RIGHT OF REFUSAL ON ALL SALVAGEABLE MATERIAL AND UNLESS OTHERWISE NOTED ON PLAN, SHALL BECOME THE PROPERTY OF THE CONTRACTOR AND SHALL BE EVALUATED IN THE CONTRACTOR'S PRICE. PROMPTLY REMOVE SALVAGED MATERIAL FROM THE CONSTRUCTION SITE AS THE WORK PROCEEDS. CAREFULLY DISMANTLE AND STORE ON SITE ALL MATERIAL SCHEDULED TO REMAIN THE PROPERTY OF THE OWNER. PROTECT UNTIL REMOVAL BY THE OWNER OR UNTIL END OF CONTRACT.
5. PREVENT ACCUMULATION OF DEBRIS AND OVERLOADING OF ANY PARTS OF THE STRUCTURE.
6. ILLUMINATE AND PROTECT DANGEROUS OPENINGS AS NECESSARY.
7. COORDINATE WITH APPLICABLE UTILITY COMPANIES AND OWNER FOR UTILITY LINE REMOVAL, RELOCATION, CAPPING AND UTILITY SHUTDOWNS NECESSITATED BY DEMOLITION, REMOVAL AND RELOCATION WORK.
8. CONTRACTOR TO EXERCISE ALL REASONABLE CARE TO PROTECT EXISTING ADJACENT PROPERTY. CONTRACTOR TO ASSUME RESPONSIBILITY FOR ALL ADJACENT PROPERTY DAMAGED DURING CONSTRUCTION.
9. RELOCATE STREET SIGNAGE WITHIN THE PROPERTY LIMITS. COORDINATE NEW LOCATION WITH ALL PERMIT AGENCIES.
10. TREE REMOVAL AND RELOCATION IS UNDER SEPARATE PERMIT.
11. ANY ASBESTOS MATERIAL FOUND AT TIME OF DEMOLITION SHALL BE REPORTED TO THE OWNER AND ARCHITECT IMMEDIATELY. PROCEEDING WITH BUILDING DEMOLITION OPERATIONS. IF HAZARDOUS MATERIALS
12. VERIFY THAT ALL HAZARDOUS MATERIALS HAVE BEEN REMOVED BEFORE ARE FOUND DURING DEMOLITION OPERATIONS, COMPLY WITH APPLICABLE REGULATIONS, LAWS, AND ORDINANCES CONCERNING REMOVAL, HANDLING AND PROTECTION AGAINST EXPOSURE OR ENVIRONMENTAL POLLUTION.
13. THE CONTRACTOR SHALL ENGAGE A PROFESSIONAL ENGINEER LICENSED IN THE STATE OF FLORIDA FOR THE DESIGN OF ALL SHORING REQUIRED. AS WELL AS ANY SHORING OR BRACING ELEMENTS RELATED TO THE CONTRACTOR'S MEANS AND METHODS TO SAFELY CONDUCT THE DEMOLITION IN THE CONTRACT DOCUMENTS
14. ANY CONTAMINATED SOIL FOUND AT ANY TIME OF DEMOLITION SHALL BE REPORTED TO THE OWNER AND ARCHITECT IMMEDIATELY
15. TEST SOILS AROUND BURIED TANKS, IF DISCOVERED, FOR CONTAMINATION.
16. THE CONTRACTOR SHALL INVESTIGATE AND VERIFY OR HAVE VERIFIED THE LOCATION OF UTILITIES BEFORE STARTING WORK. HE SHALL BE LIABLE FOR ANY EXPENSE RESULTING FROM DAMAGE TO SAME. ANY CONFLICTS WITH EXISTING UTILITIES WILL BE BROUGHT TO THE ATTENTION OF THE ENGINEER AS SOON AS POSSIBLE IN ORDER THAT HE MAY VERIFY THE ELEVATION AND LOCATION OF EXISTING CONDITIONS.
17. IT WILL BE THE RESPONSIBILITY OF THE CONTRACTOR TO NOTIFY THE CITY, UTILITY COMPANIES AND THE ENGINEER 48 HOURS PRIOR TO ANY WORK AT SITE. WATER MAIN TIE-INS REQUIRING WATER SERVICE TO BE SHUT OFF WILL BE MADE DURING TIMES SPECIFIED BY THE CITY UTILITIES.
18. CONTACT GAS COMPANY FOR ALL WORK TO BE PERFORMED ON UTILITY GAS LINES
19. UTILITIES ON PLAN ARE BASED ON SURVEY AND VISUAL INSPECTION. CONTRACTOR SHALL FIELD VERIFY THIS INFORMATION, AND INFORM THE ENGINEER OF ANY DISCREPANCY OR UNFORESEEN CONDITION THAT MAY APPEAR BEFORE COMMENCEMENT OF WORK.
20. ALL UTILITIES INCLUDING WATER, SEWER, ELECTRIC, GAS, AND DRAINAGE SHALL BE CUT AND PLUGGED AND REMOVED ENTIRELY FROM WITHIN THE PROPERTY LINES
21. COORDINATION WITH F.P.L.
22. DISPOSAL OF DEMOLISHED MATERIALS: REMOVE DEBRIS, RUBBISH AND OTHER MATERIALS RESULTING FROM DEMOLITION OPERATIONS FROM BUILDING SITE. TRANSPORT AND LEGALLY DISPOSE OF MATERIALS OFF SITE IN AN EPA APPROVED LANDFILL ACCEPTABLE TO AUTHORITY HAVING JURISDICTION.
23. AFTER COMPLETION OF THE DEMOLITION WORK, LEAVE SITE NEAT AND ORDERLY.

EXISTING BUILDING -3

EXISTING 2 STORY HOTEL BUILDING NOT PART OF THIS PERMIT

EXISTING POOL NOT PART OF THIS PERMIT


EXISTING BUILDING -4

EXISTING 2 STORY HOTEL BUILDING NOT PART OF THIS PERMIT


EXISTING BUILDING -2
EXISTING ANGLER'S HOTEL
(NOT PART OF THIS PERMIT)
EXISTING 3 STORY HOTEL TOWER

EXISTING BUILDING -1

EXISTING 5 STORY HOTEL TOWER (NOT PART OF THIS PERMIT)

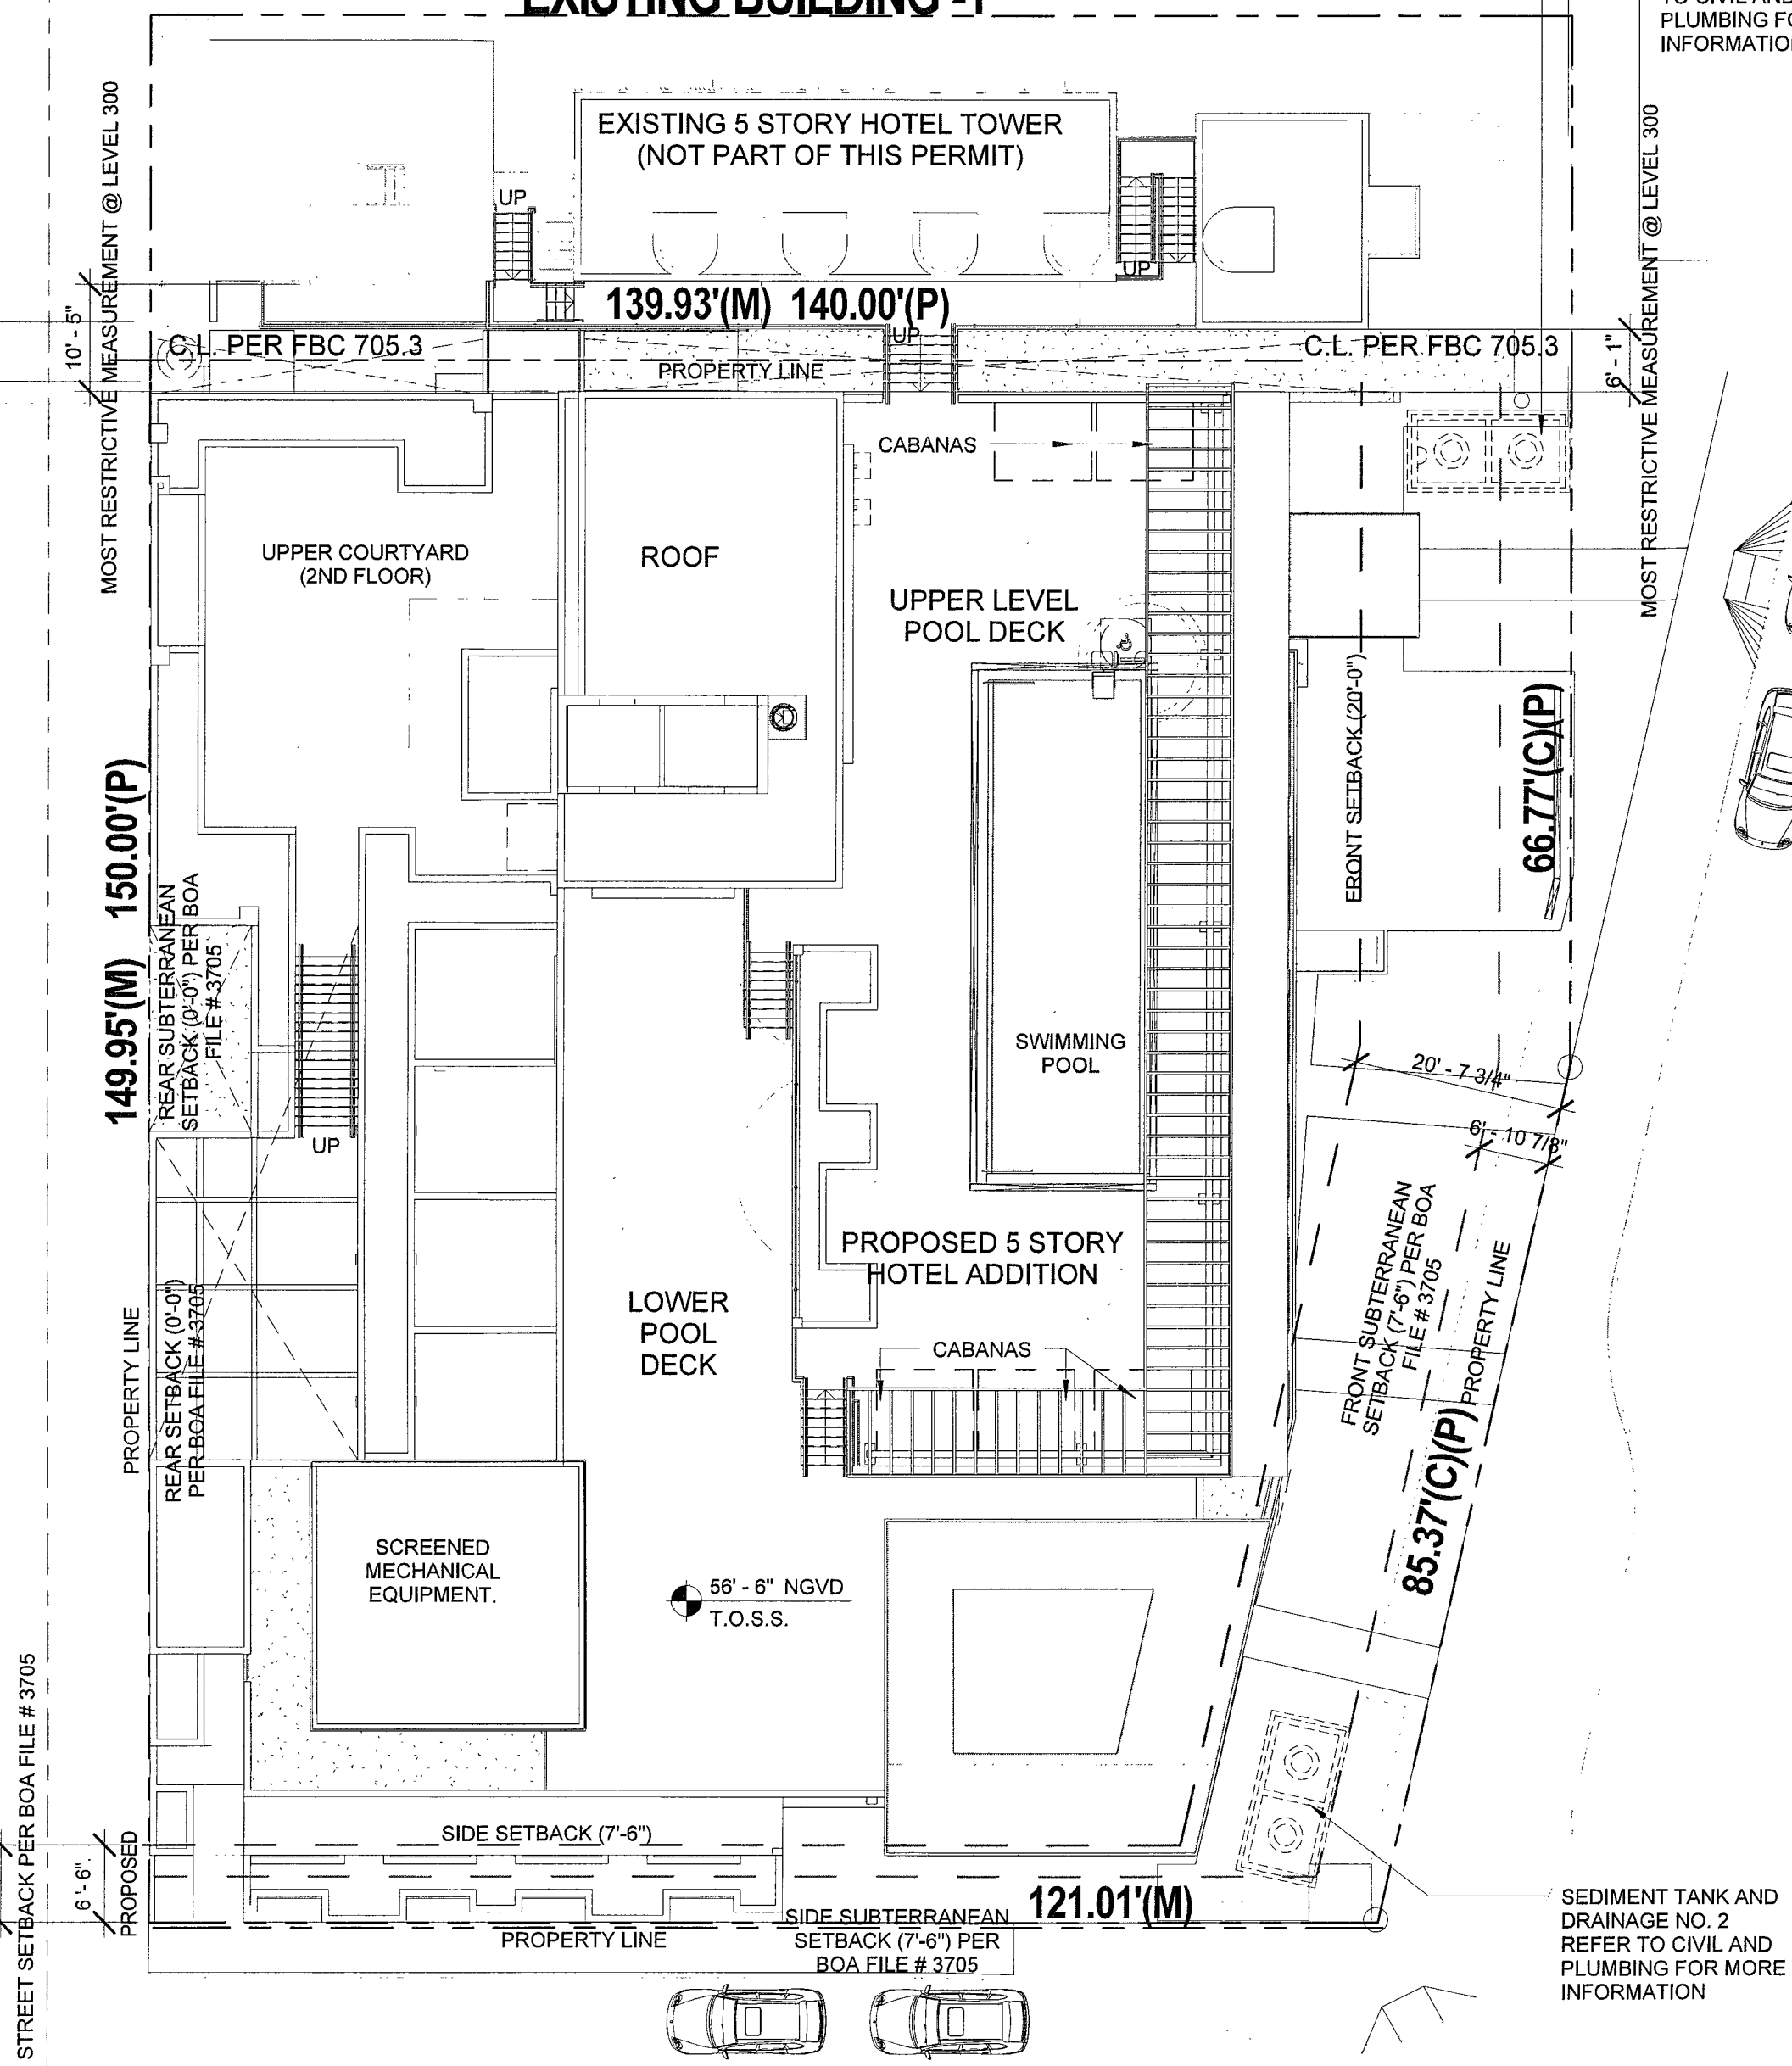

SITE LOCATION MAP
1" = 100'-0"

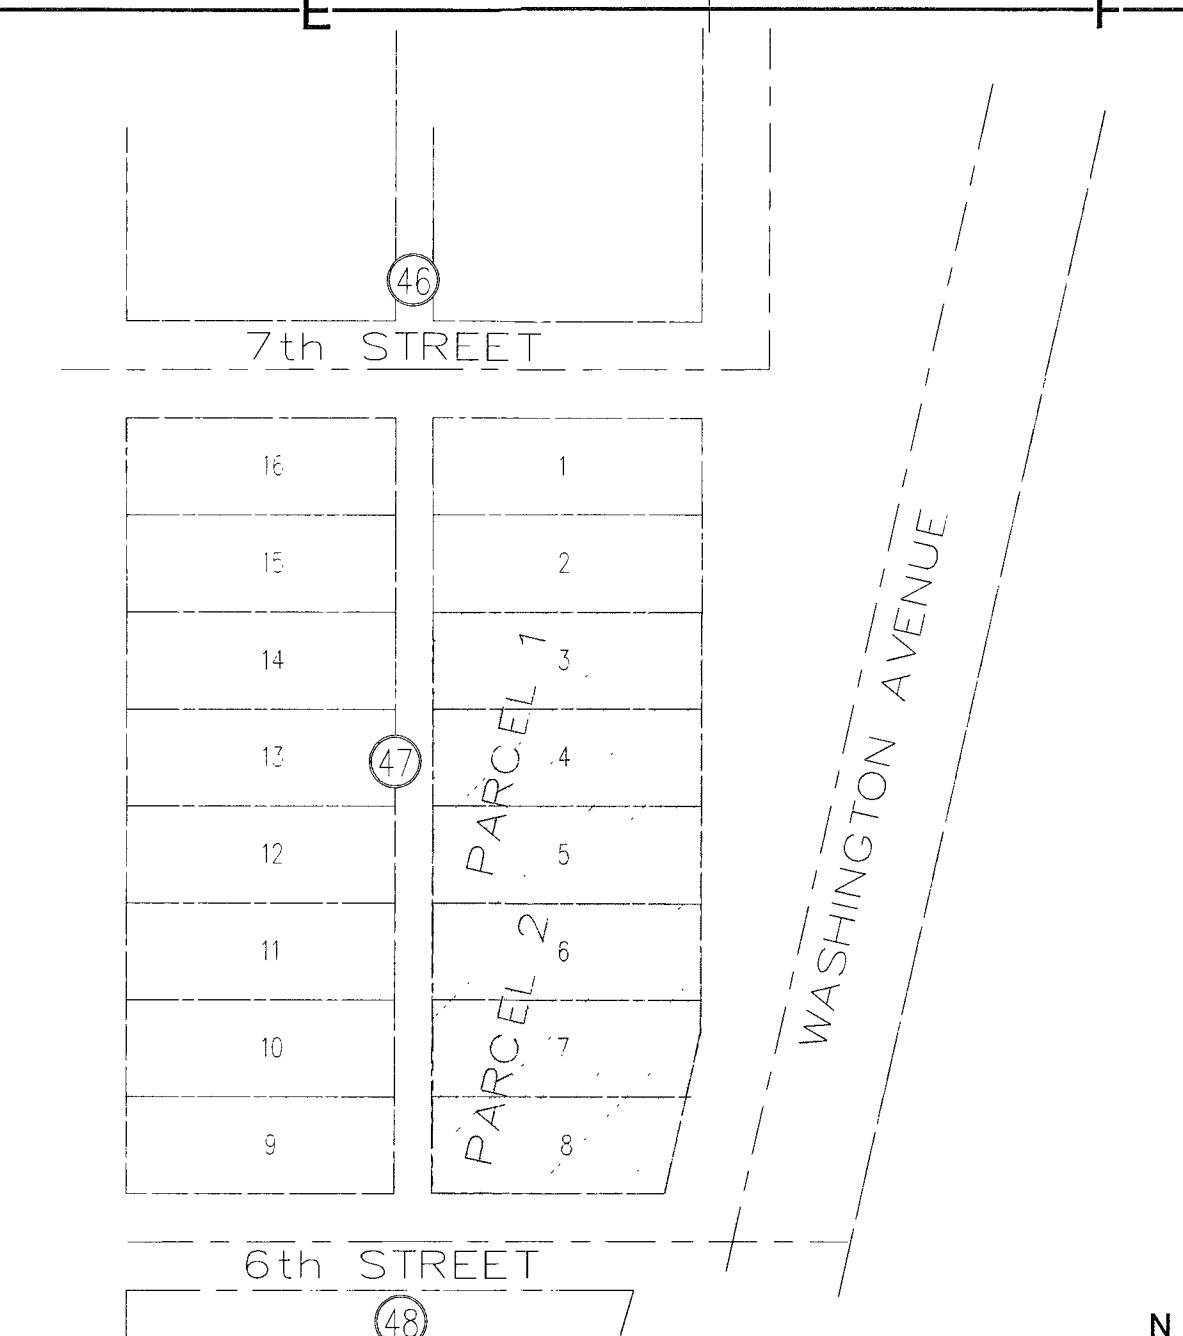

SCOPE:

SCOPE OF ARCHITECTURAL PORTION OF PERMIT AS FOLLOWS:

- COMBINATION OF THE CONSTRUCTION OF A NEW 5 STORY HOTEL BUILDING AND THE CONNECTION OF THE NEW BUILDING TO AN EXISTING 5 STORY BUILDING ADJACENT TO THE NEW SITE.
- THE NEW CONSTRUCTION CONSISTS OF THE FOLLOWING:
 - 5 STORY, (84) UNIT HOTEL WITH GROUND LEVEL AMENITIES, REGISTRATION, LOBBY BAR, MEETING ROOM, ADMINISTRATION COMPONENTS AND RETAIL COMPONENT OVER A BASEMENT LEVEL OF PARKING. SWIMMING POOL IS LOCATED AT AN ELEVATED DECK AT THE 6TH LEVEL.
 - MINOR DEMOLITION TO ADJACENT EXISTING BUILDING ALLOWING NEW CONNECTIONS AT LEVELS 200 THROUGH POOL DECK.
 - NEW CONSTRUCTION IN EXISTING BUILDING CONSISTING OF EXTENDING EXISTING STAIRS TO ROOF AND ADDING CONCRETE CATWALK AT LEVELS 5 AND ROOF.


NOTES:

- UPON PLACEMENT OF THE LOWEST FLOOR AND PRIOR TO FURTHER VERTICAL CONSTRUCTION THE "UNDER CONSTRUCTION ELEVATOR CERTIFICATE" AND THE "FLOOD PROOFING CERTIFICATE" SHALL BE SUBMITTED TO THE BUILDING DEPARTMENT FOR REVIEW AND APPROVAL (FBC 2010, BUILDING SECTION 110.3).
- PRIOR TO FINAL BUILDING INSPECTION APPROVAL OR OBTAINING TCO OR CO FINISHED CONSTRUCTION ELEVATION CERTIFICATE SHALL BE SUBMITTED TO THE BUILDING DEPARTMENT.

HOTEL GUESTROOMS PER FLOOR LEVEL:

HOTEL LEVELS	NUMBER OF GUESTROOMS
LEVEL - 100	NONE
LEVEL - 200	17 UNITS
LEVEL - 300	21 UNITS
LEVEL - 400	21 UNITS
LEVEL - 500	21 UNITS
LEVEL - 600	NONE
TOTAL NUMBER OF UNITS = 80	

SITE PLAN
1" = 1'-0"

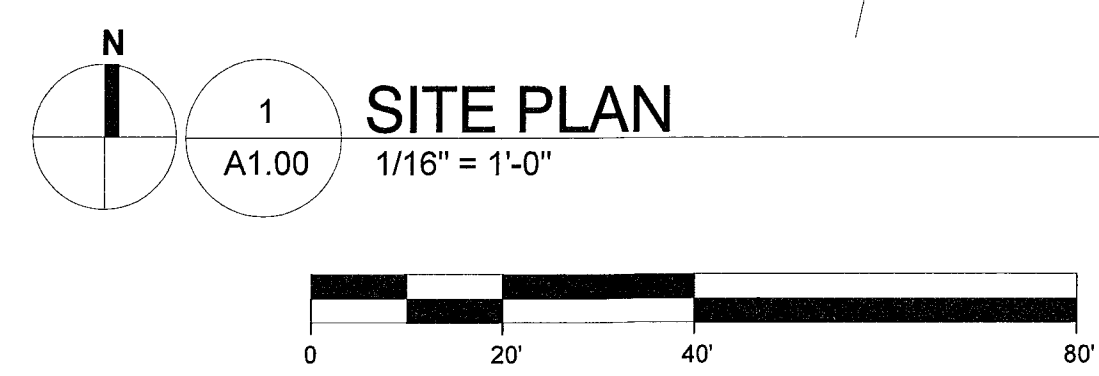

NOTE:
NO EMERGENCY GENERATOR REQUIRED ON THIS PROJECT

ZONING ANALYSIS

ZONING DISTRICT			
RM-2			
LEGAL DESCRIPTION			
LOTS 6, 7 AND 8 BLOCK 47, OCEAN BEACH ADDITION NO. 3, ACCORDING TO THE PLAT THEREOF AS RECORDED IN PLAT BOOK 2, AT PAGE 81, OF THE PUBLIC RECORDS OF MIAMI-DADE COUNTY, FLORIDA.			
LOT AREA			
	SF	ACRES	
	20,192.73	0.4635	
EXISTING BUILDING FLOOR AREA			
	ALLOWED AREA = 42,000	PROVIDED AREA = 32,312	
AVAILABLE FROM EXISTING SITE PER SHEET A03.01 AND A03.02.		42,000 - 32,312 = 9,688	
FLOOR AREA			
SEC. 142-216	ALLOWED	PROVIDED	
"RM-2" ZONE: 2.0	40,385.46		
AVAILABLE FROM EXISTING SITE: PER SHEET A03.01 AND A03.02	9,688.00	49,803	
TOTAL MAXIMUM ALLOWED:	50,073.00		
HEIGHT			
SEC. 142-217	ALLOWED	PROVIDED	
	5 STORY/ 50 FT	50'-0"	
SETBACKS			
SEC. 142-218	REQUIRED	PROVIDED	
FRONT	20'-0"	20'-0"	
FRONT - UNDERGROUND	20'-0"	7'-6" (VARIANCE APPROVED AT BOARD OF ADJUSTMENT HEARING ON 12/05/2014)	
SIDE STREET	7'-6" MIN. OR 8% OF LOT WIDTH (WHICHEVER IS GREATER)	7'-6" MIN (VARIANCE APPROVED AT BOARD OF ADJUSTMENT HEARING ON 12/05/2014)	
SIDE STREET - UNDERGROUND	7'-6" MIN. OR 5% OF LOT WIDTH (WHICHEVER IS GREATER)	7'-6" MIN (VARIANCE APPROVED AT BOARD OF ADJUSTMENT HEARING ON 12/05/2014)	
REAR	10% OF LOT DEPTH = 14'-0"	0'-0" (VARIANCE APPROVED AT BOARD OF ADJUSTMENT HEARING ON 12/05/2014)	
REAR - UNDERGROUND	NON-OCEANFRONT LOTS - 0'-0"	0'-0"	
PARKING			
	REQUIRED	PROVIDED	
HOTEL USE For Hotels less than 100 Units, 1/2 Space per Unit." (Per City of Miami Beach Ordinance # 130-339(4))	40	40	
RETAIL 1 Space per 400 SF, minus 7.5 SF per Unit = (2,802 SF) - (80 units x 7.5 SF) = 2,802 - 600 / 400 = 5.50	5.50	3	
MEETING ROOM + BOARDROOMS For Registered Hotel Guest Use Only.	0	0	
BAR 1 Space Per 4 Seats, minus 1 seat for every 2 Units. Total number of Seats = 68 Total number of Rooms = 80 80 / 2 = 40 Total parking req. = (68-40) / 4 = 7	7	2	
TOTAL	52.5 (53)	45	
100% VALET PARKING		TRIPLE SPACE (VARIANCE APPROVED AT BOARD OF ADJUSTMENT HEARING ON 12/05/2014)	

P1 LEVEL - PARKING SCHEDULE

	COUNT	PARKING TYPE
BASEMENT	45	VALET ONLY
BASEMENT: 45		


ADA ROOM MATRIX (BASED ON FLORIDA ACCESSIBILITY CODE FOR BUILDING CONSTRUCTION 2012 EDITION)

HOTEL LEVELS	FBC 224.4 COMMUNICATION FEATURES	FBC 806.4 SPECIAL ACCESSIBILITY	FBC 224.2 MOBILITY FEATURES	
			WITHOUT ROLL-IN SHOWER	WITH ROLL-IN SHOWER
L-100	121	-	-	-
L-200	208, 215	-	-	209
L-300	306, 314	-	303	-
L-400	410, 413	-	403	-
L-500	508, 517	-	503, 516	-
TOTAL PROVIDED	9	0	4	1
TOTAL REQUIRED	9	0	4	1

ADA UNIT CALCULATION:
1- In accordance with 224.2 of the Florida Accessibility Code of The Florida Building Code 2010 Calculations are based on Tables 224.2, 224.4, and Section 806.4.
2- Based on: 80 Hotel Guestrooms
Guestroom 5 with Mobility Features: 76-100 Guestrooms = 5 Guestrooms Required (Table 224.2).
3- Guestroom 5 with Mobility Features With Roll-In Shower: 1 (Table 224.2).
Guestroom 5 with Mobility Features Without Roll-In Shower: 4 (Table 224.2).
4- Required Communication Features: 76-100 Guestrooms = 9 (Table 224.4).
5- Florida Special Accessible Features: 5% of 80 units = 4 (4 - 5 Mobility Features) = 0 Units Required (Section 806.4).

AREA CALCULATION BY OCCUPANCY

R-1	Total sq.ft.	A-2	Total sq.ft.	A-3	Total sq.ft.	A-4	Total sq.ft.	M	Total sq.ft.	B	Total sq.ft.	S-1	Total sq.ft.	S-2	Total sq.ft.	KITCHEN	Total sq.ft.	TERRACES/BALCONIES	Total sq.ft.	STAIRS/ELEV.	Total sq.ft.	CIRCULATION	Total sq.ft.	BATHROOMS	Total sq.ft.
Residential	29025 SF	Assembling without fixed seats - Concentrated (chairs only-not fixed)	2776 SF	Assembling without fixed seats - Unconcentrated (tables and chairs)	1831 SF	Swimming pool deck	6566 SF	Mercantile - Basement and grade floor aeas	2802 SF	Business areas	1172 SF	Storage, stock, shipping areas	3195 SF	Parking garages (Including Ramp)	15426 SF	Kitchen, commercial	288 SF	BALCONY TERRACE	3488 SF 6799 SF	STAIR ELEVATOR	2516 SF 1334 SF	GUEST CORRIDOR CORRIDOR ELEVATOR LOBBY	4928 SF 3497 SF 1630 SF	TOILET	1322 SF
						Swimming pool water surface	850 SF																		
						Grand total: 3	7416 SF																		
GRAND TOTAL		10,374		3,318		10,066																			

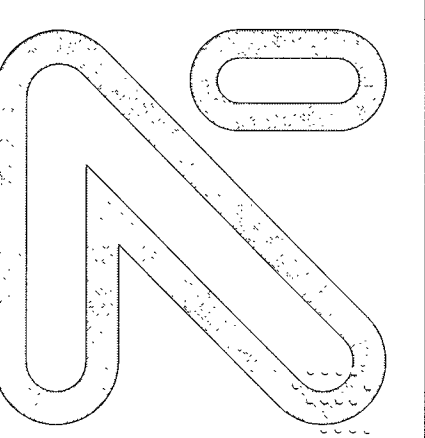

NICHOLS
BROSCH-
WURSTER
WOLFE
& ASSOCIATES, INC.
Architecture & Planning
161 Atlantic Avenue
Coral Gables, FL 33134
(305) 442-0272
(407) 502857



ANGLER'S HOTEL
600 WASHINGTON AVENUE, MIAMI BEACH, FLORIDA 33139
DEVELOPED BY: Angler's Boutique Resort LLC

APR 23 2015

REVISIONS		
#	Description	Date
1	CMB Bldg. Dept. Comments	12/16/14
2	CMB Bldg. Dept. Comments	01/15/15
3	CMB Bldg. Dept. Comments	03/25/15
4	CMB Bldg. Dept. Comments	04/14/2015

12064
A1.00

NEW CONSTRUCTION EXISTING ANGLER'S HOTEL BUILDING

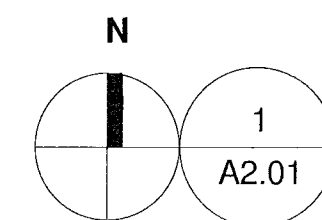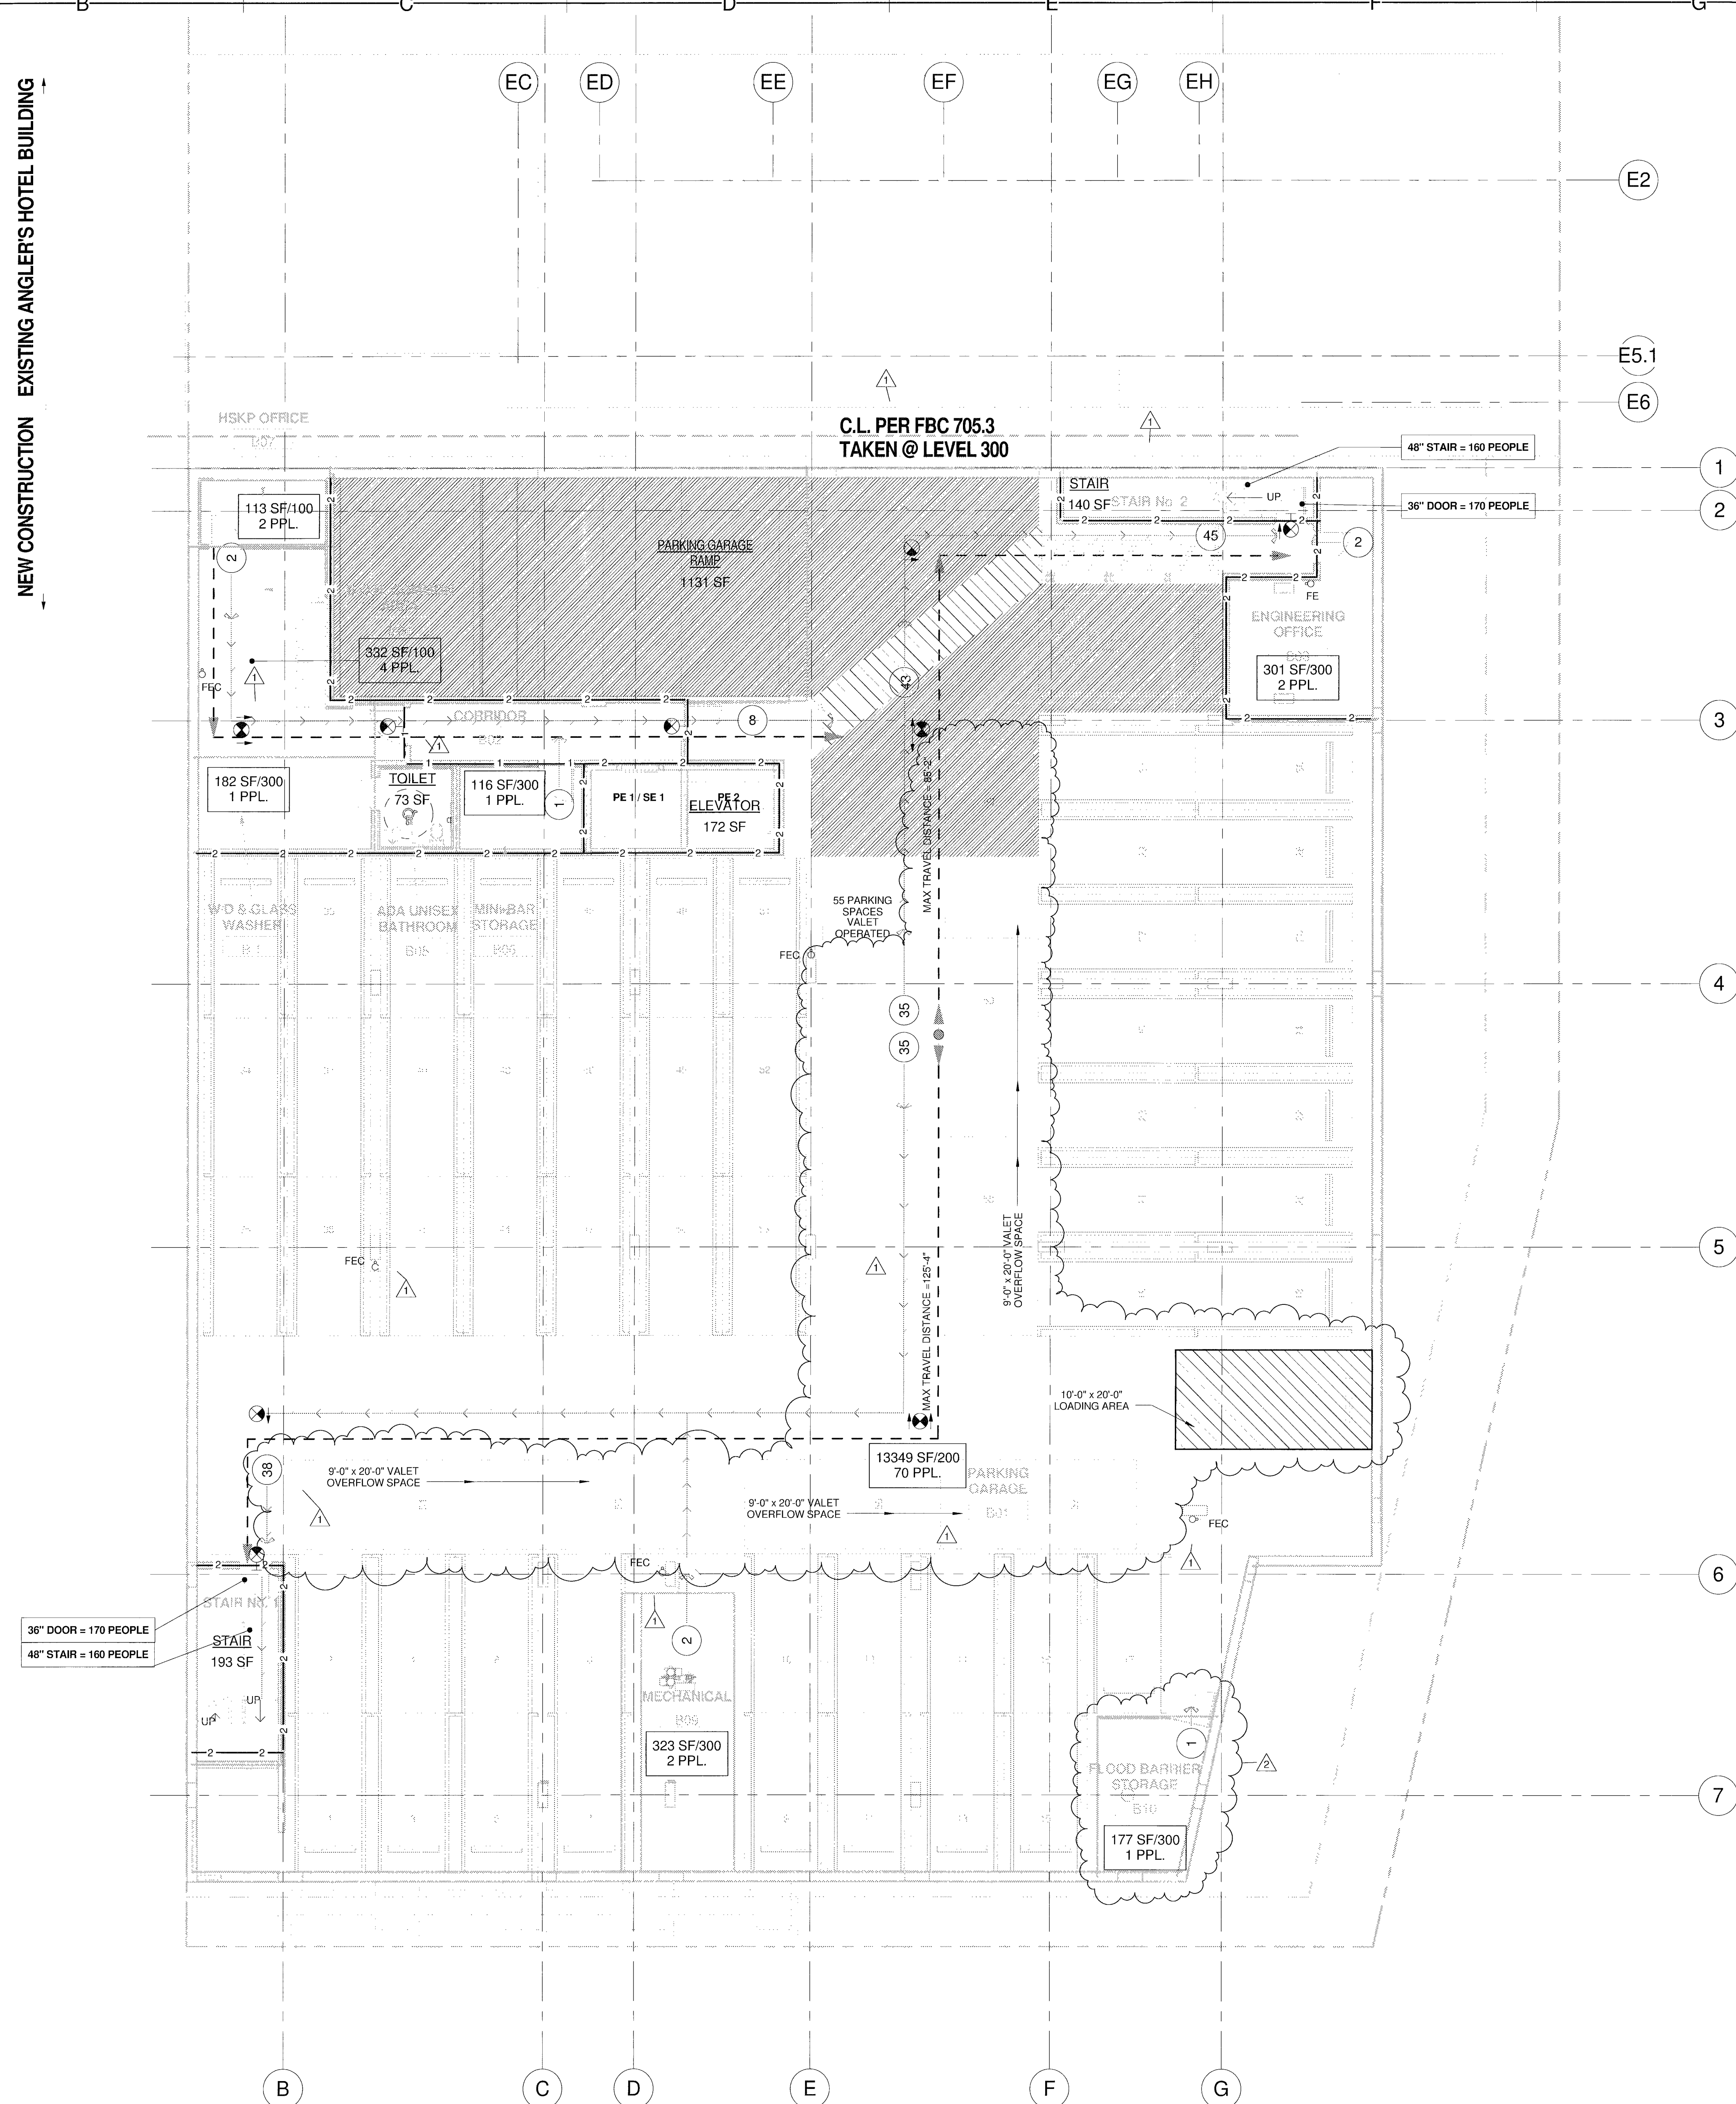

BASEMENT LEVEL (PARKING GARAGE) LIFE SAFETY PLAN
T.O.S.S. 3'-11" N.G.V.D.

FIRE RATED CONSTRUCTION LEGEND	
	4 HOUR FIRE WALL (EXISTING)
	3 HOUR FIRE WALL (NOT USED)
	2 HOUR FIRE WALL
	2 HOUR FIRE WALL (EXISTING)
	1 HOUR FIRE WALL
	SMOKE BARRIER (NOT USED)
	PATH OF TRAVEL TO EXIT
	MAXIMUM TRAVEL DISTANCE
NOTE : PLANS INDICATE MINIMUM RATING REQUIRED, ACTUAL WALL MAY HAVE A HIGHER RATING.	
EXIT LIGHT LEGEND	
	EXIT LIGHT FIXTURE CEILING MOUNTED, DIRECTION ARROWS AS SHOWN (SHADED QUADRANT INDICATES FACES OF FIXTURES).
	EXIT LIGHT FIXTURE WALL MOUNTED, DIRECTION ARROWS AS SHOWN (SHADED QUADRANT INDICATES FACES OF FIXTURES).



ANGLER'S HOTEL
600 WASHINGTON AVENUE, MIAMI BEACH, FLORIDA 33139
DEVELOPED BY: Angler's Boutique Resort LLC

JAN 15 2015
[Signature]

REVISIONS		
#	Description	Date
1	CMR Bldg. Dept. Comments	12/16/14
2	CMR Bldg. Dept. comments	01/15/15

12064

A2.01


REVIEWED
CITY OF MIAMI BEACH
FIRE DEPARTMENT
FILE

600 WASHINGTON AVENUE, MIAMI BEACH, FLORIDA 33139
DEVELOPED BY: Angler's Boutique Resort LLC


Permit Issue
10-10-11

1	CMB Bldg. Dept. Comments
3	CMB Bldg. Dept. Comments

A2.02

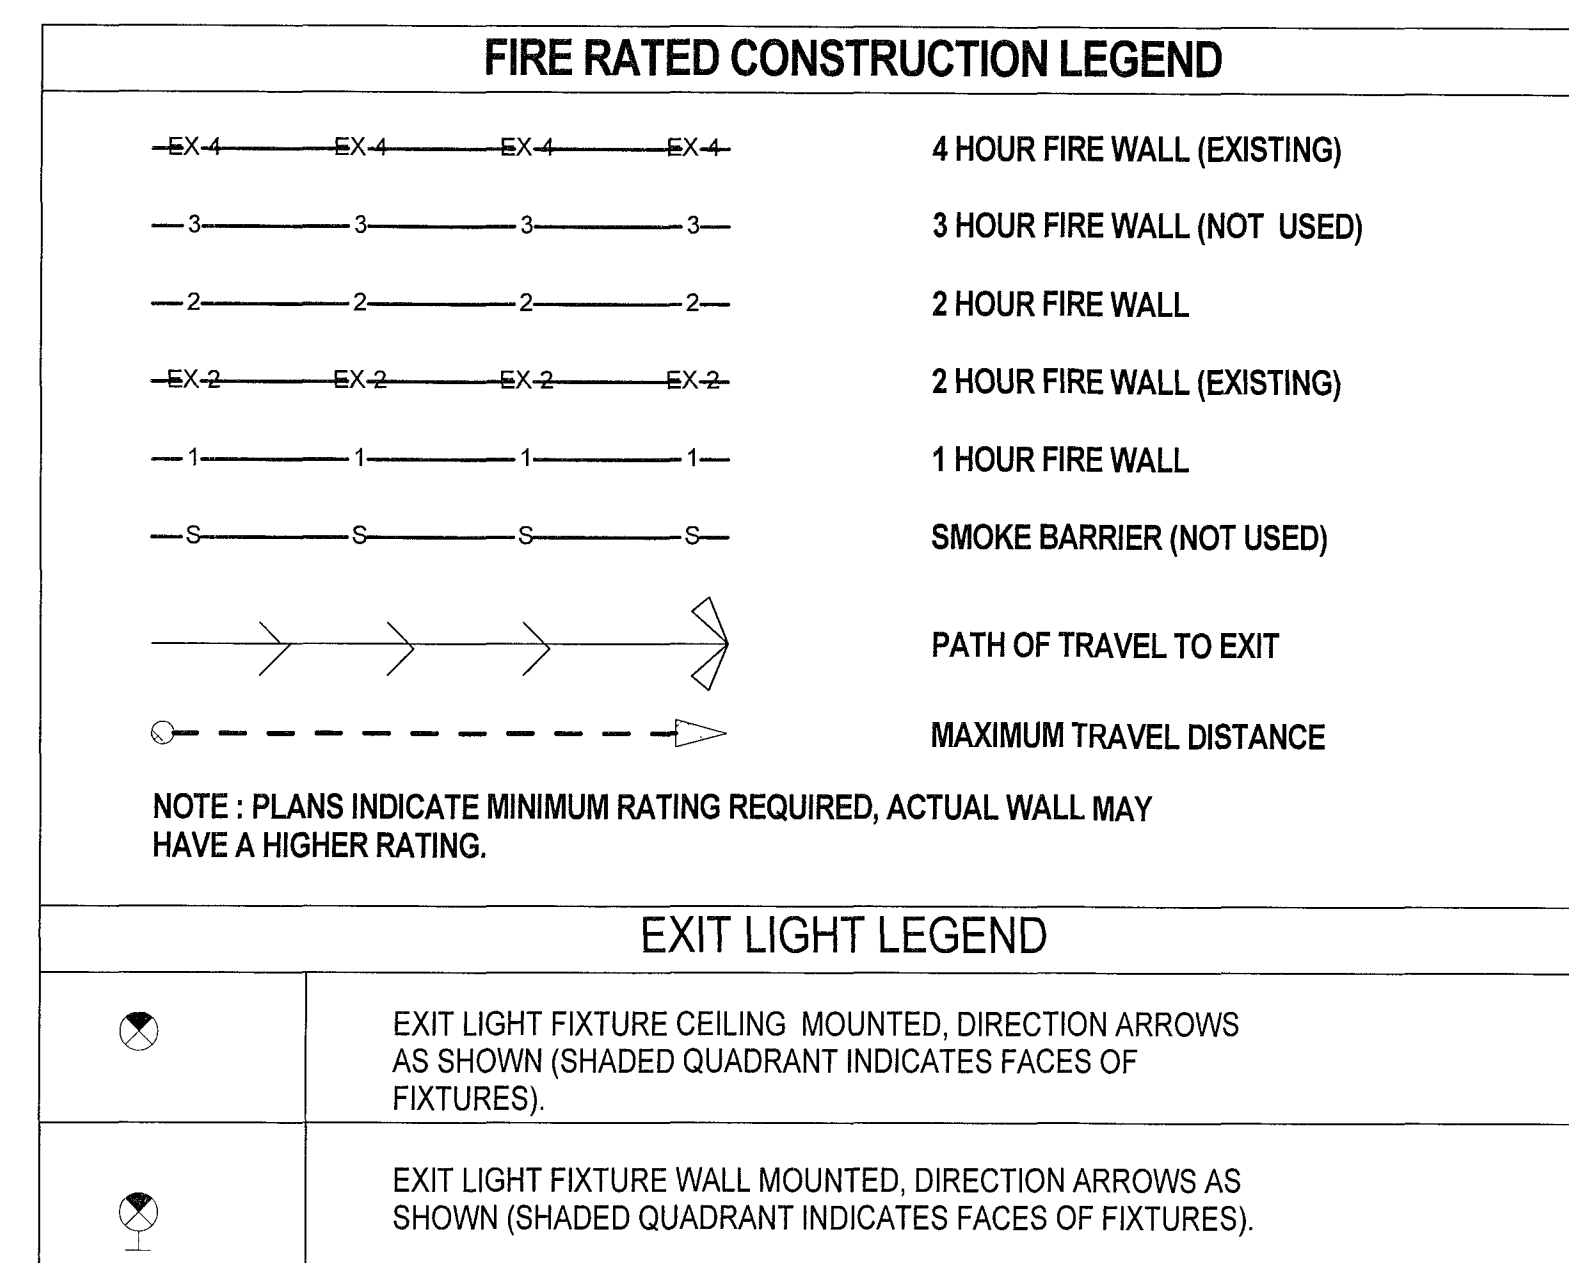

NEW CONSTRUCTION ANGLER'S HOTEL BUILDING

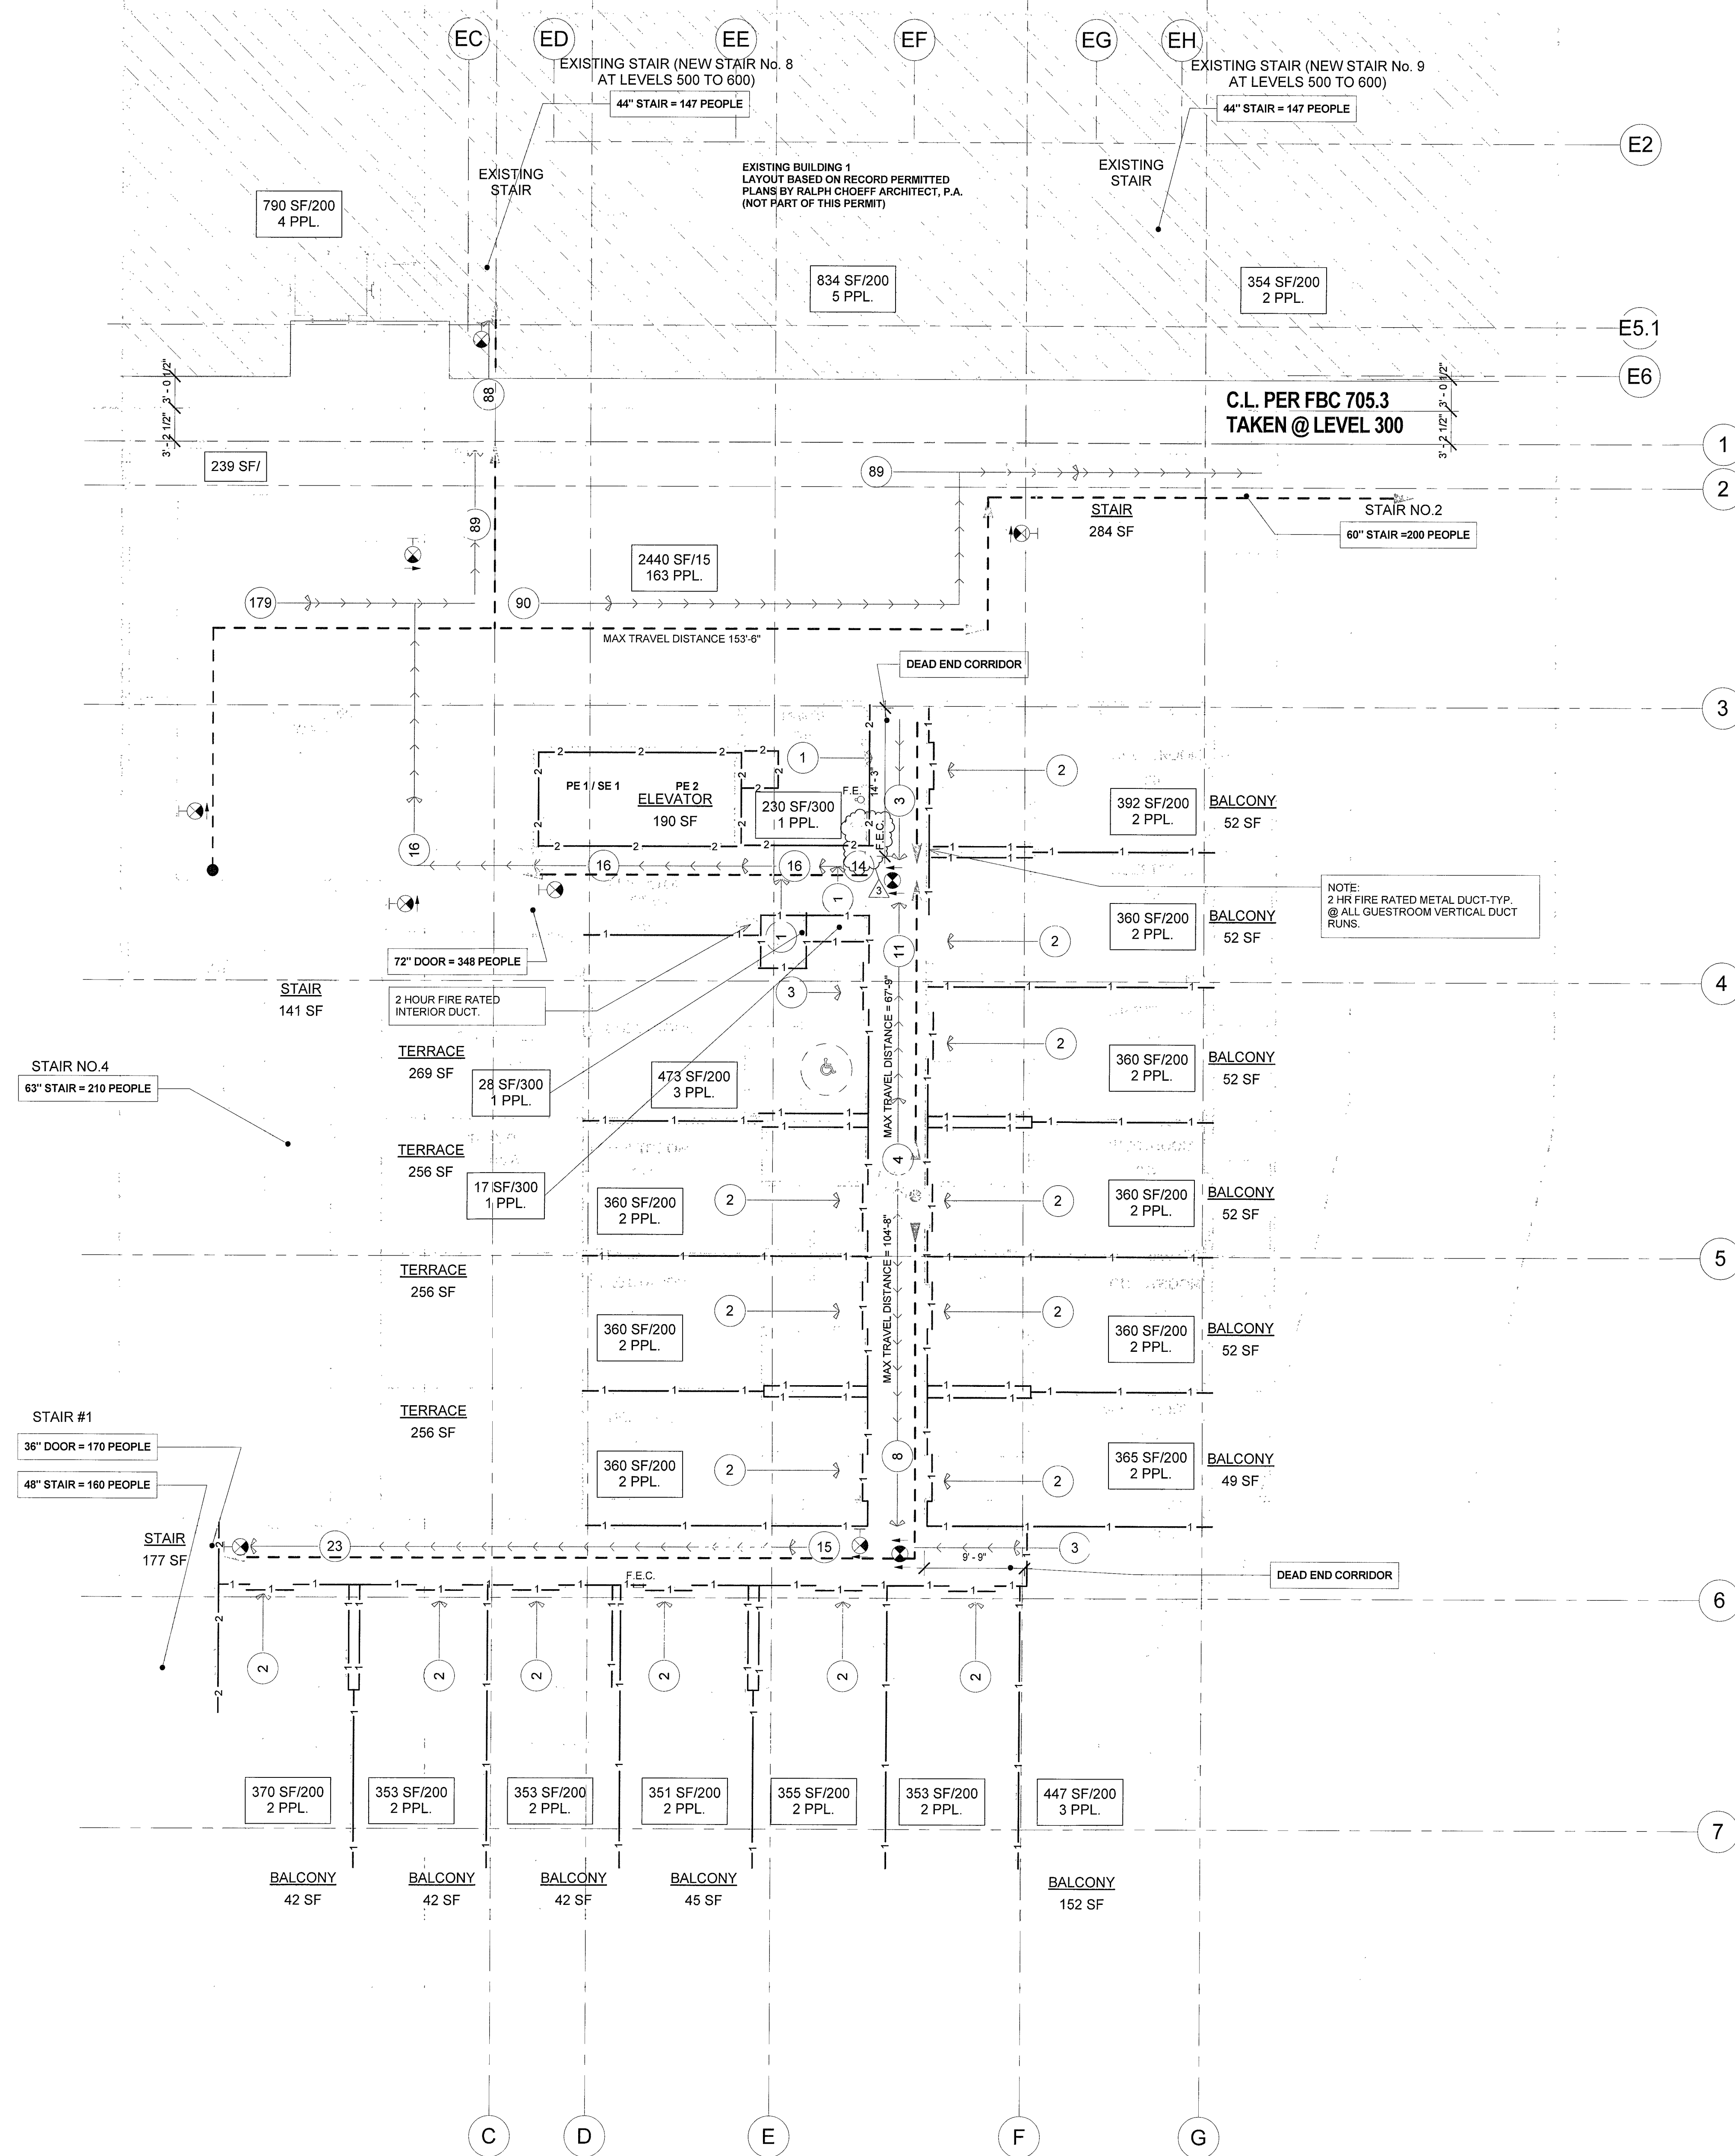

FIRE RATED CONSTRUCTION LEGEND	
	4 HOUR FIRE WALL (EXISTING)
	3 HOUR FIRE WALL (NOT USED)
	2 HOUR FIRE WALL
	2 HOUR FIRE WALL (EXISTING)
	1 HOUR FIRE WALL
	SMOKE BARRIER (NOT USED)
	PATH OF TRAVEL TO EXIT
	MAXIMUM TRAVEL DISTANCE
NOTE: PLANS INDICATE MINIMUM RATING REQUIRED, ACTUAL WALL MAY HAVE A HIGHER RATING.	
EXIT LIGHT LEGEND	
	EXIT LIGHT FIXTURE CEILING MOUNTED, DIRECTION ARROWS AS SHOWN (SHADED QUADRANT INDICATES FACES OF FIXTURES).
	EXIT LIGHT FIXTURE WALL MOUNTED, DIRECTION ARROWS AS SHOWN (SHADED QUADRANT INDICATES FACES OF FIXTURES).



ANGLER'S HOTEL
600 WASHINGTON AVENUE, MIAMI BEACH, FLORIDA 33139
DEVELOPED BY: Angler's Boutique Resort LLC

APR 25 2015
[Signature]

REVISIONS		
#	Description	Date
1	CMB Bldg Dept. Comments	12/16/14
3	CMB Bldg Dept. Comments	03/25/15

12064

A2.03


1
A2.03
LEVEL 200 LIFE SAFETY PLAN
1/8" = 1'-0"
T.O.S.S. 17'-4" N.G.V.D.







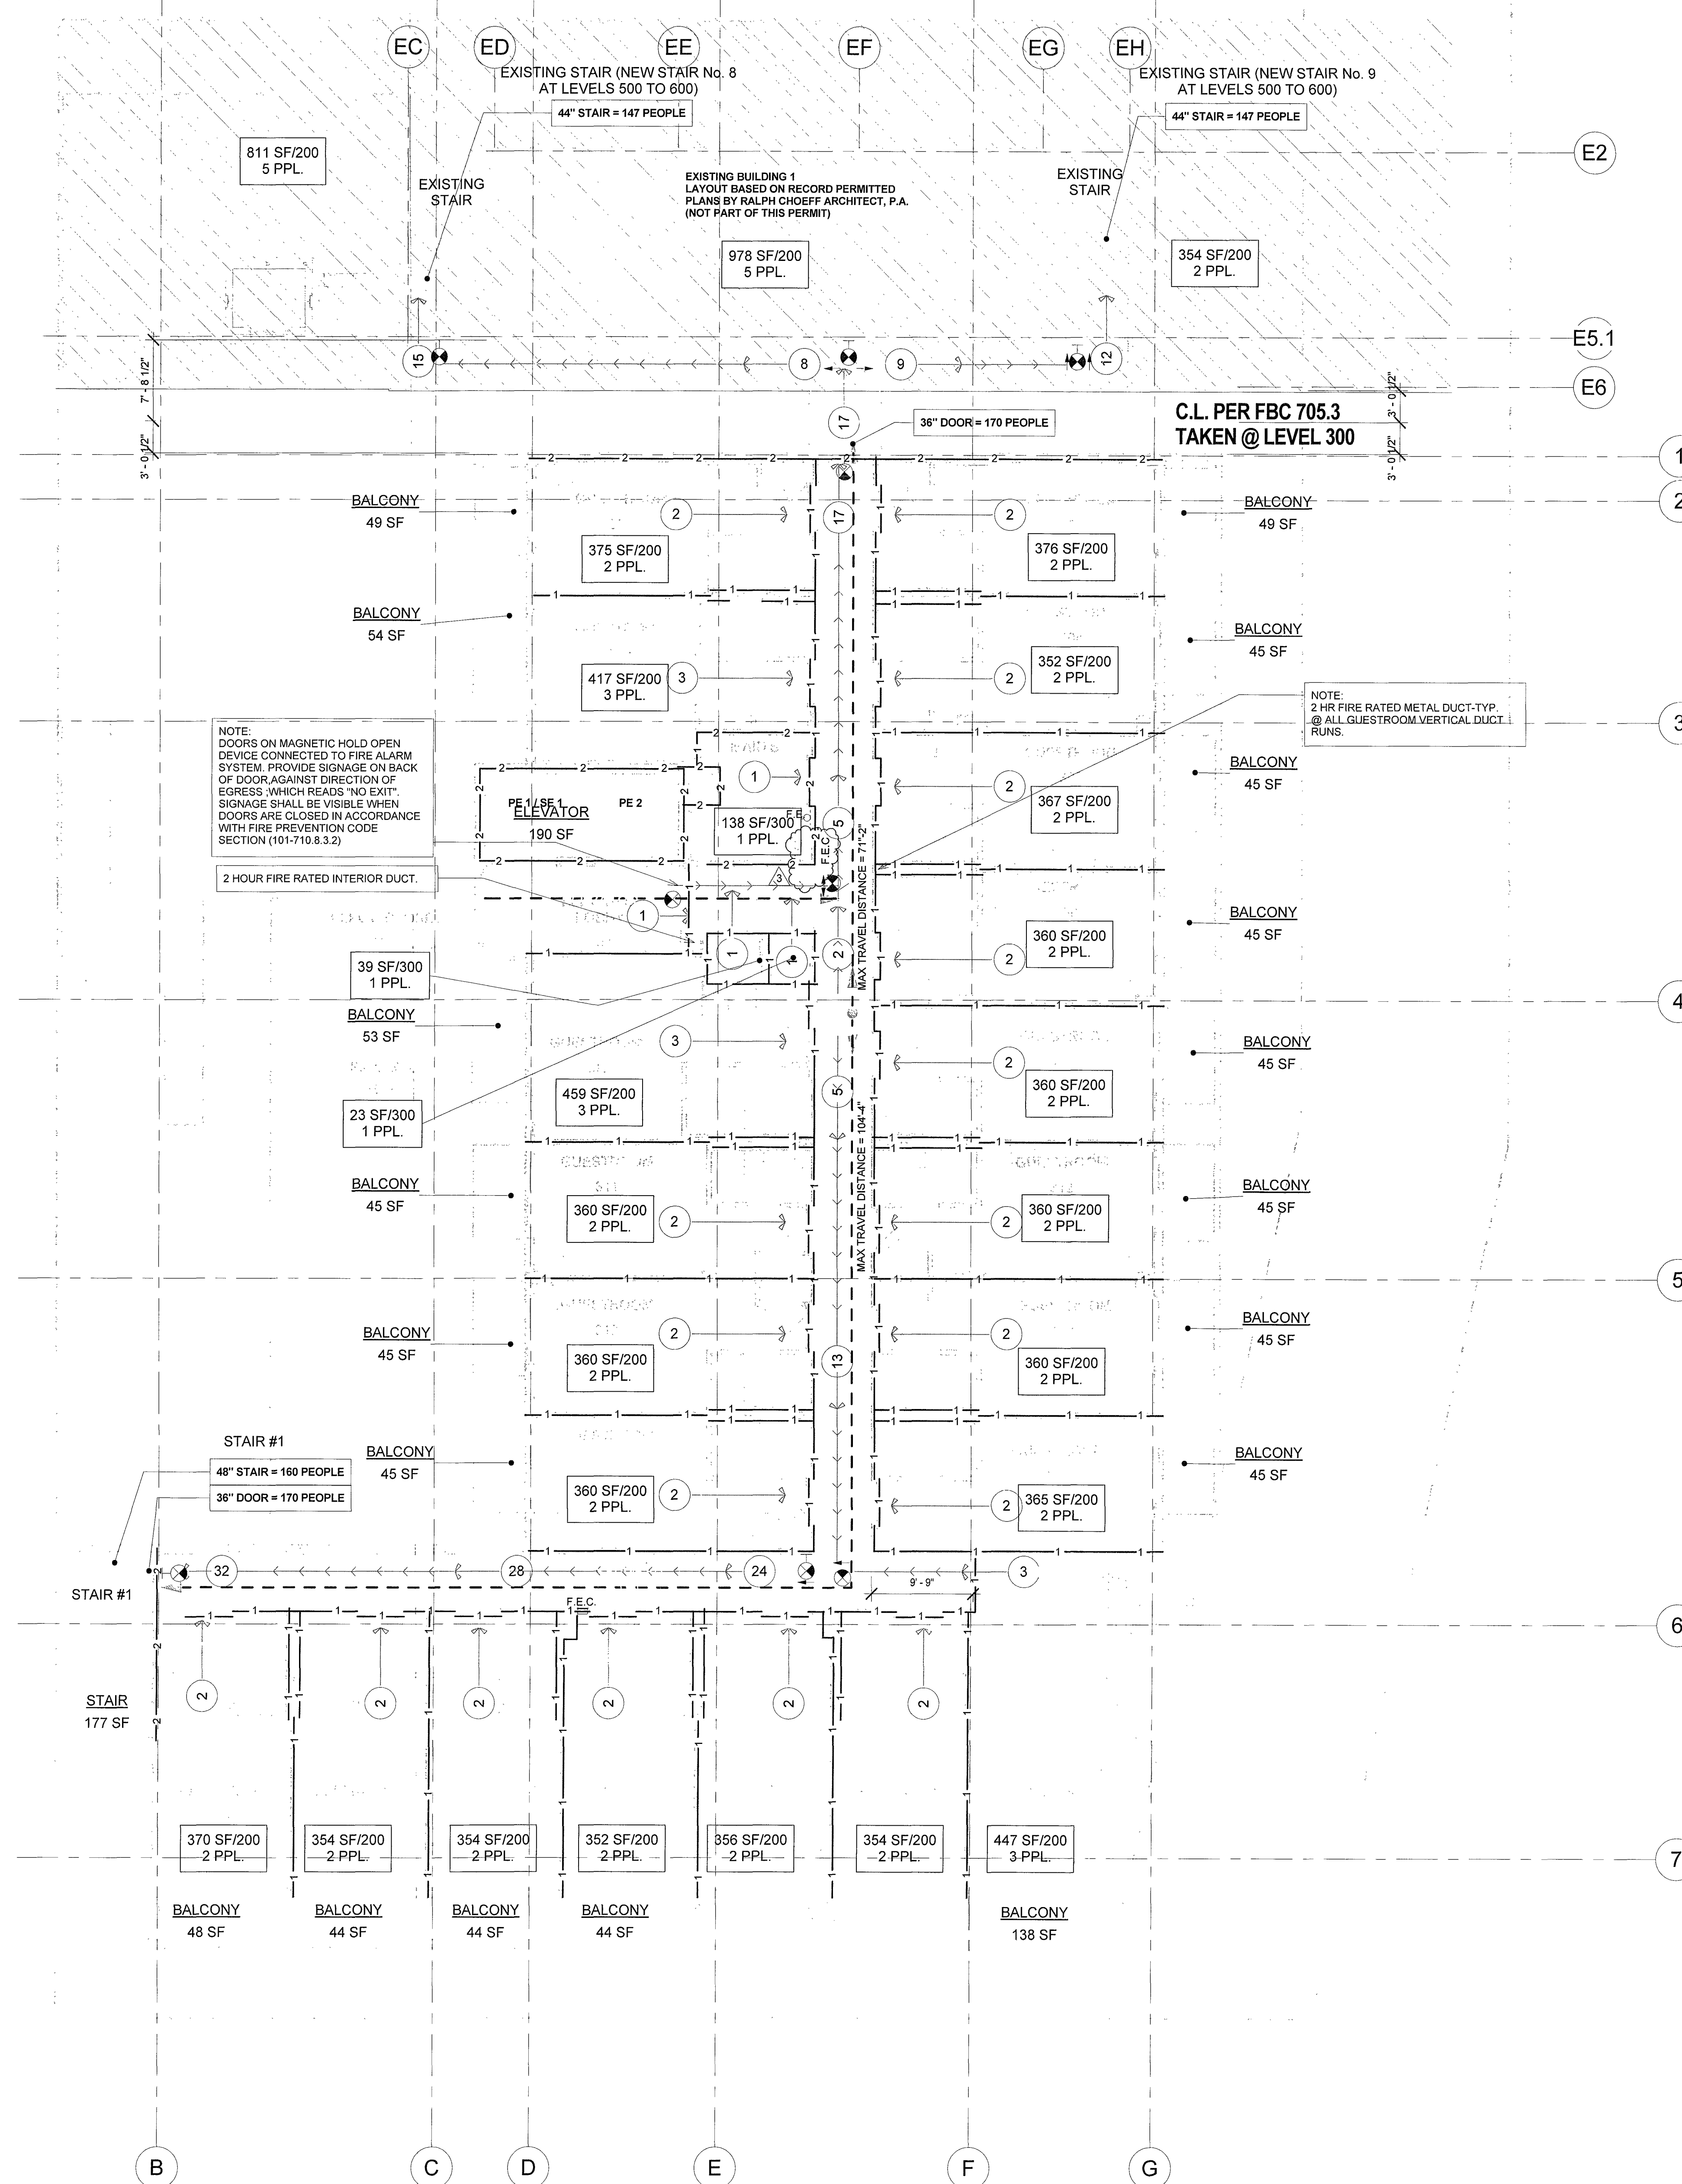



MAR 25 2015

Permit Issue 10-13-14	
REVISIONS	
	Description
CMB Bldg. Dept. Comments	
CMB Bldg. Dept. Comments	

12064

A2.04





FIRE RATED CONSTRUCTION LEGEND	
	4 HOUR FIRE WALL (EXISTING)
	3 HOUR FIRE WALL (NOT USED)
	2 HOUR FIRE WALL
	2 HOUR FIRE WALL (EXISTING)
	1 HOUR FIRE WALL
	SMOKE BARRIER (NOT USED)
	
	
NOTE : PLANS INDICATE MINIMUM RATING REQUIRED, ACTUAL WALL MAY HAVE A HIGHER RATING.	
EXIT LIGHT LEGEND	
	EXIT LIGHT FIXTURE CEILING MOUNTED, DIRECTION ARROWS AS SHOWN (SHADED QUADRANT INDICATES FACES OF FIXTURES).
	EXIT LIGHT FIXTURE WALL MOUNTED, DIRECTION ARROWS AS SHOWN (SHADED QUADRANT INDICATES FACES OF FIXTURES).

LEVEL 300 LIFE SAFETY PLAN
1/8" = 1'-0" T.O.S.S. 26'-8" N.G.V.D.



NEW CONSTRUCTION EXISTING ANGLER'S HOTEL BUILDING

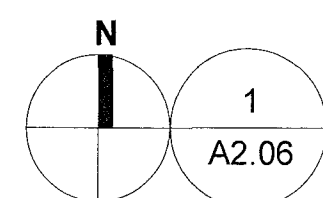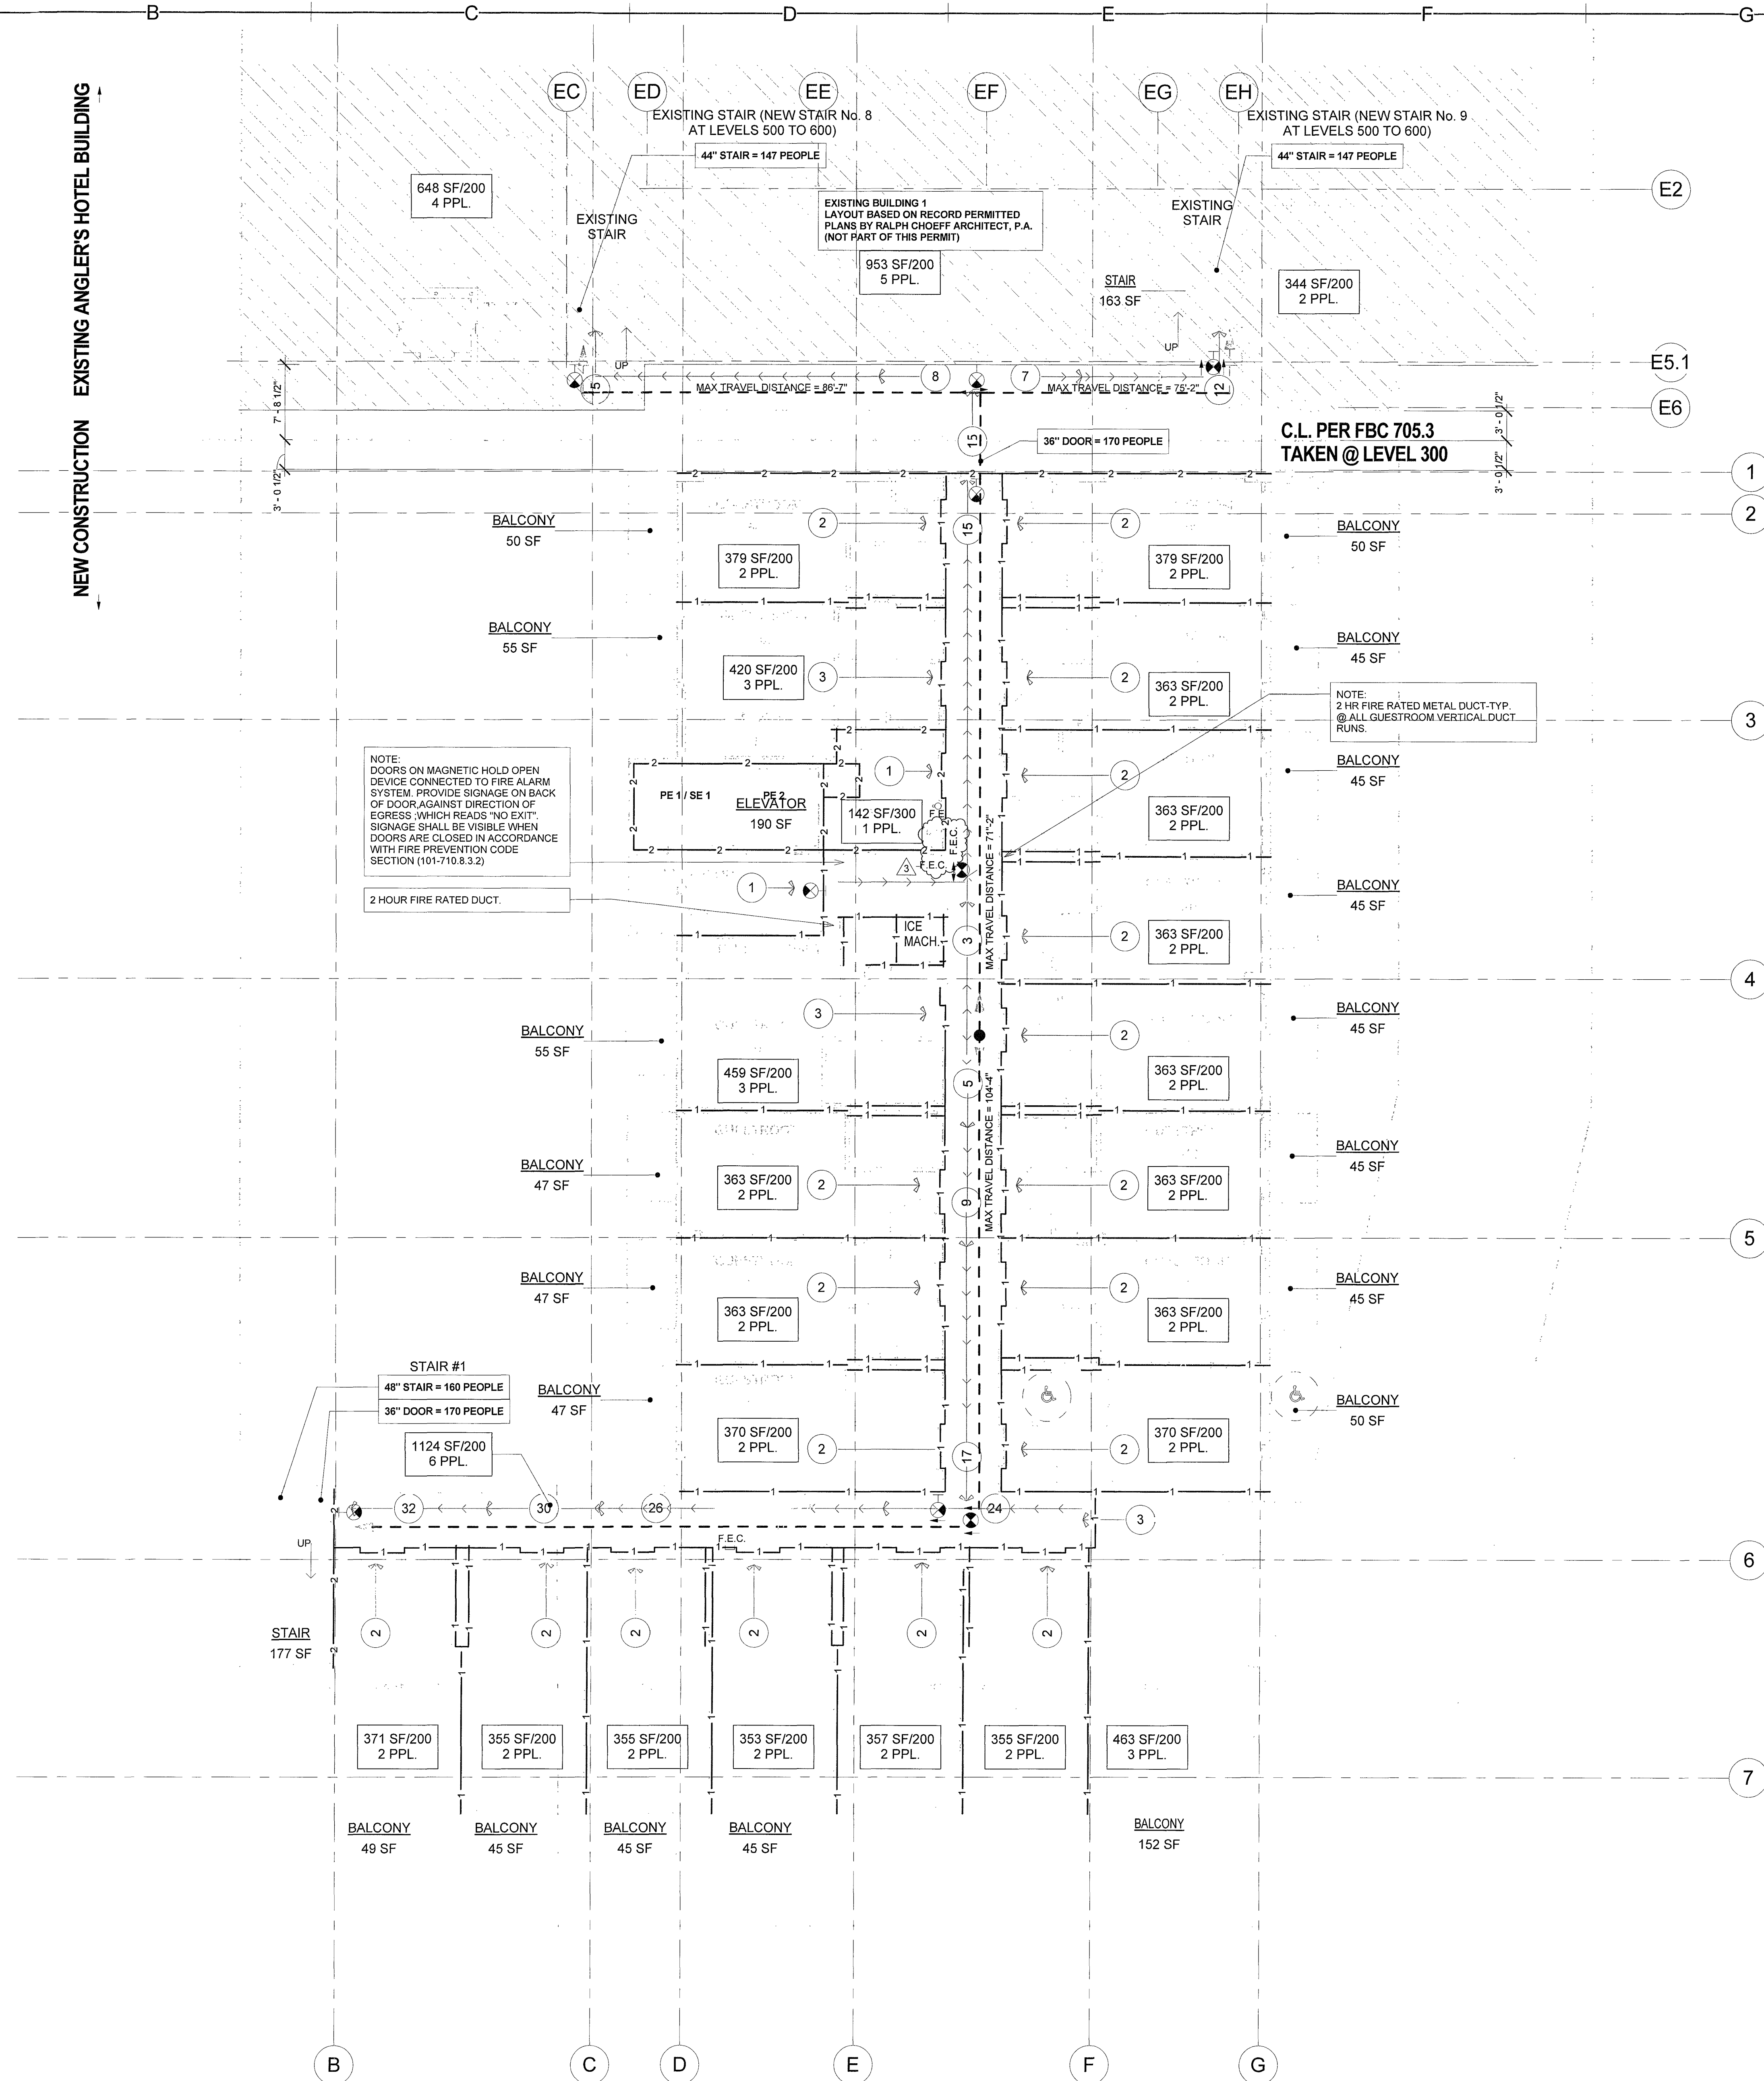

LEVEL 500 LIFE SAFETY PLAN
T.O.S.S. 45'-4" N.G.V.D.

FIRE RATED CONSTRUCTION LEGEND	
	4 HOUR FIRE WALL (EXISTING)
	3 HOUR FIRE WALL (NOT USED)
	2 HOUR FIRE WALL
	2 HOUR FIRE WALL (EXISTING)
	1 HOUR FIRE WALL
	SMOKE BARRIER (NOT USED)
	PATH OF TRAVEL TO EXIT
	MAXIMUM TRAVEL DISTANCE
NOTE: PLANS INDICATE MINIMUM RATING REQUIRED, ACTUAL WALL MAY HAVE A HIGHER RATING.	
EXIT LIGHT LEGEND	
	EXIT LIGHT FIXTURE CEILING MOUNTED, DIRECTION ARROWS AS SHOWN (SHADED QUADRANT INDICATES FACES OF FIXTURES).
	EXIT LIGHT FIXTURE WALL MOUNTED, DIRECTION ARROWS AS SHOWN (SHADED QUADRANT INDICATES FACES OF FIXTURES).



ANGLER'S HOTEL
600 WASHINGTON AVENUE, MIAMI BEACH, FLORIDA 33139
DEVELOPED BY: Angler's Boutique Resort LLC


MAR 25 2015

REVISIONS		
#	Description	Date
1	CMB Bldg Dept Comments	12/16/14
2	CMB Bldg Dept Comments	03/25/15

APPROVED
MAY 11 2015

12064

A2.06

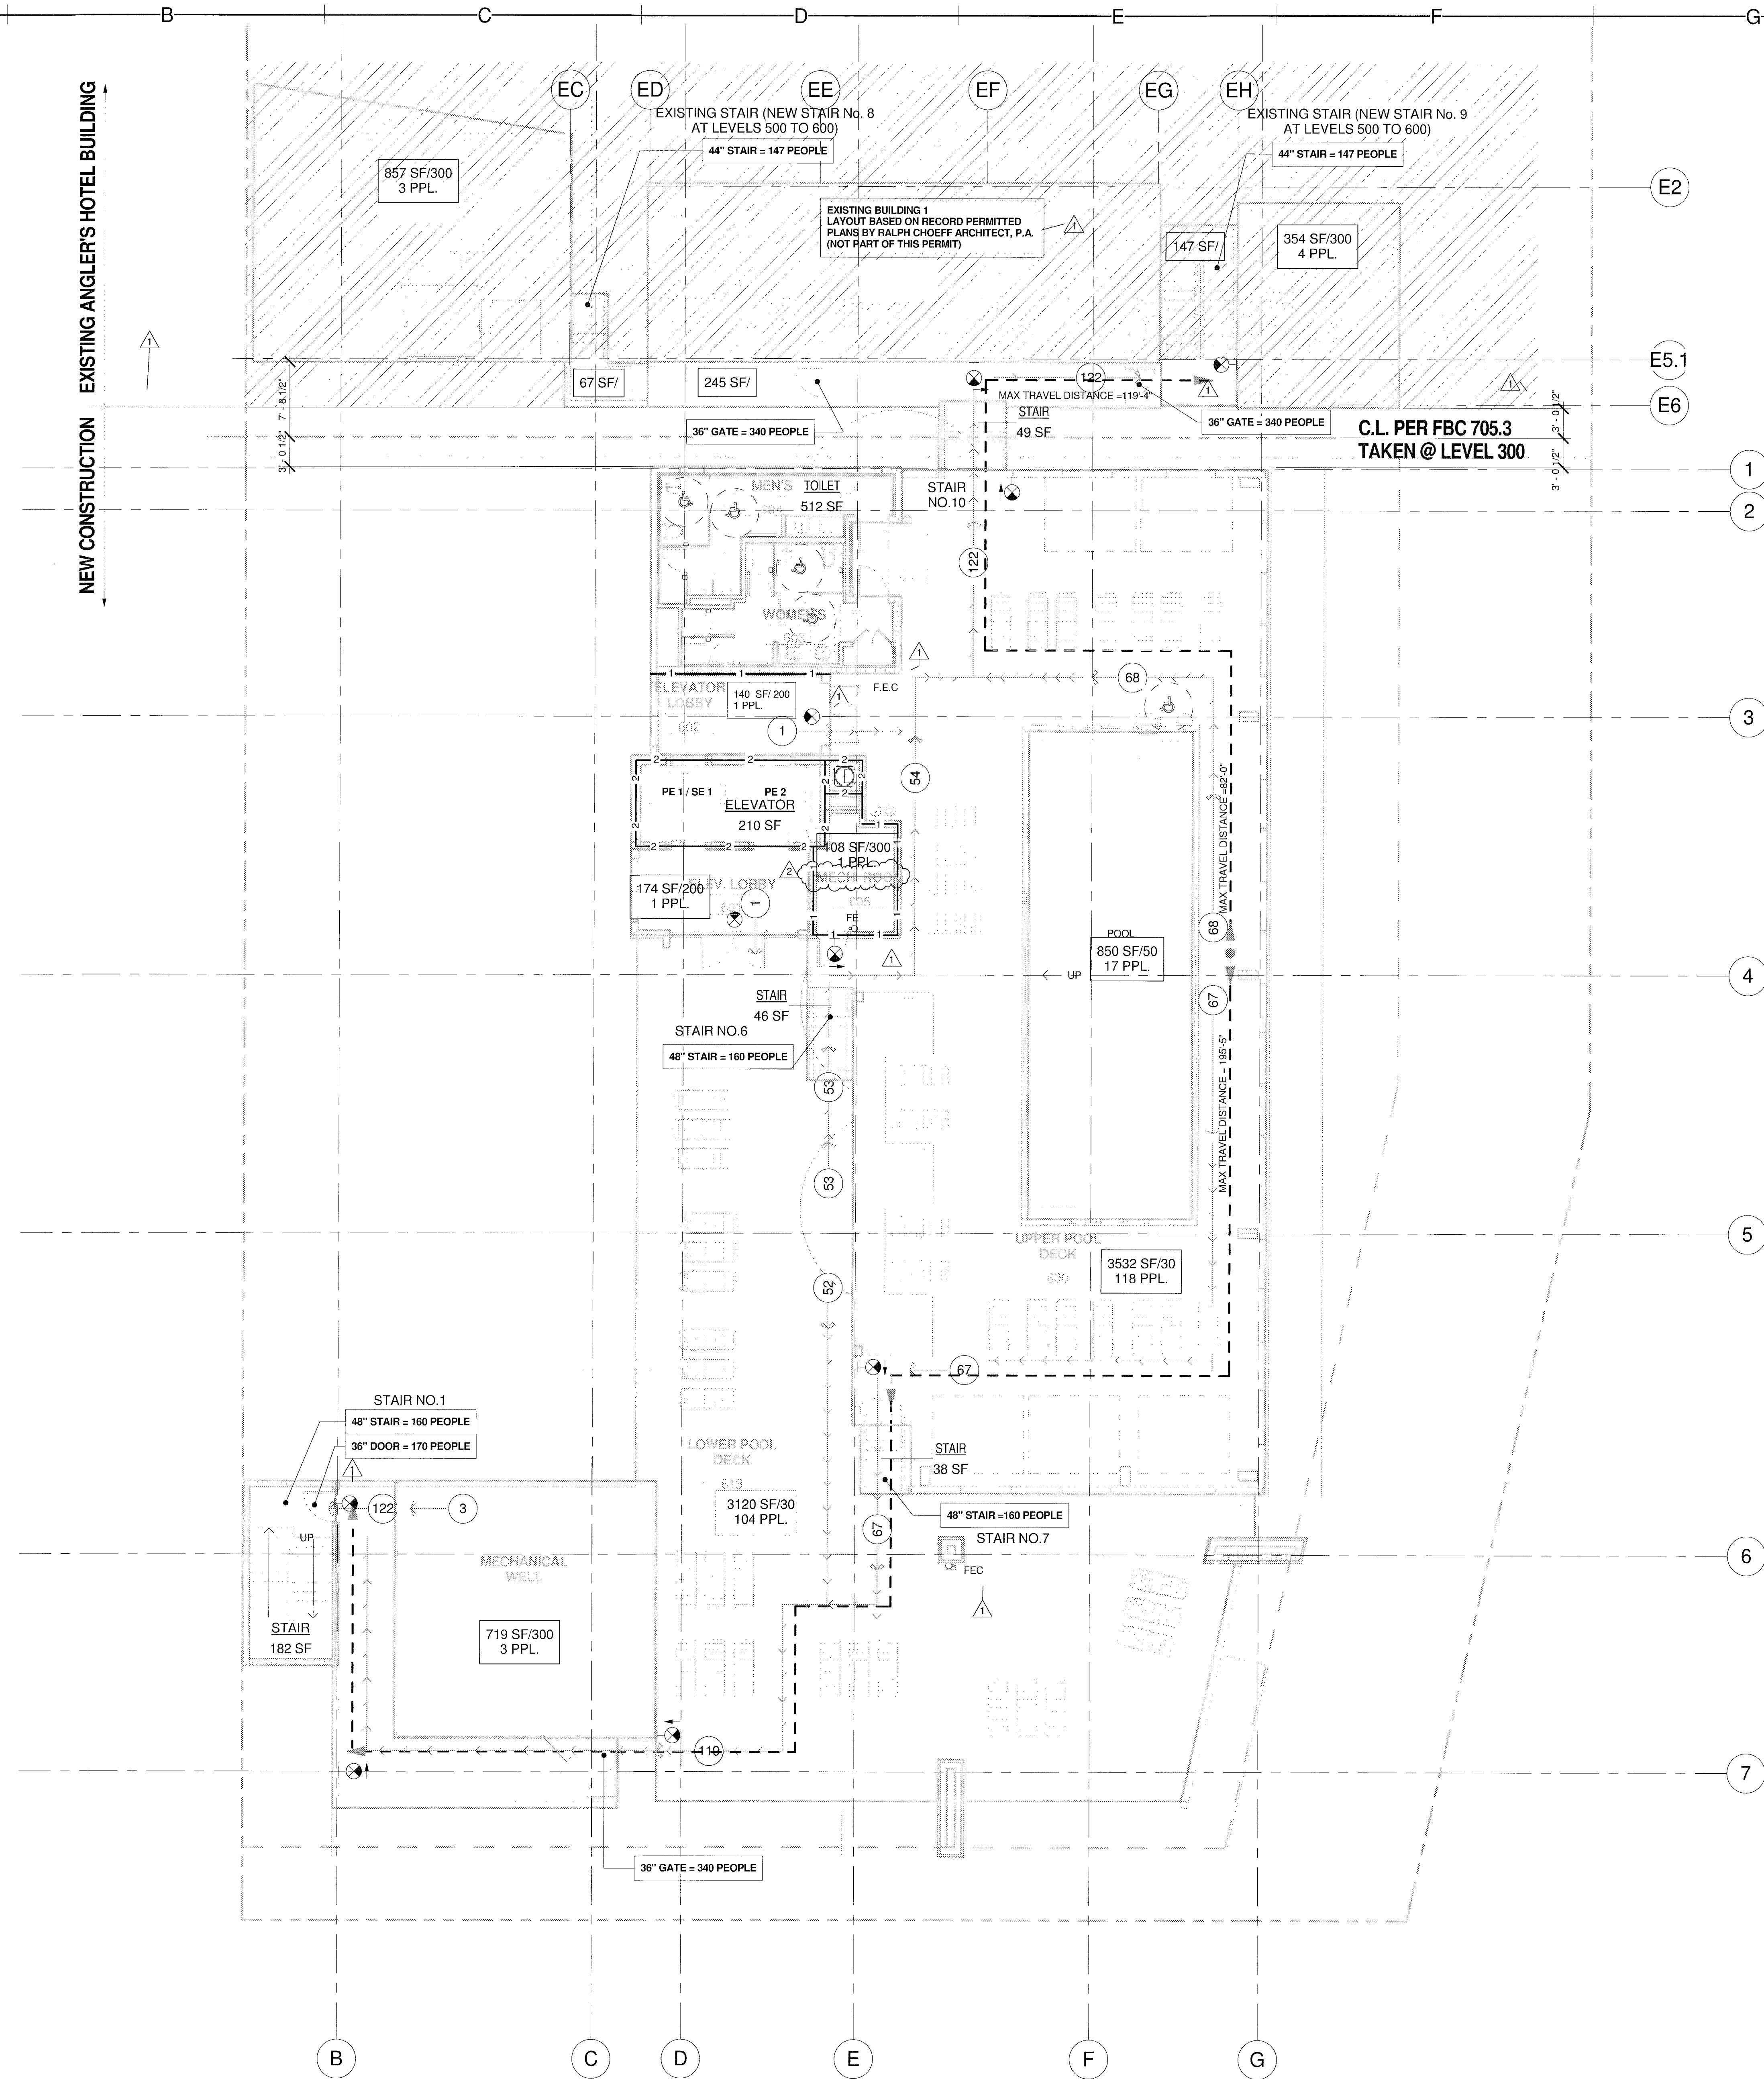

FIRE RATED CONSTRUCTION LEGEND	
	4 HOUR FIRE WALL (EXISTING)
	3 HOUR FIRE WALL (NOT USED)
	2 HOUR FIRE WALL
	2 HOUR FIRE WALL (EXISTING)
	1 HOUR FIRE WALL
	SMOKE BARRIER (NOT USED)
	PATH OF TRAVEL TO EXIT
	MAXIMUM TRAVEL DISTANCE
NOTE: PLANS INDICATE MINIMUM RATING REQUIRED, ACTUAL WALL MAY HAVE A HIGHER RATING.	
EXIT LIGHT LEGEND	
	EXIT LIGHT FIXTURE CEILING MOUNTED, DIRECTION ARROWS AS SHOWN (SHADED QUADRANT INDICATES FACES OF FIXTURES).
	EXIT LIGHT FIXTURE WALL MOUNTED, DIRECTION ARROWS AS SHOWN (SHADED QUADRANT INDICATES FACES OF FIXTURES).

REVISIONS		
#	Description	Date
1	CMB Bldg. Dept. Comments	12/16/14
2	CMB Bldg. Dept. Comments	01/15/15

LOWER / UPPER POOL DECK LIFE SAFETY PLAN
1
A2.07
1/8" = 1'-0"
LOWER POOL DECK T.O.S.S. 56'-6" N.G.V.D.
UPPER POOL DECK T.O.S.S. 59'-6" N.G.V.D.

REVIEWED
CITY OF MIAMI
FIRE DEPARTMENT

EXISTING
2 STORY
BUILDING


EXISTING
POOL

EXISTING
2 STORY
BUILDING

EXISTING
5 STORY
BUILDING

EXISTING 3 STORY BUILDING

NEW CONSTRUCTION
EXISTING ANGLER'S HOTEL BUILDINGS

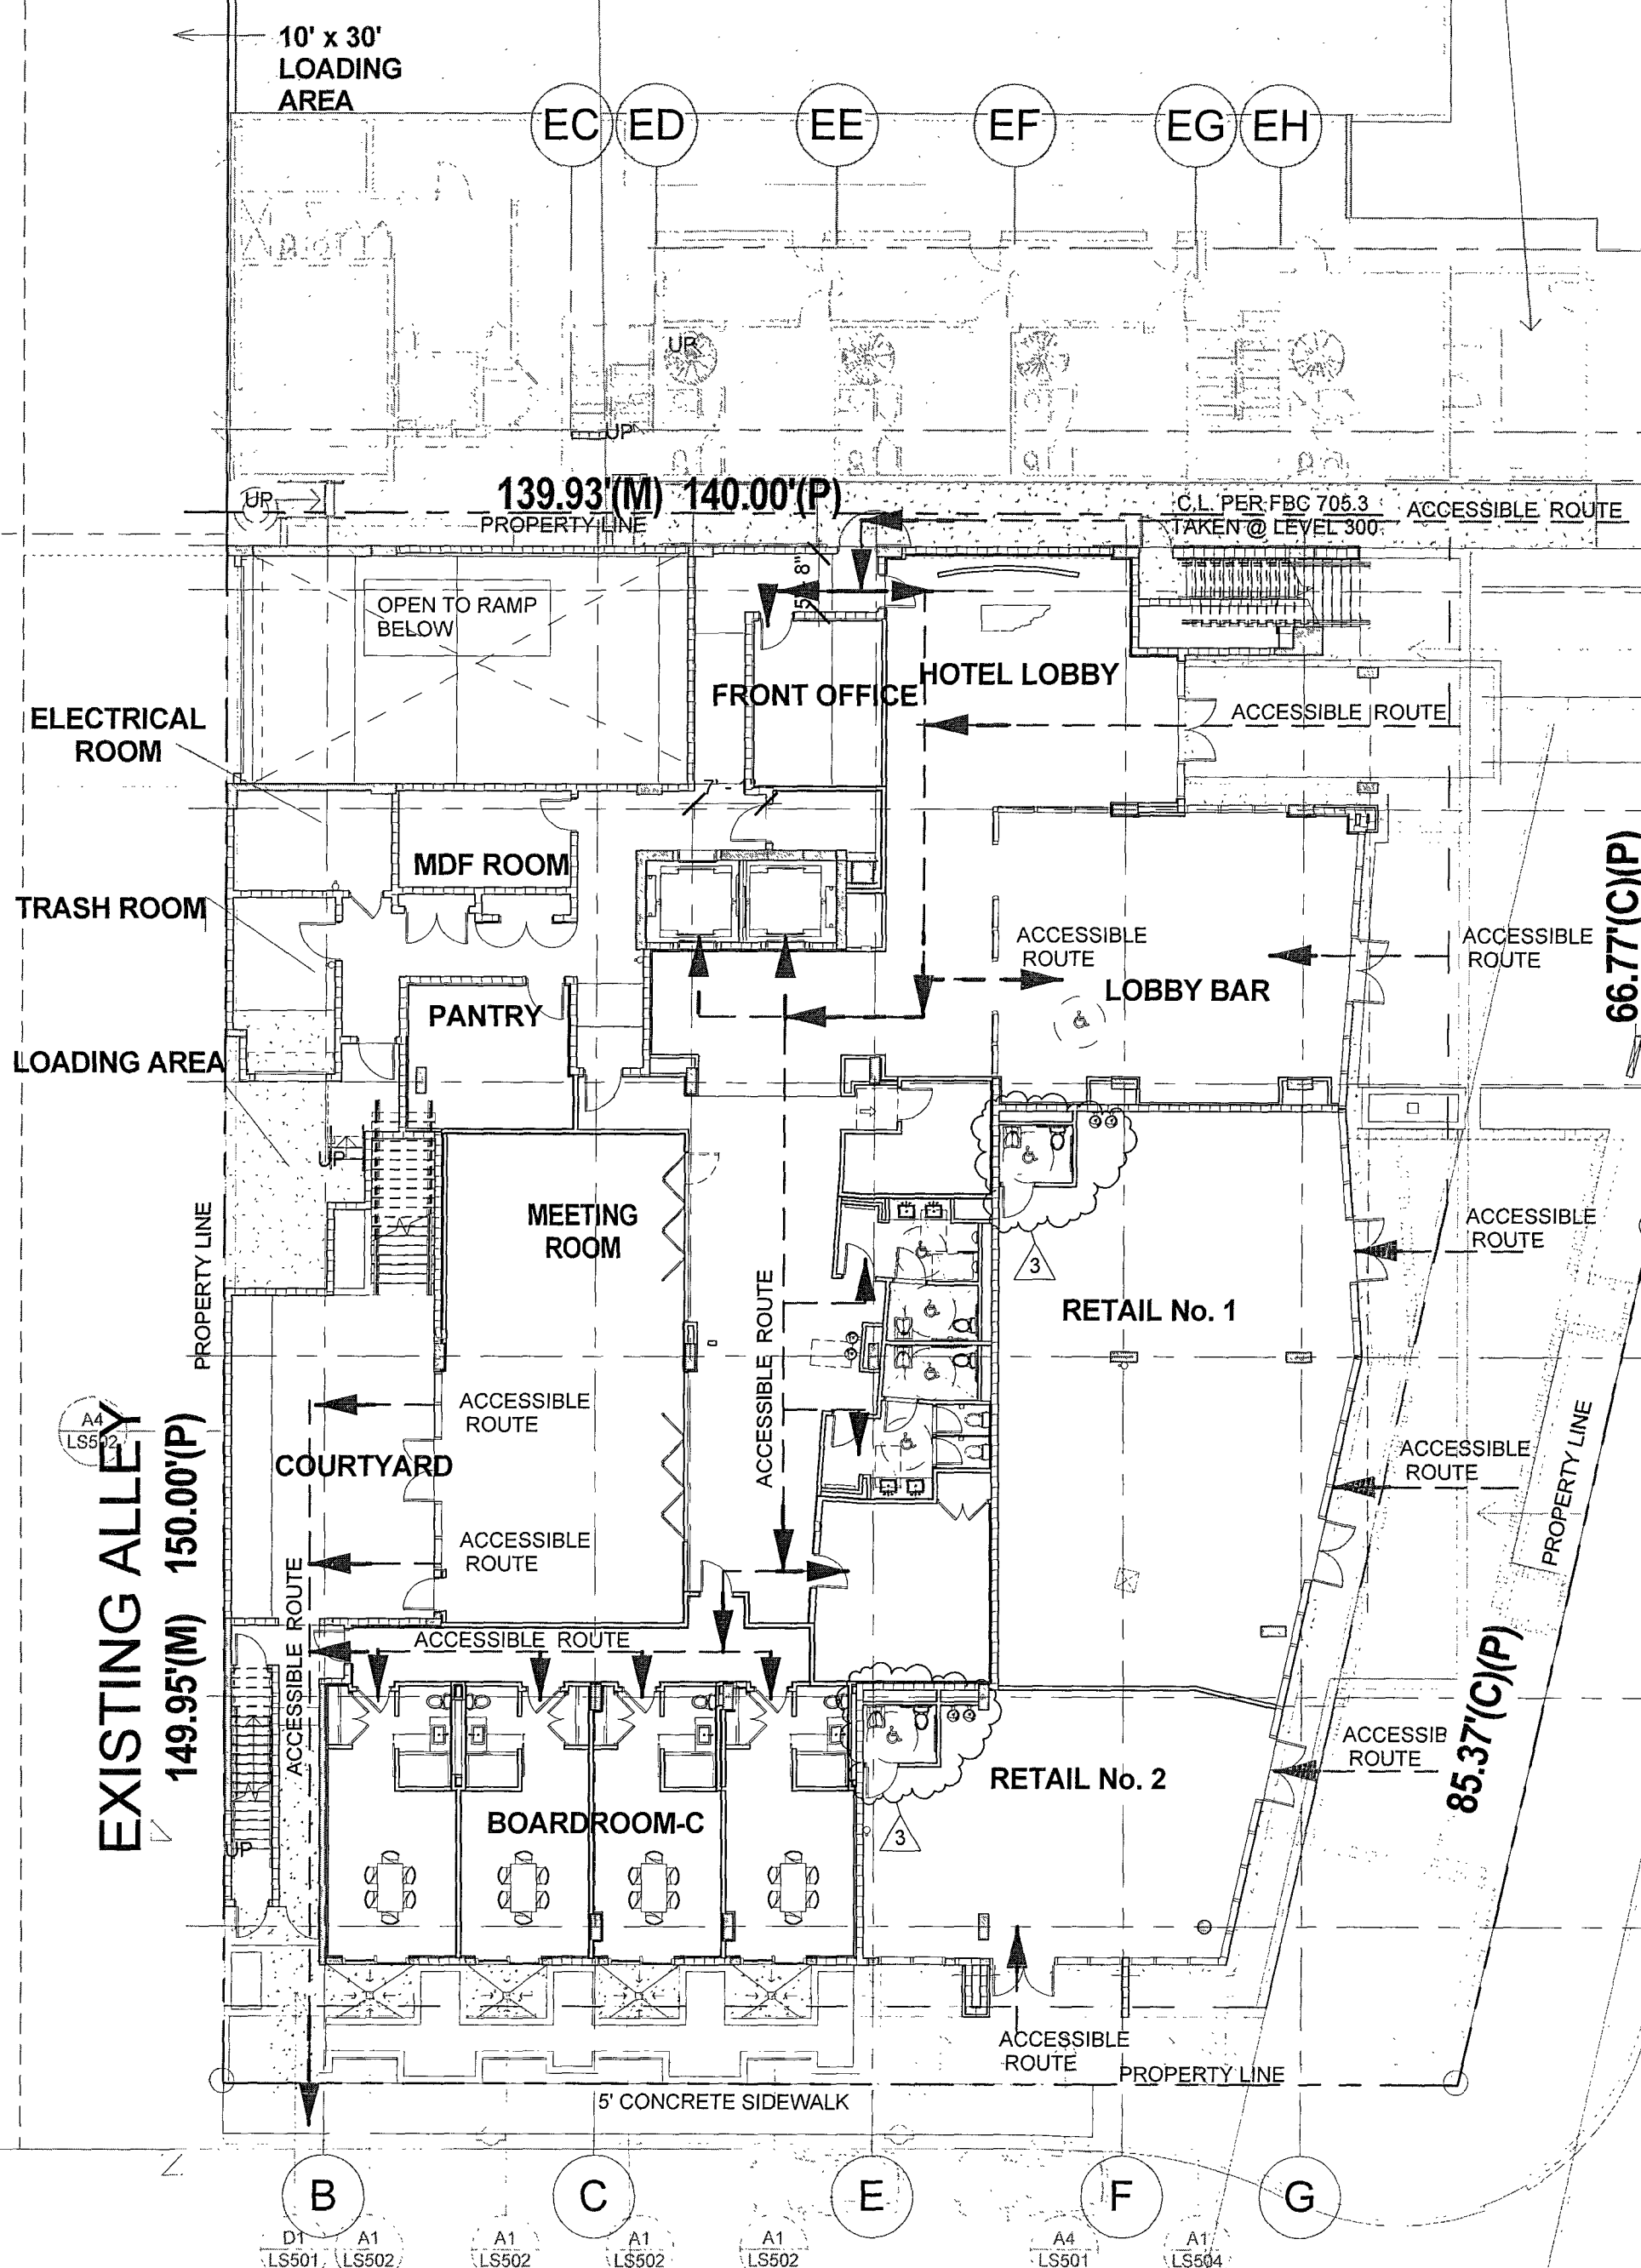

1 OVERALL REFERENCE FLOOR PLAN - LEVEL 100
1/16" = 1'-0"
T.O.S.S. 6'-6" N.G.V.D.

REFERENCE 2010 FBC : PLUMBING TABLE 403.1									
PLUMBING FIXTURES MATRIX									
A-2 OCCUPANCY - LEVEL 100 MEETING ROOM / LOBBY BAR									
188 OCCUPANTS.									
CODE REQUIREMENT		FEMALE		MALE		TOTAL PROVIDED		TOTAL REQUIRED	
FIXTURES		F	M	F	M	F	M	F	M
WC	1/75	1/75		94 / 75	94 / 75	XX	XX	2	1
URINALS	NA	67%							1
LAVATORIES	1/200			188 / 200		XX		1	
DRINKING FOUNTAIN	1/500			188 / 500		XX		1	
SERVICE SINK	1 SINK					XX		1	
B OCCUPANCY - LEVEL 100 ADMINISTRATION / FRONT OFFICE									
7 OCCUPANTS.									
CODE REQUIREMENT		FEMALE		MALE		TOTAL PROVIDED		TOTAL REQUIRED	
FIXTURES		F	M	F	M	F	M	F	M
WC	1/25 & 1/50			4 / 25	3 / 25	XX	XX	1	1
URINALS	NA	50%		0/25	0/25				NA
LAVATORIES	1/40 FIRST 80 1/80 REMAINDER			7 / 40		XX		2	
DRINKING FOUNTAIN	1/100			7 / 100		XX		1	
SERVICE SINK	NA					NA		NA	

POTTY PARITY FOR ASSEMBLY OCCUPANCY
3/2 water closets provided for women as the combined total of water closets and urinals provided for men
2 COMBINED WATER CLOSET AND URINALS
3 WOMEN'S WATER CLOSETS REQUIRED

LEVEL 300 FIXTURE SUMMARY
WOMEN'S W.C. = 3
MEN'S W.C. = 1
MEN'S URINAL = 2
LAVATORIES = 4
DRINK FOUNTAIN = 2
SERVICE SINK = 1

REFERENCE 2010 FBC : PLUMBING TABLE 403.1									
PLUMBING FIXTURES MATRIX									
A-5 OCCUPANCY - LOWER AND UPPER POOL DECK									
222 OCCUPANTS.									
CODE REQUIREMENT		FEMALE		MALE		TOTAL PROVIDED		TOTAL REQUIRED	
FIXTURES		F	M	F	M	F	M	F	M
WC	1/40	1/75		111/40	111/75	XX	XX	3	1
URINALS	NA	67%							1
LAVATORIES	1/150	1/200		111 / 150	111 / 200	XX		1	1
DRINKING FOUNTAIN	1/1000			222 / 1000		XX		1	
SERVICE SINK	1 SINK					XX			

POOL LOWER AND UPPER POOL
DECK FIXTURE SUMMARY
WOMEN'S W.C. = 4
MEN'S W.C. = 2
MEN'S URINAL = 2
LAVATORIES = 4
DRINK FOUNTAIN = 2
SERVICE SINK = 1


REFERENCE 2010 FBC: TABLE 424.1.6.1									
PUBLIC SWIMMING POOL REQUIRED FIXTURE COUNT									
880 S.F. POOL SURFACE AREA									
MEN'S RESTROOM		WOMEN'S RESTROOM		TOTAL PROVIDED		TOTAL REQUIRED			
URINALS		WC		WC		WC	LV	WC	LV
0 - 2,500 sq. ft.	1	1	1	1	1	1	1	1	1
2,501 - 5,000 sq. ft.	2	1	1	5	1				
5,001 - 7,500 sq. ft.	2	2	2	6	2				
7,501 - 10,000 sq. ft.	3	2	3	8	3				

REFERENCE 2010 FBC : PLUMBING TABLE 403.1									
PLUMBING FIXTURES MATRIX- RETAIL NO.1									
MERCANTILE (M) OCCUPANCY - RETAIL NO.1- LEVEL 100									
64 OCCUPANTS.									
CODE REQUIREMENT		FEMALE / MALE		TOTAL PROVIDED		TOTAL REQUIRED			
FIXTURES		FEMALE / MALE		FEMALE / MALE		FEMALE / MALE			
WC	1/500			64/500	1			1	
URINALS	NA			N/A				N/A	
LAVATORIES	1/750			64/750	1			1	
DRINKING FOUNTAIN	1/1000			64/1000	1			1	
SERVICE SINK	N/A			N/A				N/A	

REFERENCE 2010 FBC : PLUMBING TABLE 403.1									
PLUMBING FIXTURES MATRIX- RETAIL NO.2									
MERCANTILE (M) OCCUPANCY - RETAIL NO.2 - LEVEL 100									
64 OCCUPANTS.									
CODE REQUIREMENT		FEMALE / MALE		TOTAL PROVIDED		TOTAL REQUIRED			
FIXTURES		FEMALE / MALE		FEMALE / MALE		FEMALE / MALE			
WC	1/500			35/500	1			1	
URINALS	NA			N/A				N/A	
LAVATORIES	1/750			35/750	1			1	
DRINKING FOUNTAIN	1/1000			35/1000	1			1	
SERVICE SINK	N/A			N/A				N/A	

PLUMBING FIXTURE CALCULATIONS

2 A3.00 1/16" = 1'-0"

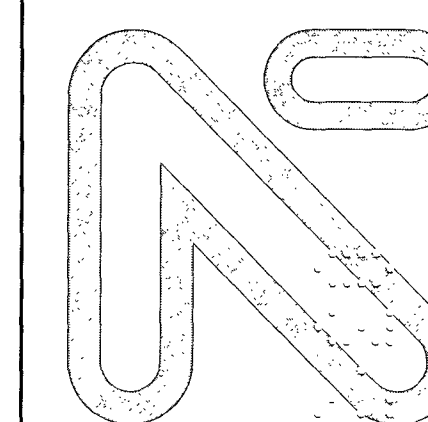

NICHOLS
BROSCH
WURSTHOF
& ASSOCIATES, INC.
Architecture & Planning

1111 Avenue of the Americas
New York, NY 10020
212-684-3300
AEC 000880

ANGLER'S HOTEL

600 WASHINGTON AVENUE, MIAMI BEACH, FLORIDA 33139

DEVELOPED BY: Angler's Boutique Resort LLC

MAR 25 2015

[Signature]

Permit Issue
10-13-14


REVISIONS

#	Description	Date
1	CMB Bldg. Dept. Comments	12/16/14
3	CMB Bldg. Dept. Comments	03/25/15

12064

A3.00

C:\Users\jcardozo\Documents\12064-ANGLER'S HOTEL-new_jcardozo.rvt
4/23/2015 10:43:32 AM

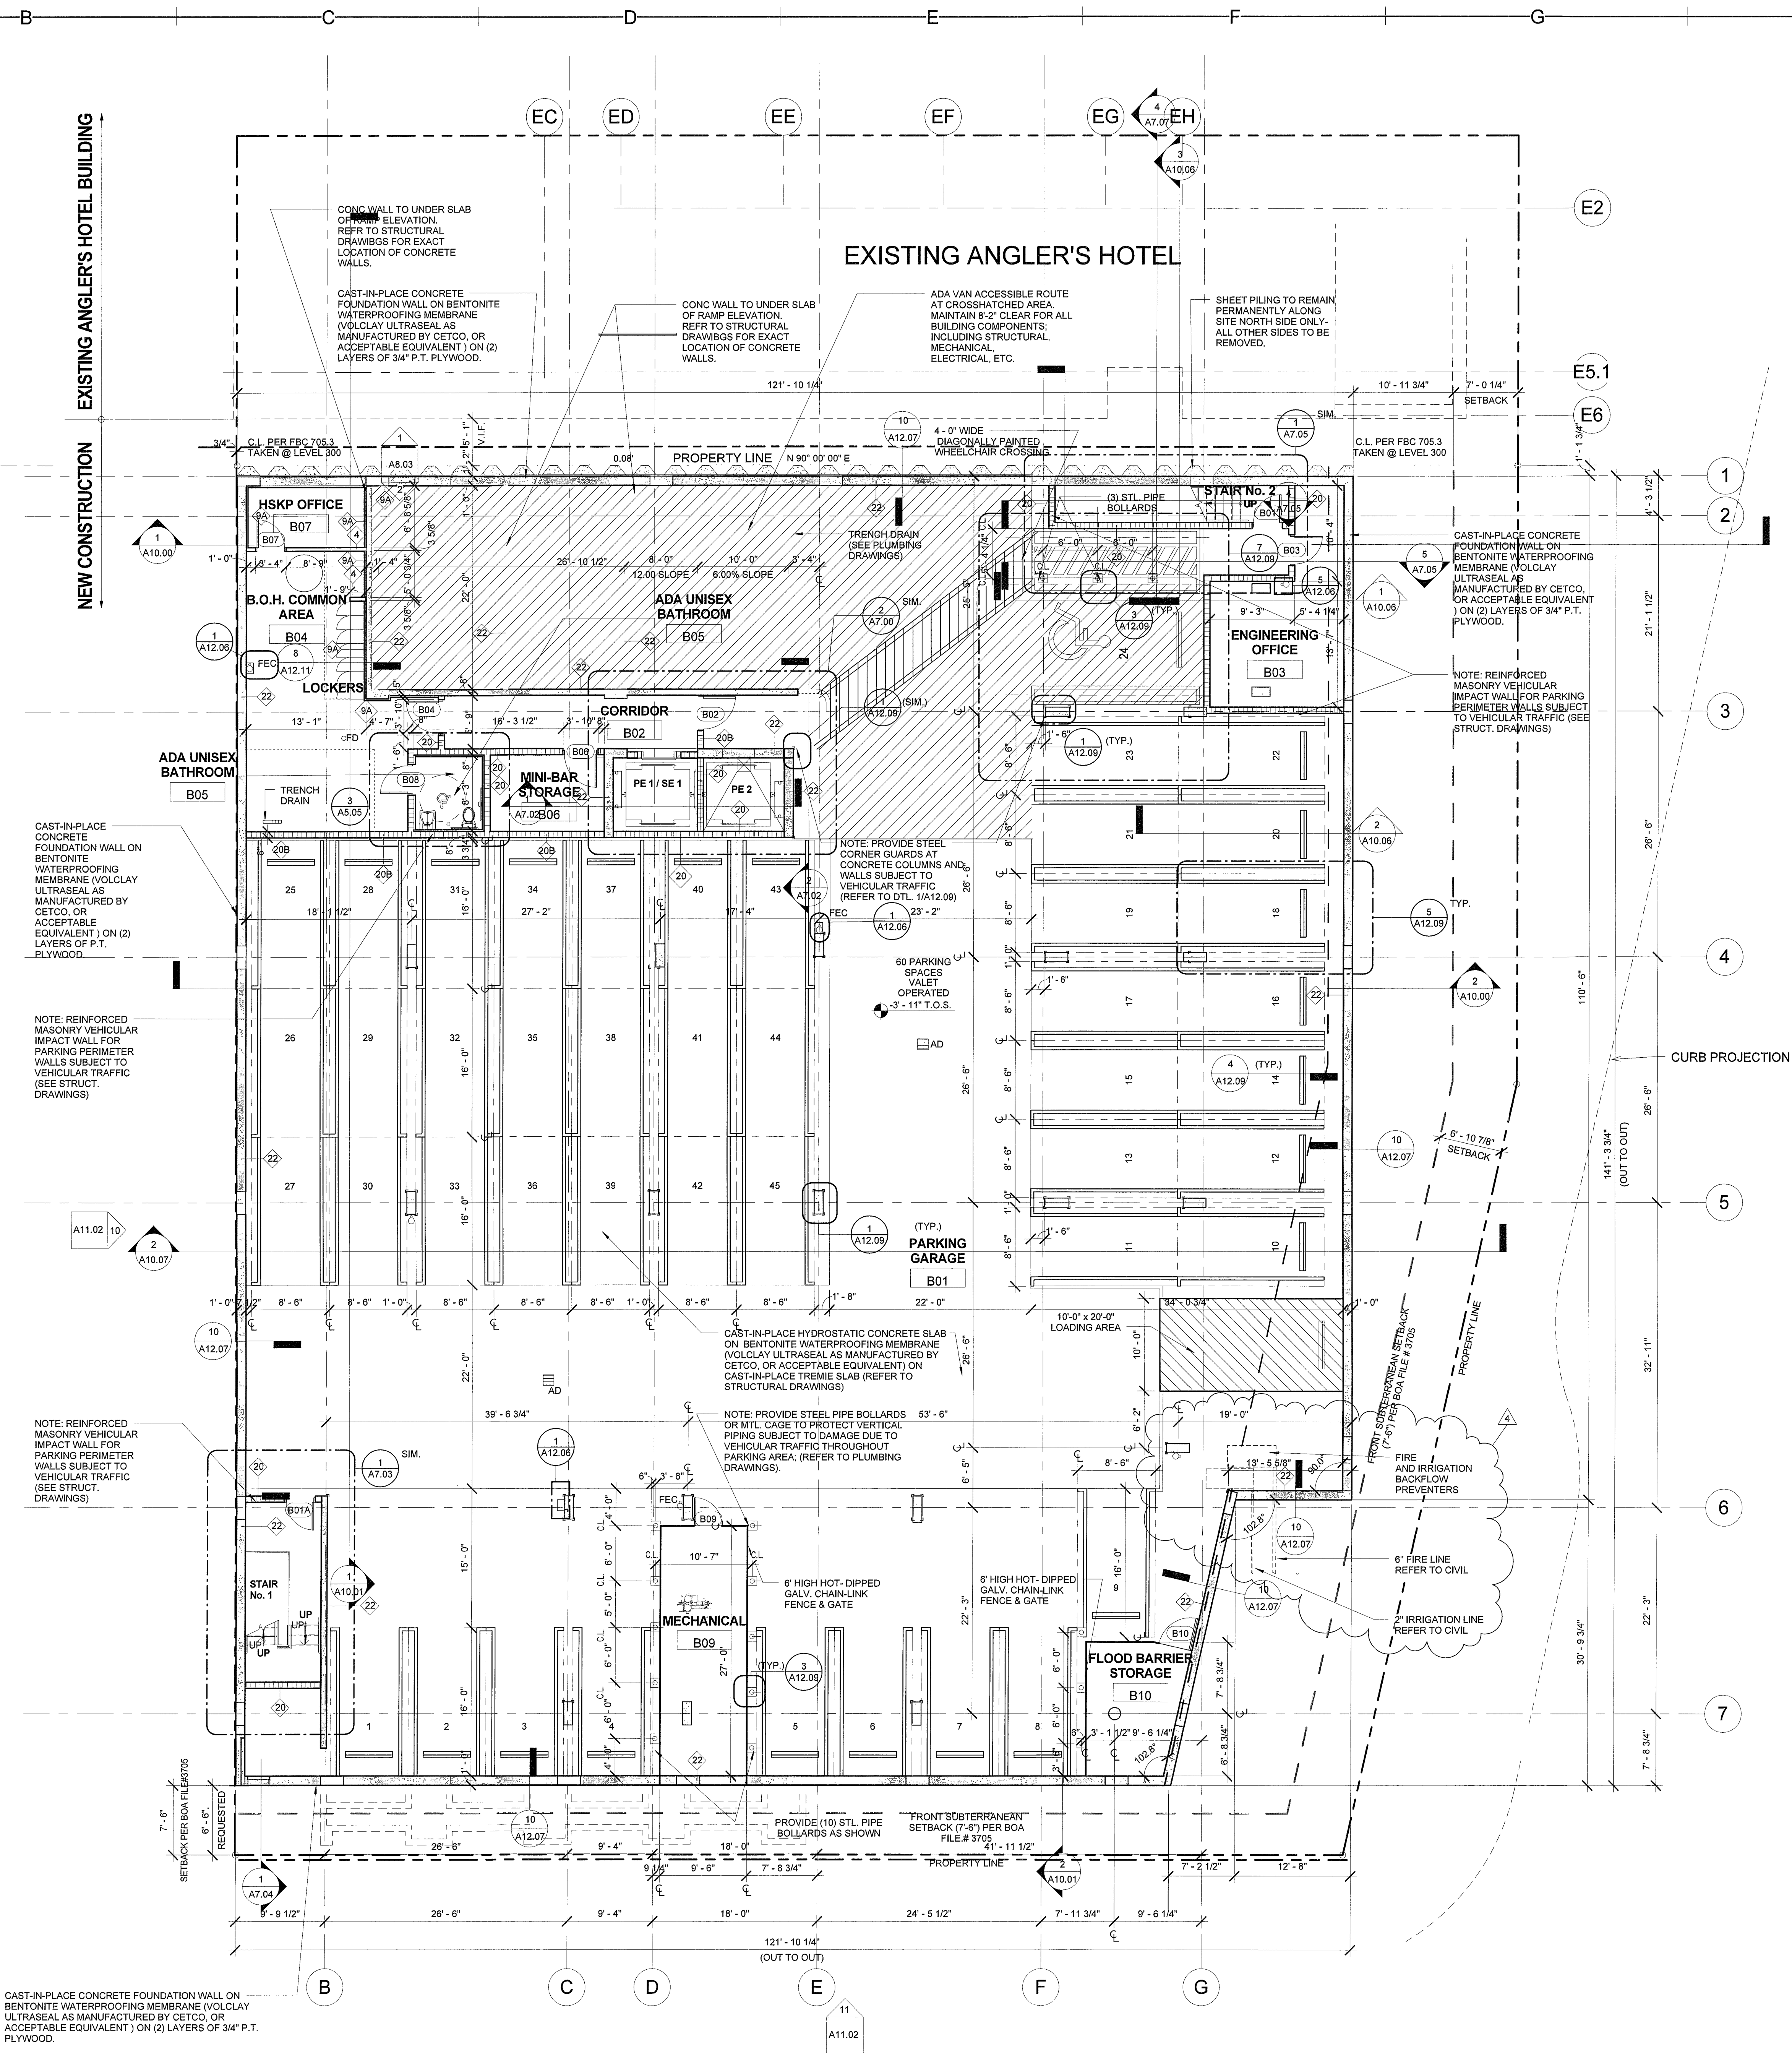

BASEMENT LEVEL (PARKING GARAGE) FLOOR PLAN
1/8" = 1'-0"
T.O.S.S. -3'-11" N.G.V.D.

- GENERAL NOTES**
- ALL DIMENSIONS TO STUD OR FURRING FACE.
 - PARTITION FRAMING TO BE 20 GA. 3-5/8" METAL STUDS (MIN.) AT 16" O.C. AT ALL HUNG ITEMS AND WALLS TO RECEIVE TILE.
 - CONTRACTOR TO COORDINATE SHEETS WITH MECHANICAL, PLUMBING, AND ELECTRICAL CONTRACTORS.
 - ALL SLOPES TO DRAINS SHALL BE 1/8" FT. (MIN.); 2% MAX. AT ALL AREAS OTHER THAN SHOWERS.
 - REFER TO INTERIOR DESIGN DRAWINGS FOR PUBLIC REFLECTED CEILING PLANS, FURNITURE LAYOUTS, MILLWORK DETAILS, HARDWARE-FIXTURE SELECTIONS & FINISHES.
 - REFER TO SHEETS A12.00 THRU A12.02 FOR ALL WALL TYPES.
 - REFER TO SHEETS ON SERIES A1400 FOR ALL DOOR, AND FOR WINDOW ELEVATIONS IN A11.00 SERIES.
 - ALL ACCESSIBLE / EGRESS INTERIOR DOORS TO PROVIDE 32" CLEAR AS PER DOOR SCHEDULES ON SERIES A1400 & 404.2.3 (2012 FBC ACCESSIBILITY CODE).
 - USE 5/8" GLASS MAT GYPSUM WALLBOARD AT ALL WALLS TO RECEIVE TILE.
 - REFER TO MECHANICAL PLANS FOR EXTERIOR VENTS & SIZES.
 - PROVIDE SOUND ATTENUATION AT RAIN WATER LEADER LOCATIONS.
 - ALL GLAZING BELOW 42" AFF SHALL BE SAFETY GLAZING COMPLYING WITH ANSI Z97.1 & FBC(2010) 1618.4.6.3
 - CONTRACTOR TO FIELD VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS PRIOR TO COMMENCE WORK.
 - ALL EXISTING DIMENSIONS ARE FOR REFERENCE ONLY CONTRACTOR TO FIELD VERIFY EVERY AFFECTED CONDITION PRIOR TO COMMENCE WORK
 - CONTRACTOR TO SUBMIT SHOP DRAWINGS AND SAMPLES TO THE ARCHITECT OF ALL ITEMS TO BE REPLACED SUCH AS WINDOWS.

**NICHOLS
BROSCH
WURST
WOLFE**
& ASSOCIATES, INC.
Architecture & Planning
161 Arnette Avenue
Coral Gables, FL 33134
(305) 446-2072
FAC 050507


ANGLER'S HOTEL
600 WASHINGTON AVENUE, MIAMI BEACH, FLORIDA 33139
DEVELOPED BY: Angler's Boutique Resort LLC

APR 23 2015
[Signature]

REVISIONS		
#	Description	Date
1	CMB Bldg. Dept. Comments	12/16/14
2	CMB Bldg. Dept. Comments	01/15/15
3	CMB Bldg. Dept. Comments	03/25/15
4	CMB Bldg. Dept. Comments	04/14/2015

12064
A4.00

C:\Users\skris\Documents\12064 - ANGLERS HOTEL - skris.mt
1/30/2015 4:16:46 PM

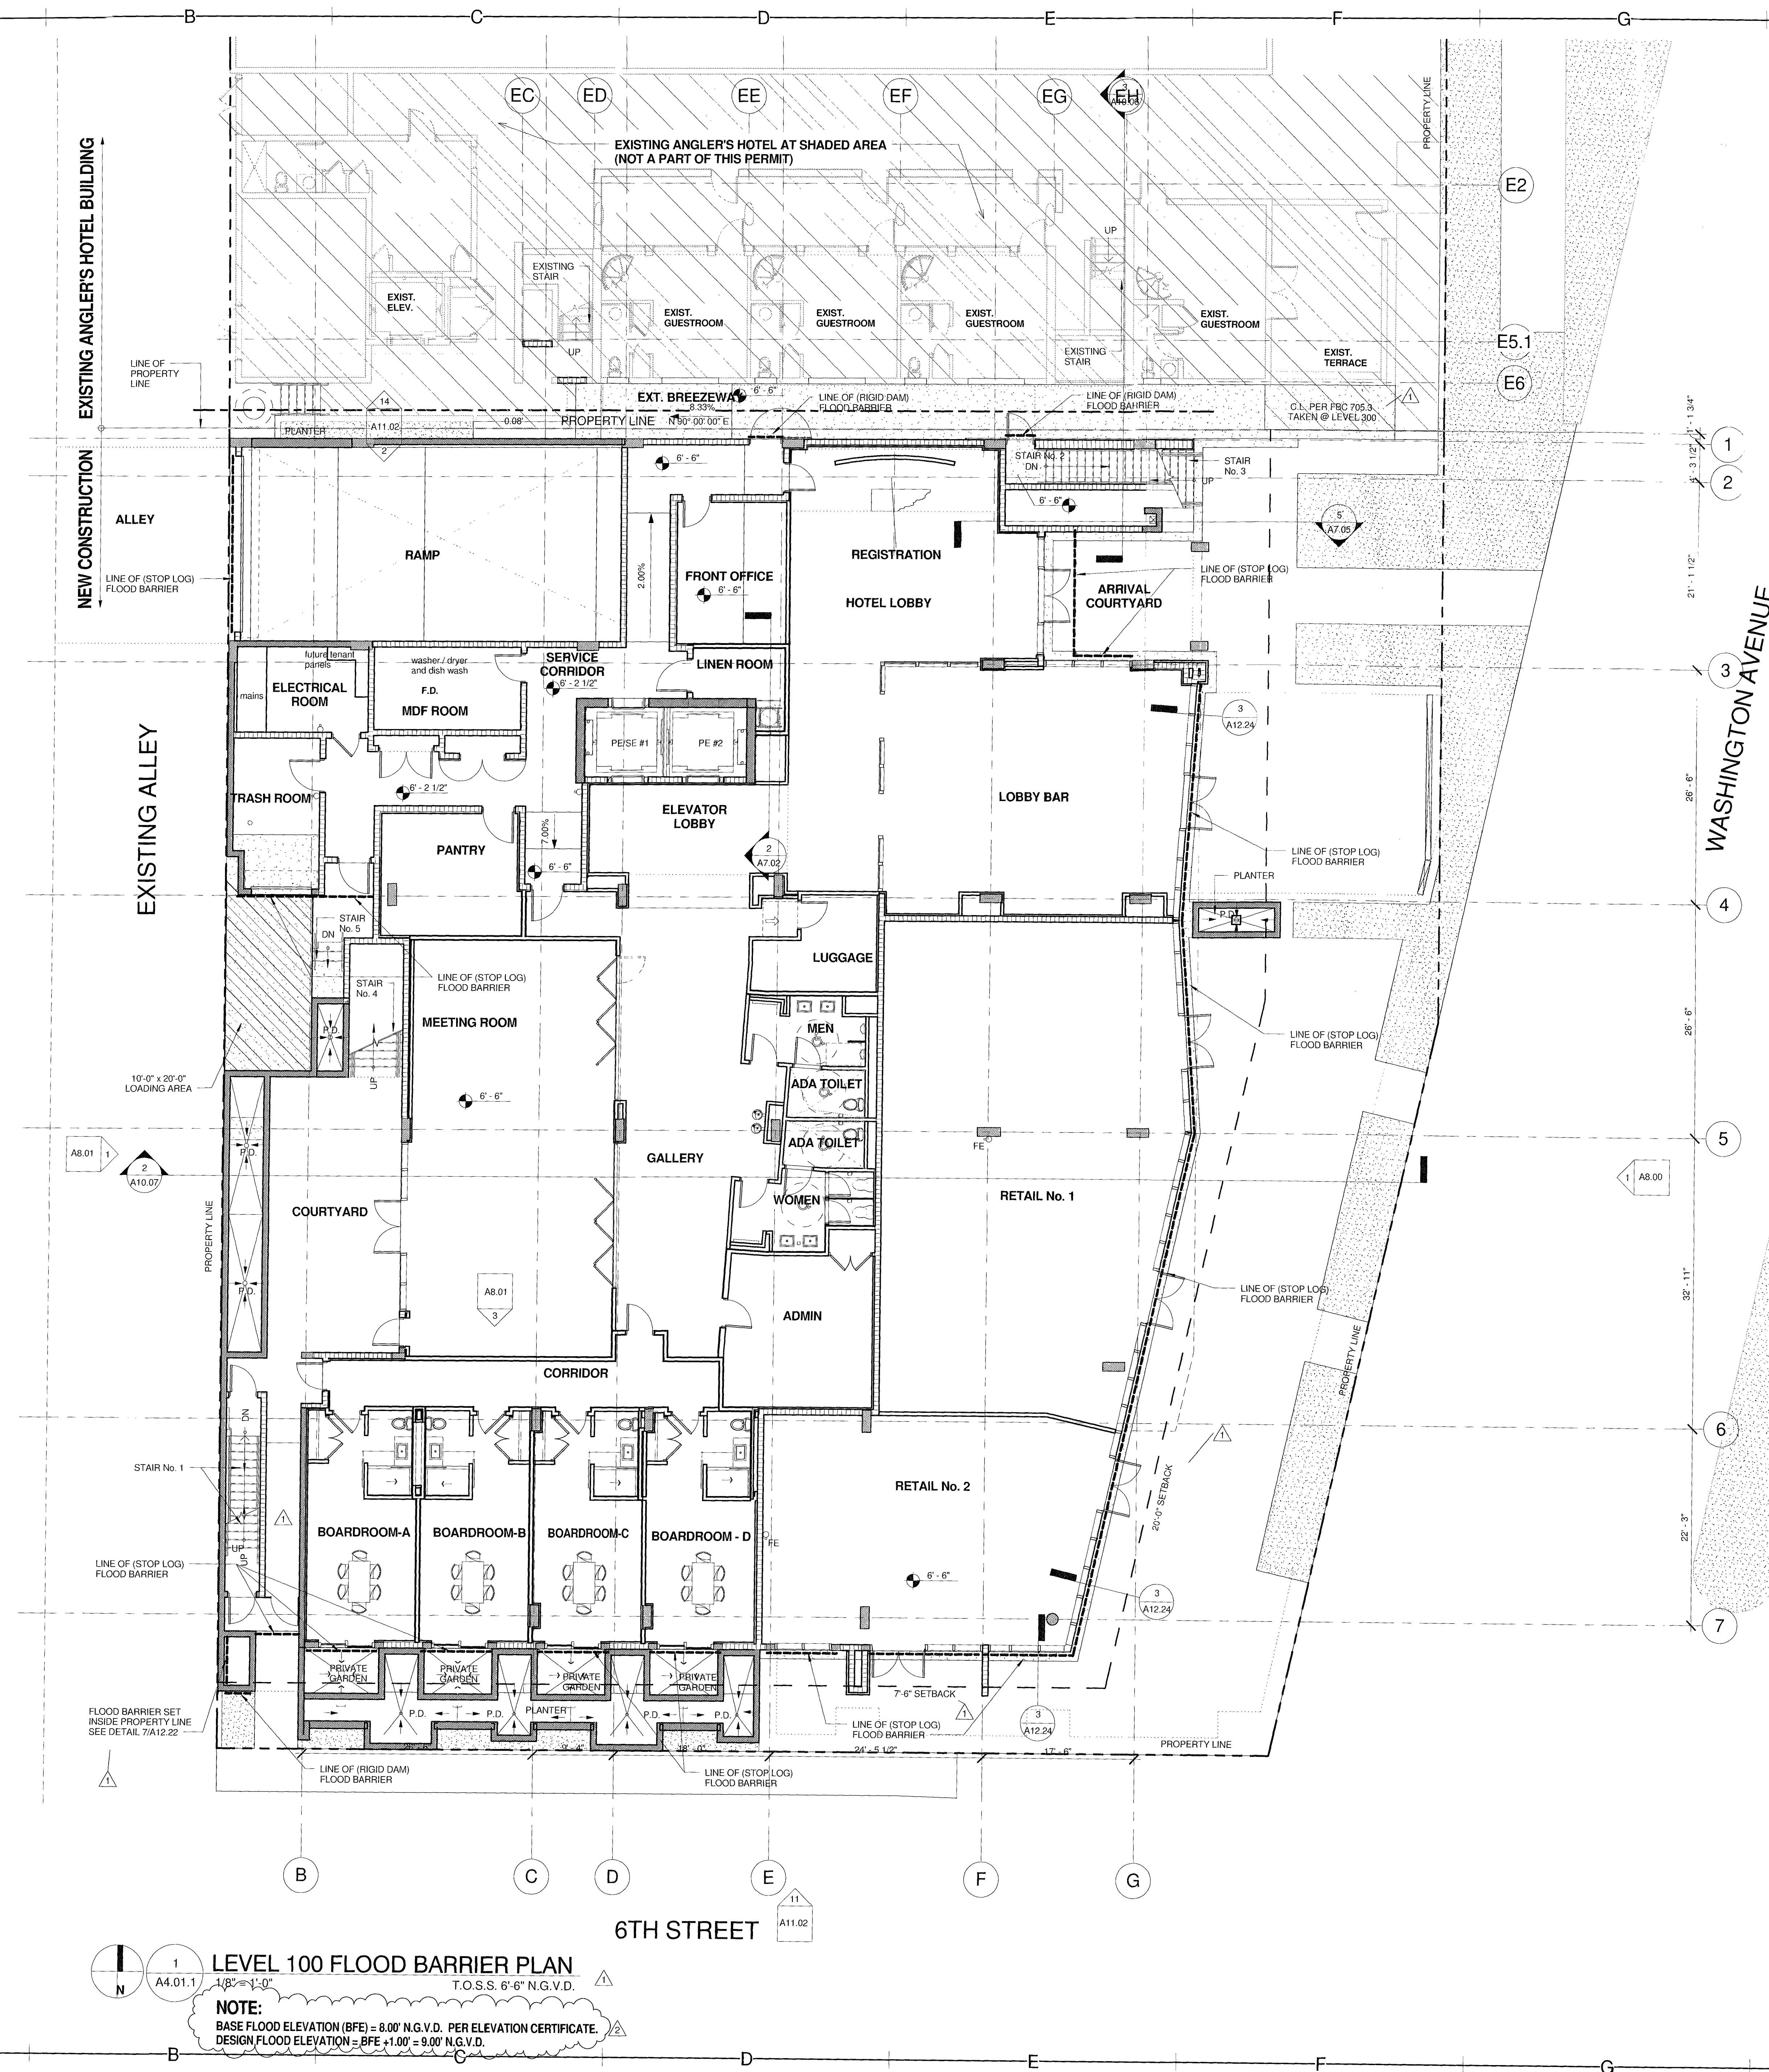


FLOOD BARRIER NOTES:

- FLOOD BARRIER:**
1. INDICATES ALL HABITABLE AREAS BELOW 9'-0" N.G.V.D. TO BE PROTECTED WITH APPROVED FLOOD BARRIER SYSTEM. DESIGNED WATERTIGHT WITH WALLS SUBSTANTIALLY IMPERMEABLE TO THE PASSAGE OF WATER AND WITH STRUCTURAL COMPONENTS HAVING THE CAPACITY OF RESISTING HYDROSTATIC AND HYDRODYNAMIC LOADS AND EFFECTS OF BUOYANCY. FLOOD BARRIER SYSTEM:
A. STOP LOG FLOOD BARRIER SYSTEM - PROVIDE 24" WIDE CONCRETE STRIP BELOW WITH REQUIRED TOLERANCE OF 1/16" OVER 30'-0" FOR PROPER SEALING OF FLOOD BARRIER SYSTEM, TYPICAL.
B. RIGID DAM FLOOD BARRIER SYSTEM - PROVIDE 24" WIDE CONCRETE WIDE STRIP BELOW WITH REQUIRED TOLERANCE OF 1/16" OVER 30'-0" FOR PROPER SEALING OF FLOOD BARRIER SYSTEM, TYPICAL.
C. SUBMIT SIGNED AND SEALED SHOP DRAWINGS BY AN ENGINEER LICENSED IN THE STATE OF FLORIDA FOR ALL FLOOD BARRIER SYSTEMS.

2. ALL HABITABLE AREAS BELOW 9'-0" N.G.V.D. TO BE PROTECTED WITH CAST-IN-PLACED CONCRETE STEM WALL DESIGNED WATERTIGHT WITH CRYSTALLINE WATERPROOFING BY XYPEX CHEMICAL CORP. OR ACCEPTABLE EQUIVALENT ON OUTSIDE FACE OF CONCRETE WALLS. ALL WALLS TO BE SUBSTANTIALLY IMPERMEABLE TO THE PASSAGE OF WATER AND WITH STRUCTURAL COMPONENTS HAVING THE CAPACITY OF RESISTING HYDROSTATIC AND HYDRODYNAMIC LOADS AND EFFECTS OF BUOYANCY. (REFER TO STRUCTURAL DRAWINGS).
3. ALL EQUIPMENT PROVIDED FOR LIFE SAFETY SHALL BE MOUNTED ABOVE 9'-0" N.G.V.D.
4. A SEPARATE BUILDING PERMIT SHALL BE OBTAINED PRIOR TO INSTALLATION OF FLOOD BARRIERS.
5. THE PROPOSED STRUCTURE IS DESIGNED AND SHALL BE CONSTRUCTED IN ACCORDANCE WITH SECTION 1612 AND ASCE 24-05.
6. ALL ELECTRICAL MECHANICAL AND PLUMBING EQUIPMENT AND UTILITIES OUTSIDE OF DRY FLOOD PROOFING AREAS SHALL BE ELEVATED AT OR ABOVE BFE +1, + 9.0' FT. NGVD.

FLOOD PROOFING DATA:

1. FIRM MAP NUMBER: 120686C0319L
2. MAP EFFECTIVE DATE: SEPTEMBER 11, 2009
3. FLOOD ZONE-AE BASE FLOOD ELEVATION = 8.0 FT. NGVD.
4. MINIMUM REQUIRED FLOOD DESIGN ELEVATION: BFE+1 FT. = 9'-0" NGVD.
5. ELEVATION DATA:
A. THE LOWEST FLOOR ELEVATION INCLUDING BASEMENT: 3'-11" NGVD.
B. NEXT HIGHER FLOOR ELEVATION: 6'-0" NGVD.
C. DRY FLOOD PROOFING DESIGN ELEVATION: 9'-0" NGVD.
D. THE LOWEST ADJACENT GRADE ELEVATION NEXT TO THE PROPOSED STRUCTURE: FT. 4'-9" NGVD.
E. HEIGHT OF THE FLOOD PROOFING ON THE BUILDING ABOVE THE LOWEST ADJACENT GRADE: 2'-9" NGVD. (4'-9" - 2'-0") = 2'-9"
F. CROWN OF THE ROAD ELEVATION: 16'-8" NGVD.
G. SIDEWALK NEXT TO THE PROPOSED STRUCTURE ELEVATION: 16'-2" NGVD.
H. GRADE ELEVATION @ CENTER OF PROPERTY LINE = 6'-2 1/2"
6. CLASSIFICATION OF STRUCTURES FOR FLOOD - RESISTANT DESIGN AND CONSTRUCTION PER ASCE 24-05 TABLE 1-1-CATEGORY II.

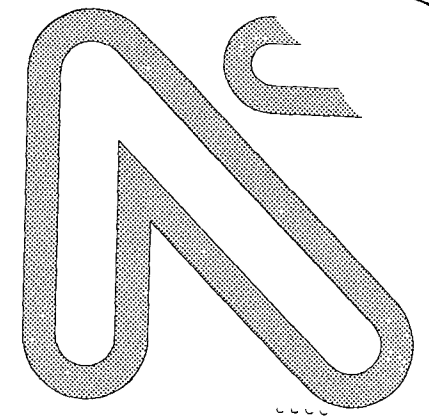

**NICHOLS
BROSCH
WURST
WOLFE
& ASSOCIATES, INC.**
Architecture & Planning
1600 Southwest Avenue
Coral Gables, FL 33134
(305) 443-0252
(305) 443-0253
FAX: (305) 443-0254
AEC 000000

ANGLER'S HOTEL
600 WASHINGTON AVENUE, MIAMI BEACH, FLORIDA 33139
DEVELOPED BY: Angler's Boutique Resort LLC



JAN 15 2015
[Signature]

REVISIONS		
#	Description	Date
1	CMB Bldg. Dept. Comments	12/16/14
2	CMB Bldg. Dept. Comments	01/15/15

12064

A4.01.1

[Signature]
RECEIVED
CITY OF MIAMI LIBRARY
FIRE DEPARTMENT

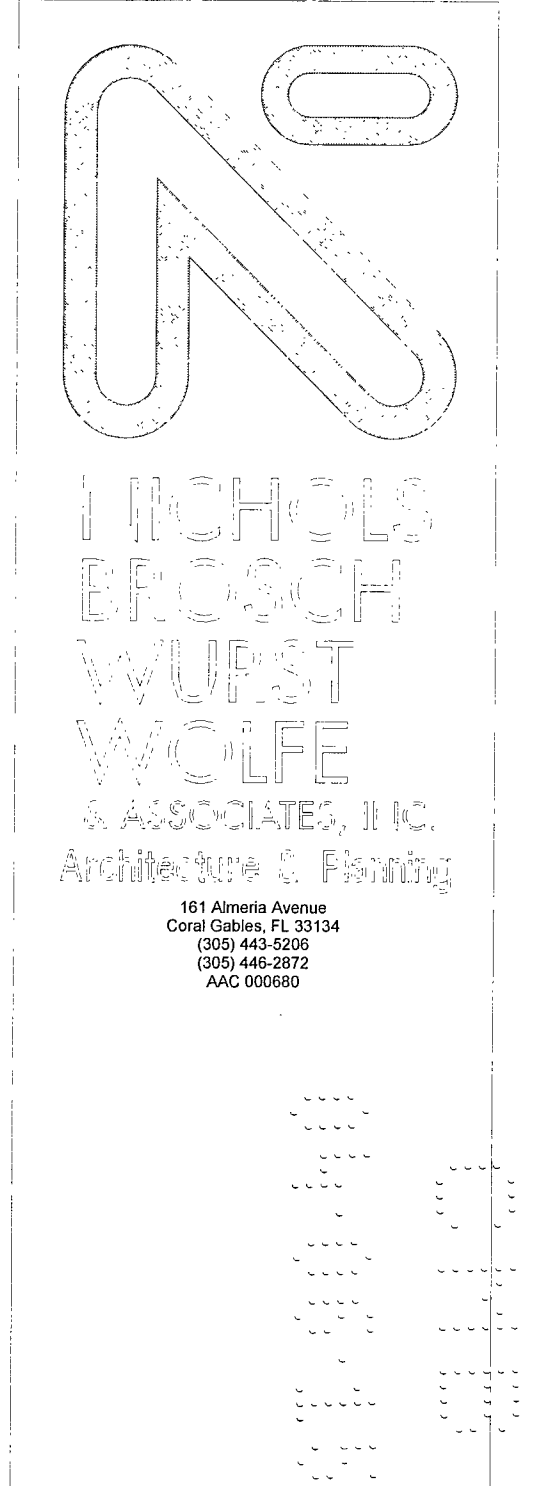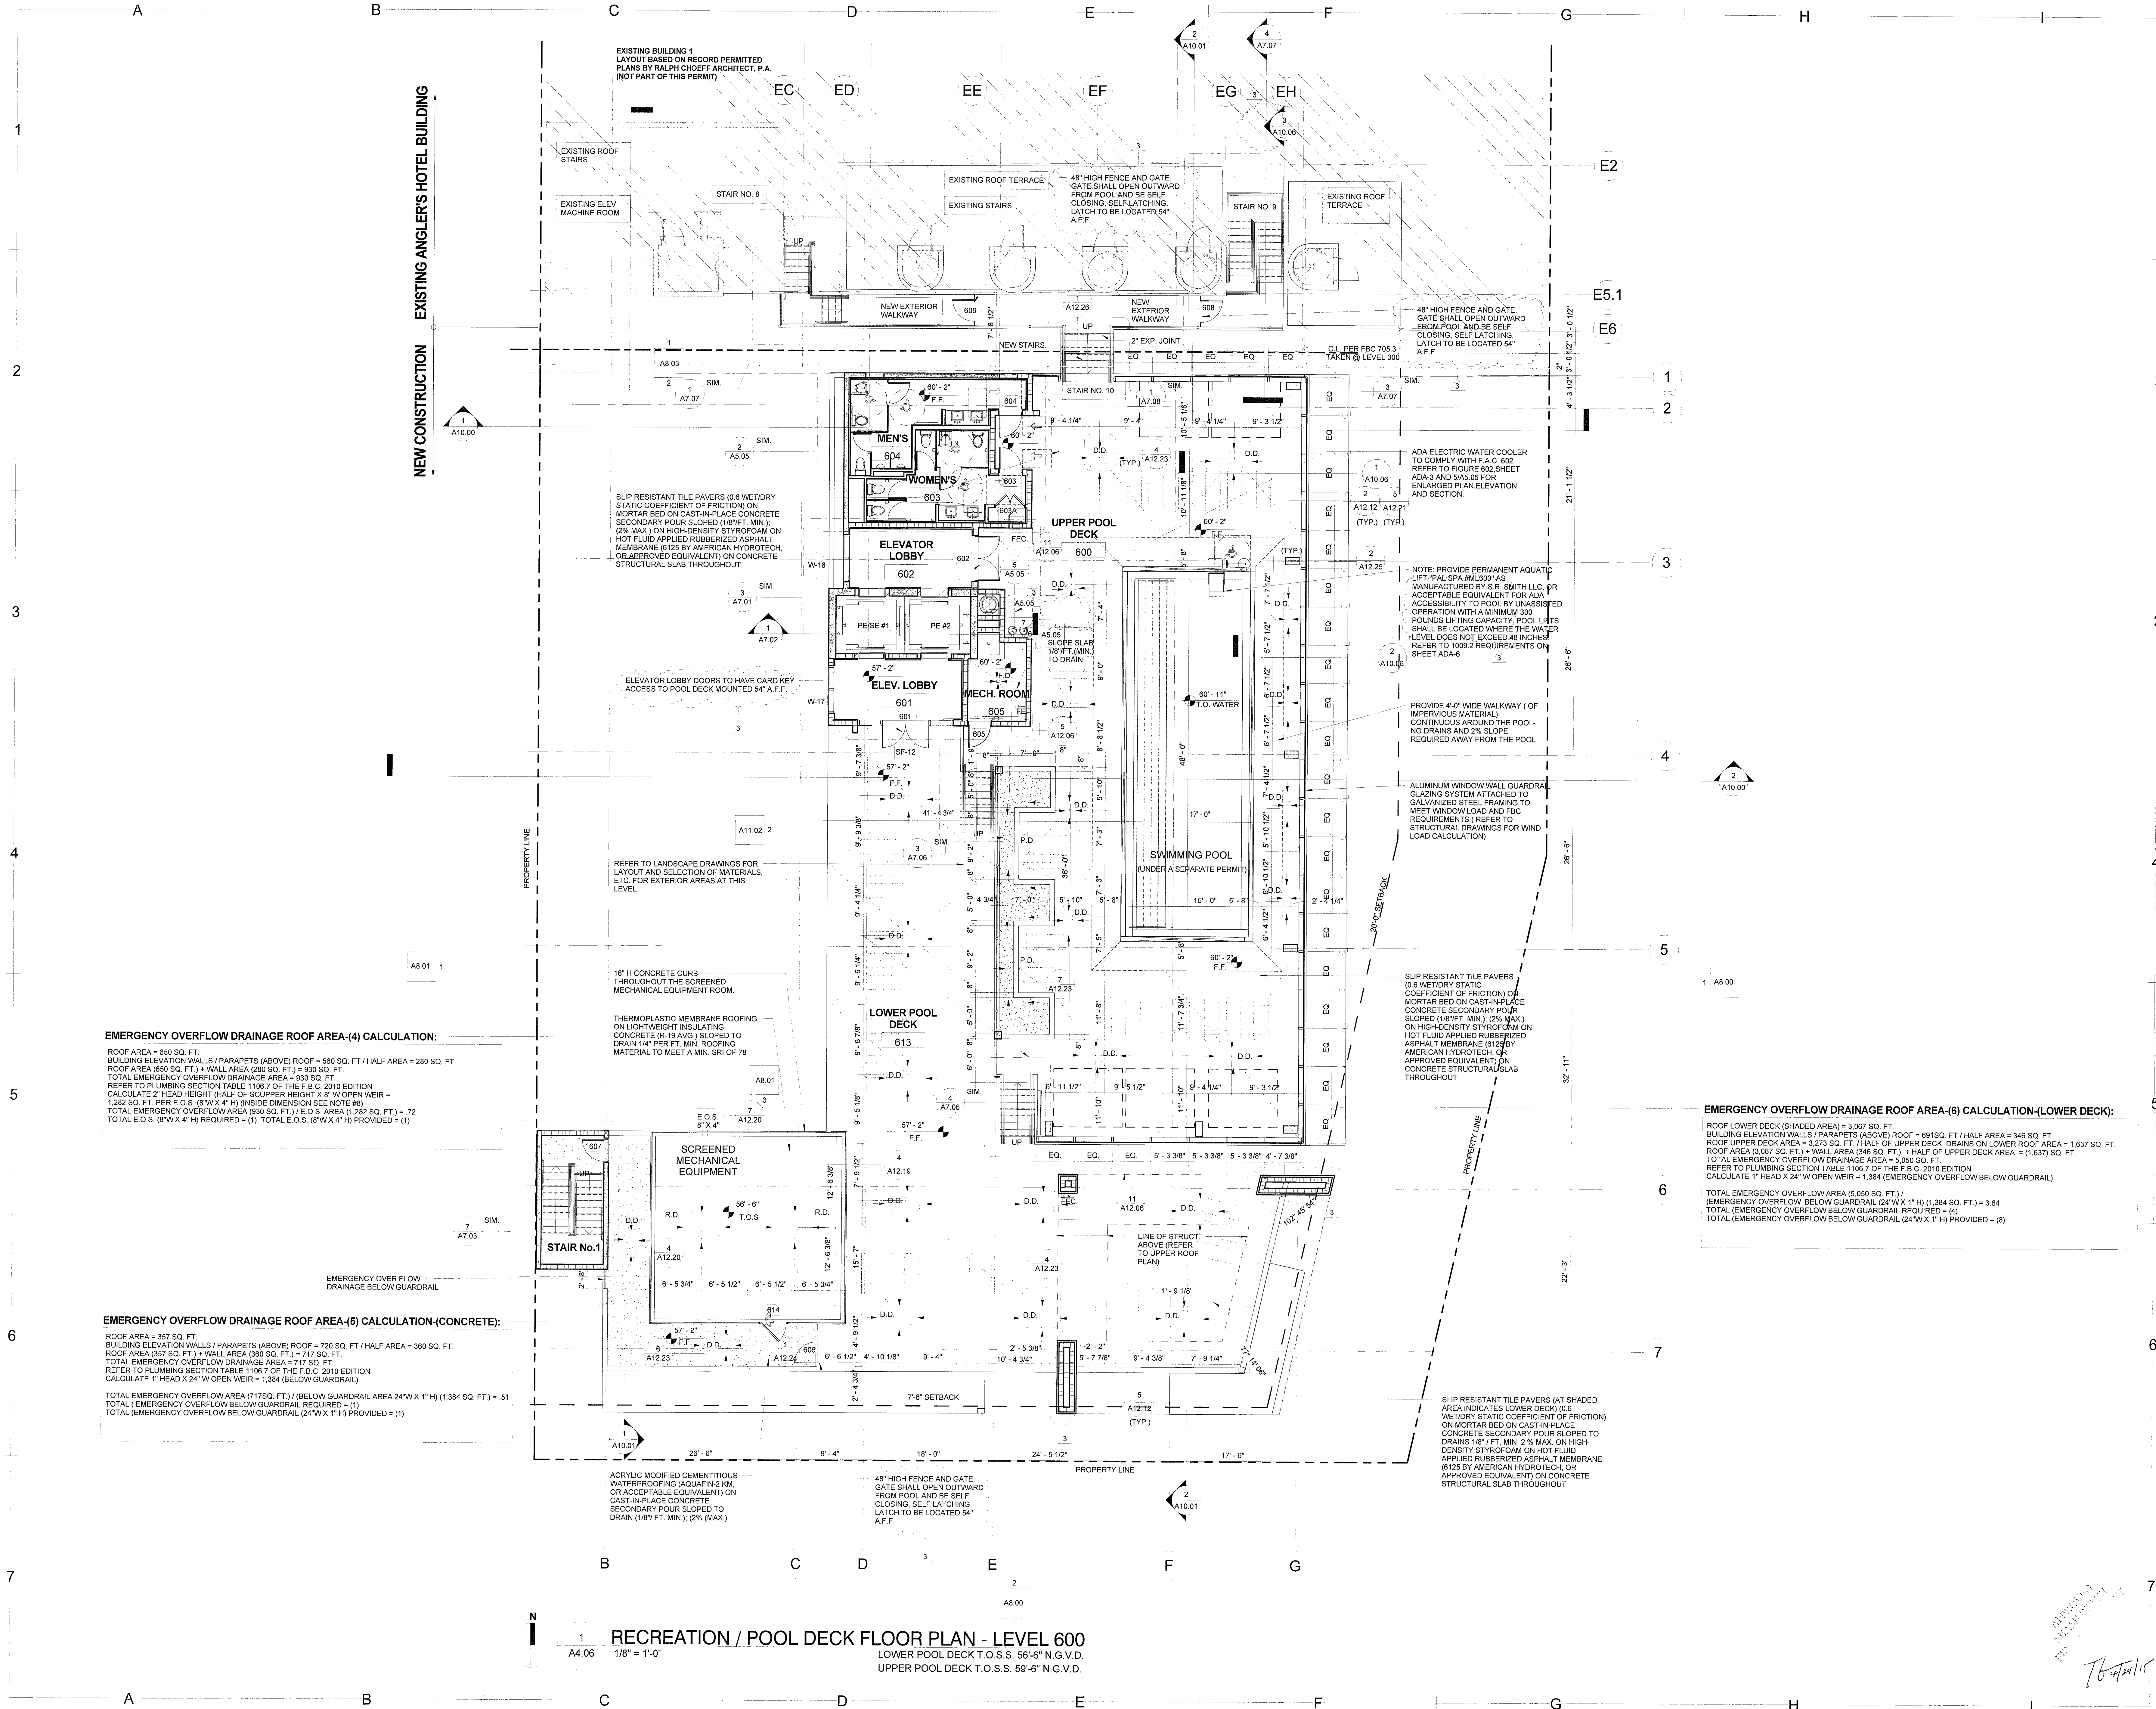

ANGLER'S HOTEL
600 WASHINGTON AVENUE, MIAMI BEACH, FLORIDA 33139
DEVELOPED BY: Angler's Boutique Resort LLC

MADE 5 2016
Phu

REVISIONS		
#	Description	Date
1	CMB Bldg. Dept. Comments	12/16/14
2	CMB Bldg. Dept. Comments	01/15/15
3	CMB Bldg. Dept. Comments	03/25/15

C:\Users\akriss\Documents\1201\INGLERS_HOTEL_akriss.rvt
12/18/2014 2:11:57 PM

EMERGENCY OVERFLOW DRAINAGE ROOF AREA-(1) CALCULATION:

ROOF AREA = 1,198 SQ. FT.
BUILDING ELEVATION WALLS / PARAPETS (ABOVE) ROOF = 1,268 SQ. FT. / HALF AREA = 634 SQ. FT.
ROOF AREA (1,198 SQ. FT.) + WALL AREA (634 SQ. FT.) = 10,782 SQ. FT.
TOTAL EMERGENCY OVERFLOW DRAINAGE AREA = 1,832 SQ. FT.
REFER TO PLUMBING SECTION TABLE 1106.7 OF THE F.B.C. 2010 EDITION
CALCULATE 2" HEAD HEIGHT (HALF OF SCUPPER HEIGHT X 8" W OPEN WEIR =
1,282 SQ. FT. PER E.O.S. (8"W X 4" H) (INSIDE DIMENSION SEE NOTE #8)
TOTAL EMERGENCY OVERFLOW AREA (1,832 SQ. FT.) / E.O.S. AREA (1,282 SQ. FT.) = 1.42
TOTAL E.O.S. (8"W X 4" H) REQUIRED = (2) TOTAL E.O.S. (8"W X 4" H) PROVIDED = (2)

EMERGENCY OVERFLOW DRAINAGE ROOF AREA-(2) CALCULATION:

ROOF AREA = 148 SQ. FT.
BUILDING ELEVATION WALLS / PARAPETS (ABOVE) ROOF = 54 SQ. FT. / HALF AREA = 27 SQ. FT.
ROOF AREA (148 SQ. FT.) + WALL AREA (27 SQ. FT.) = 175 SQ. FT.
TOTAL EMERGENCY OVERFLOW DRAINAGE AREA = 175 SQ. FT.
REFER TO PLUMBING SECTION TABLE 1106.7 OF THE F.B.C. 2010 EDITION
CALCULATE 2" HEAD HEIGHT (HALF OF SCUPPER HEIGHT X 4" W OPEN WEIR =
641 SQ. FT. PER E.O.S. (4"W X 4" H) (INSIDE DIMENSION SEE NOTE #8)
TOTAL EMERGENCY OVERFLOW AREA (175 SQ. FT.) / E.O.S. AREA (641 SQ. FT.) = .273
TOTAL E.O.S. (4"W X 4" H) REQUIRED = (1) TOTAL E.O.S. (4"W X 4" H) PROVIDED = (1)

EMERGENCY OVERFLOW DRAINAGE ROOF AREA-(3) CALCULATION:

ROOF AREA = 132 SQ. FT.
BUILDING ELEVATION WALLS / PARAPETS (ABOVE) ROOF = 81 SQ. FT. / HALF AREA = 41 SQ. FT.
ROOF AREA (132 SQ. FT.) + WALL AREA (41 SQ. FT.) = 193 SQ. FT.
TOTAL EMERGENCY OVERFLOW DRAINAGE AREA = 193 SQ. FT.
REFER TO PLUMBING SECTION TABLE 1106.7 OF THE F.B.C. 2010 EDITION
CALCULATE 2" HEAD HEIGHT (HALF OF SCUPPER HEIGHT X 4" W OPEN WEIR =
641 SQ. FT. PER E.O.S. (4"W X 4" H) (INSIDE DIMENSION SEE NOTE #8)
TOTAL EMERGENCY OVERFLOW AREA (193 SQ. FT.) / E.O.S. AREA (641 SQ. FT.) = .30
TOTAL E.O.S. (4"W X 4" H) REQUIRED = (1) TOTAL E.O.S. (4"W X 4" H) PROVIDED = (1)

ROOFING NOTES:

1. REFER TO SHEETS A12.19 & A12.20 FOR ALL TYPICAL THERMOPLASTIC MEMBRANE SYSTEM ROOFING DETAILS, WHICH INCLUDES BUT NOT LIMITED TO THE FOLLOWING: ROOF FLASHING, PIPE PENETRATION, ROOF DRAIN, OVERFLOW SCUPPERS, EQUIPMENT SUPPORTS AND ETC.
2. ALL MECHANICAL PENETRATION, ELECTRICAL, PLUMBING AND OTHER PENETRATIONS SHALL BE MOUNTED A MINIMUM OF 12 INCHES FROM PARAPET WALLS.
3. ALL ROOFTOP MOUNTED EQUIPMENT SHALL BE INSTALLED AS PER THE MANUFACTURER'S ENGINEERED SHOP DRAWINGS AND CALCULATIONS DESIGNED TO COMPLY WITH F.B.C.
4. ALL ROOFING SYSTEM MUST BE INSTALLED TO ENSURE POSITIVE DRAINAGE. THE MINIMUM ROOF SLOPE SHALL NOT BE LESS THAN 1/4": 12" IN ACCORDANCE WITH F.B.C. 2010 EDITION, SECTION 1515.2.2.1
5. ALL OVERFLOW DRAINS AND SCUPPERS ARE TO BE INSTALLED WITH THE INLET FLOW LINE LOCATED NOT LESS THAN 2" OR MORE THAN 4" ABOVE THE LOW POINT OF THE FINISHED ROOFING SURFACE, EXCLUDING Sumps IN ACCORDANCE WITH F.B.C. SECTION 1514.4.4
6. ALL CRICKETS TO BE 1/2" PER FT. MINIMUM SLOPED TO DRAIN, TYPICAL.
7. ROOF VENTS SHALL BE A MINIMUM OF 10 FT. FROM AIR INTAKES. REFER TO MECHANICAL DRAWINGS.
8. E.O.S. - EMERGENCY OVERFLOW SCUPPER
- NOTE:
SCUPPER SIZE SHOWN ON DRAWINGS ARE BASED ON THE CLEAR DIMENSION REQUIRED INSIDE OF SCUPPER. COORDINATE WALL OPENINGS W/ OVERALL EXTERIOR SCUPPER SIZE.
9. R.D. - ROOF DRAIN (SEE TO PLUMBING DWG'S)
10. R.D.S. - ROOF DRAIN SCUPPER
11. SEE ELECTRICAL DRAWINGS FOR LIGHTNING PROTECTION PLANS.
12. SEE PLUMBING DRAWINGS FOR ROOF DECK DRAINAGE CALCULATIONS. PROVIDE AND INSTALL WALKING PADS AROUND ALL MECHANICAL EQUIPMENT UNITS. REFER TO SPECIFICATIONS. (TYPICAL)
13. PROVIDE ELEVATED 3'-0" WIDE CROSS WALKS OVER MECHANICAL PIPES AS REQUIRED.

**NICHOLS
BROSCH
WURST
WOLFE**
& ASSOCIATES, INC.
Architecture & Planning
161 Arroyo Avenue
Coral Gables, FL 33134
(305) 442-2872
FAX (305) 442-2889

ANGLER'S HOTEL
600 WASHINGTON AVENUE, MIAMI BEACH, FLORIDA 33139
DEVELOPED BY: Angler's Boutique Resort LLC

Permit Issue
10-13-14

REVISIONS

#	Description	Date
1	CMB Bldg. Dept. Comments	12/16/14

[Signature]
DEC 16 2014

12064

A4.07

UPPER ROOF PLAN
1/8" = 1'-0" (T.O.S.S. 89'-10" N.G.V.D.)

3600 WASHINGTON AVENUE, MIAMI BEACH, FLORIDA 33139


DEVELOPED BY: Andler's Boutique Resort LLC


JAN 15 2015

Permit Issue 10-13-14		
REVISIONS		
#	Description	
1	CMB Bldg. Dept. Comments	12/15
2	CMB Bldg. Dept. comments	01/15


12064

A5.06

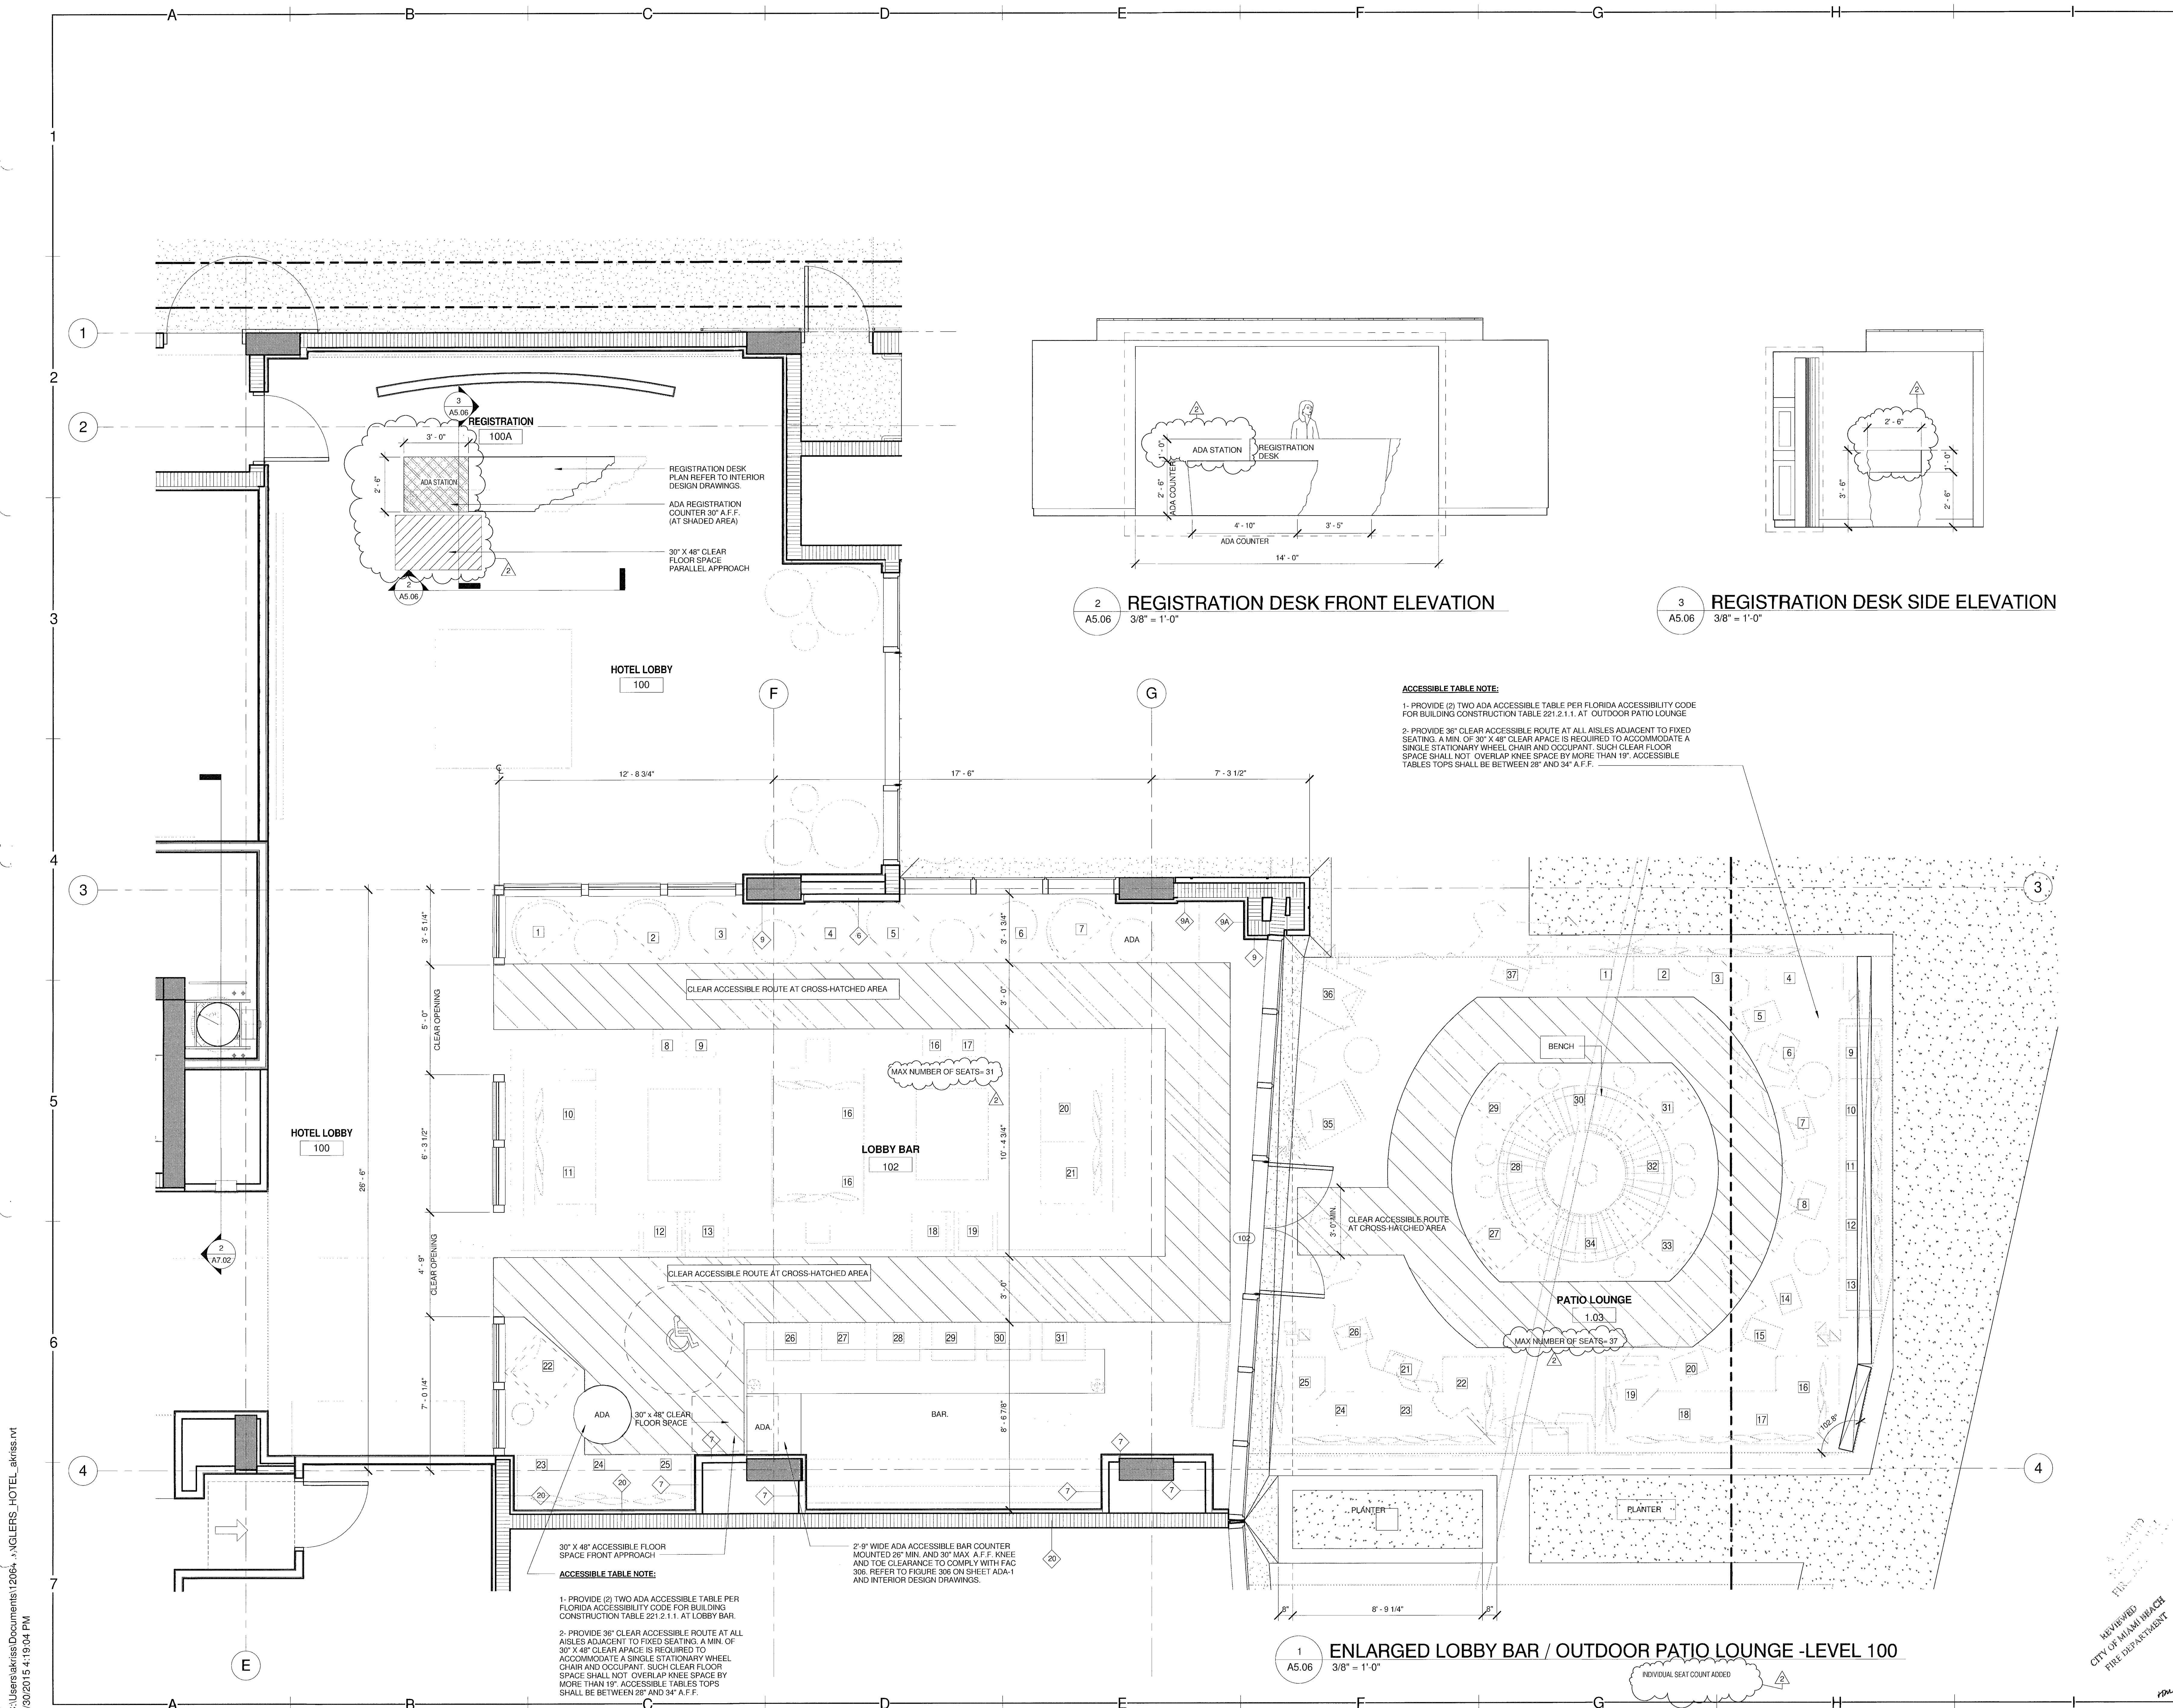

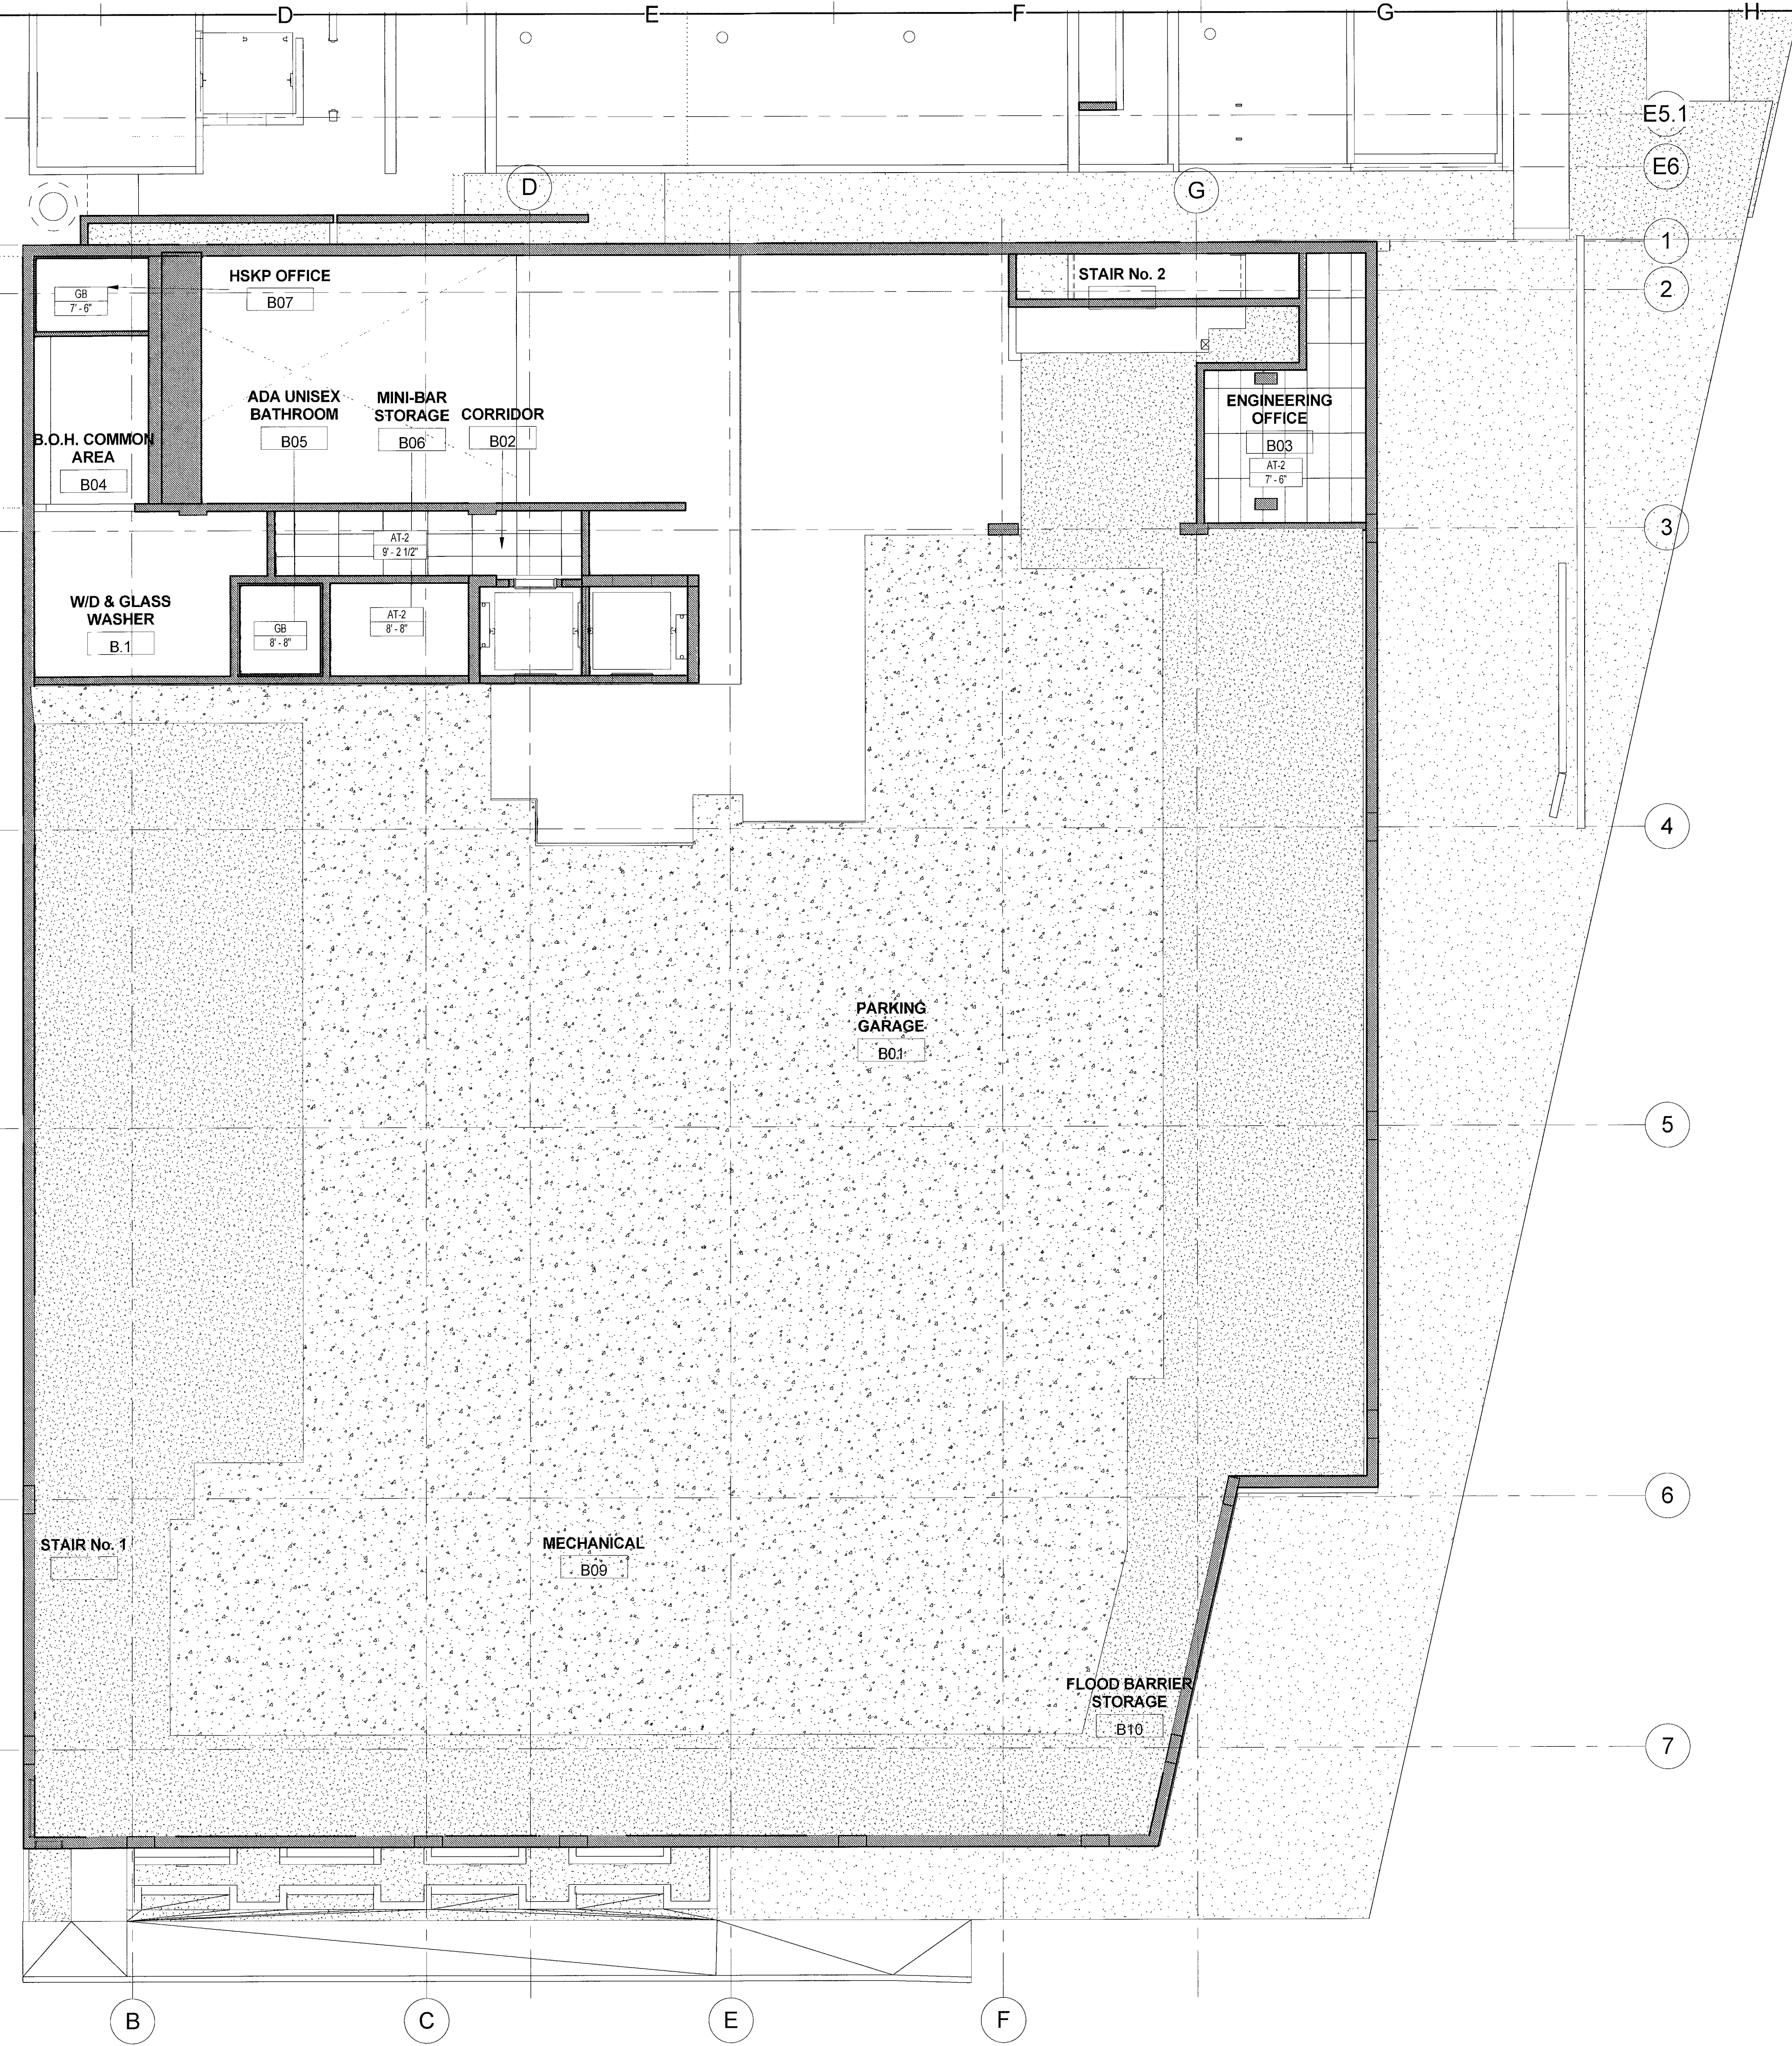

1
A6.00
BASEMENT REFLECTED CEILING PLAN
1/8" = 1'-0"

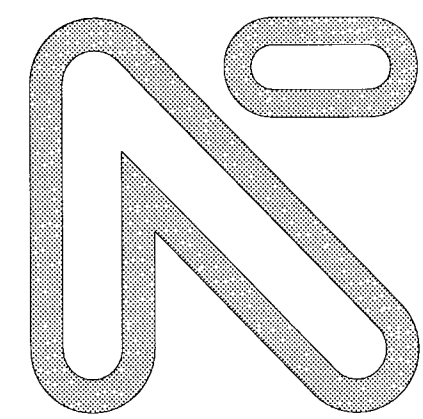

NICHOLS
BROSCH
WURST
WOLFE
& ASSOCIATES, INC.
Architecture & Planning

401 NW 10th Street
Coral Gables, FL 33134
(305) 443-1000
(305) 448-2872
FAX: (305) 443-1000

ANGLER'S HOTEL

600 WASHINGTON AVENUE, MIAMI BEACH, FLORIDA 33139

DEVELOPED BY: Angler's Boutique Resort LLC

Permit Issue
10-13-14

REVISIONS

#	Description	Date
1	ICMB Bldg. Dept. Comments	12/16/14

[Signature]
DEC 16 2014

12064

A6.00

NEW SHEET

REVIEWED BY:
CITY OF MIAMI BEACH
FIRE DEPARTMENT



REFLECTED CEILING PLAN, SYMBOLS, AND NOTES

XXX	CEILING MATERIAL
X' - X"	CEILING HEIGHT ABOVE FINISH FLOOR
⊙	PENDANT LIGHT
WP	RECESSED DOWNLIGHT (WP WHEN WATERPROOF)
○	WALL SCONCE
⊙	SURFACE MOUNTED FIXTURE
⊙	CEILING MOUNTED EXIT LIGHT
⊙	WALL MOUNTED EXIT LIGHT
SD	SMOKE DETECTOR
S	AUDIBLE / VISIBLE SPEAKER
□	ACCESS PANEL
⊗	CEILING MOUNT A/C SUPPLY GRILL
⊗	CEILING MOUNT A/C RETURN GRILL
—	LINEAR DIFFUSER
●	SEMI-RECESSED FIRE SPRINKLER HEAD
●	FIRE SPRINKLER HEAD
▷	WALL MOUNTED FIRE SPRINKLER HEAD

AT-1	ACOUSTICAL CEILING TILE (2X2)
AT-2	ACOUSTICAL CEILING TILE (2X4)
AT-3	ACOUSTICAL CEILING TILE (2X4) - DAMAGE RESISTANT

ES	EXPOSED STRUCTURE
GB	GYPSUM WALL BOARD
GMGB	GLASS-MAT GYPSUM WALLBOARD
⊗	SPRAYED-ON INSULATION
□	2X2 RECESSED FLUORESCENT LIGHT FIXTURE
□	2X4 RECESSED FLUORESCENT LIGHT FIXTURE
□	2X2 SURFACE MOUNTED FLUORESCENT LIGHT FIXTURE
□	2X4 SURFACE MOUNTED FLUORESCENT LIGHT FIXTURE
□	WALL MOUNTED FLUORESCENT LIGHT FIXTURE
□	EMERGENCY LIGHTING LIGHT FIXTURE (SEE ELECTRICAL DRAWINGS)

REFLECTED CEILING NOTES:

- G.C. TO COORDINATE ARCHITECTURAL, MECHANICAL, ELECTRICAL, LIGHTING, AND FIRE PROTECTION INSTALLATIONS.
- SEE LIGHTING AND ELECTRICAL DRAWINGS FOR FIXTURE TYPES & SCHEDULE.
- ALL CEILING HEIGHTS ARE FROM THE TOP OF THE FINISH FLOOR.
- SUSPENDED ACOUSTICAL CEILING TILE & GRID SYSTEM IS NOT DESIGNED OR INTENDED TO SUPPORT THE WEIGHT OF ADDITIONAL EQUIPMENT, CABLE, CONDUIT, MECHANICAL EQUIPMENT OR OTHER CONSTRUCTION. ALL SUCH ELEMENTS ARE TO BE INDEPENDENTLY SUPPORTED FROM THE BUILDING STRUCTURE BY AT LEAST TWO OPPOSITE CORNERS.
- ALL LIGHTS NOT DIMENSIONED SHALL BE CENTERED OR PLACED EQUALLY WITHIN THE CEILING SPACE. FINAL PLACEMENT OF FIXTURES SHALL BE APPROVED BY ARCHITECT & INTERIOR DESIGNER PRIOR TO WIRING FIXTURES. CONTRACTOR SHALL MAKE MINOR ADJUSTMENTS TO LAYOUT WITHOUT ANY ADDITIONAL COST TO THE CONTRACT.
- HEAVY OR LARGE DECORATIVE LIGHT FIXTURES EXCEEDING 15-20 LBS. REQUIRE ATTACHMENT DETAILS WHICH EXCEED CONVENTIONAL METHODS FOR ATTACHING J-BOXES TO CEILING FRAMING. THEY SHALL BE SUSPENDED FROM STRUCTURAL SLAB FROM AN ENGINEERED METAL FRAMING SYSTEM.
- SEE MEP DRAWINGS FOR EXACT LOCATION AND SPECIFICATIONS OF FIRE ALARM, FIRE SPRINKLER & MECHANICAL SYSTEMS.

NOTE:
FOR PUBLIC AREA REFLECTED CEILING ELEVATIONS, DIMENSIONS, LIGHT FIXTURES, ETC. SEE INTERIOR DESIGN AND LIGHTING DRAWINGS.

ALL GUESTROOM BATH DROPPED CEILINGS THROUGHOUT, INCLUDING SHOWERS, TO HAVE 5/8" GLASS-MAT GYPSUM BOARD (MEETING ASTM C1178) ON 1 5/8" GALV. MTL. STUD FRAMING AT 16" O.C.

ALL EXPOSED CONCRETE CEILINGS TO RECEIVE SKIM COAT PLASTER - PAINTED.


ALL DROPPED GYPSUM WALLBOARD CEILINGS (OTHER THAN BATHROOM CEILINGS) TO BE 5/8" GYPSUM WALLBOARD ON 1 5/8" GALV. MTL. STUD FRAMING.

JAN 15 2015
mm

Permit Issue 10-13-14		
REVISIONS		
#	Description	Date
1	CMB Bldg. Dept. Comments	12/16/14
2	CMB Bldg. Dept. Comments	01/15/15

12064

A6.01

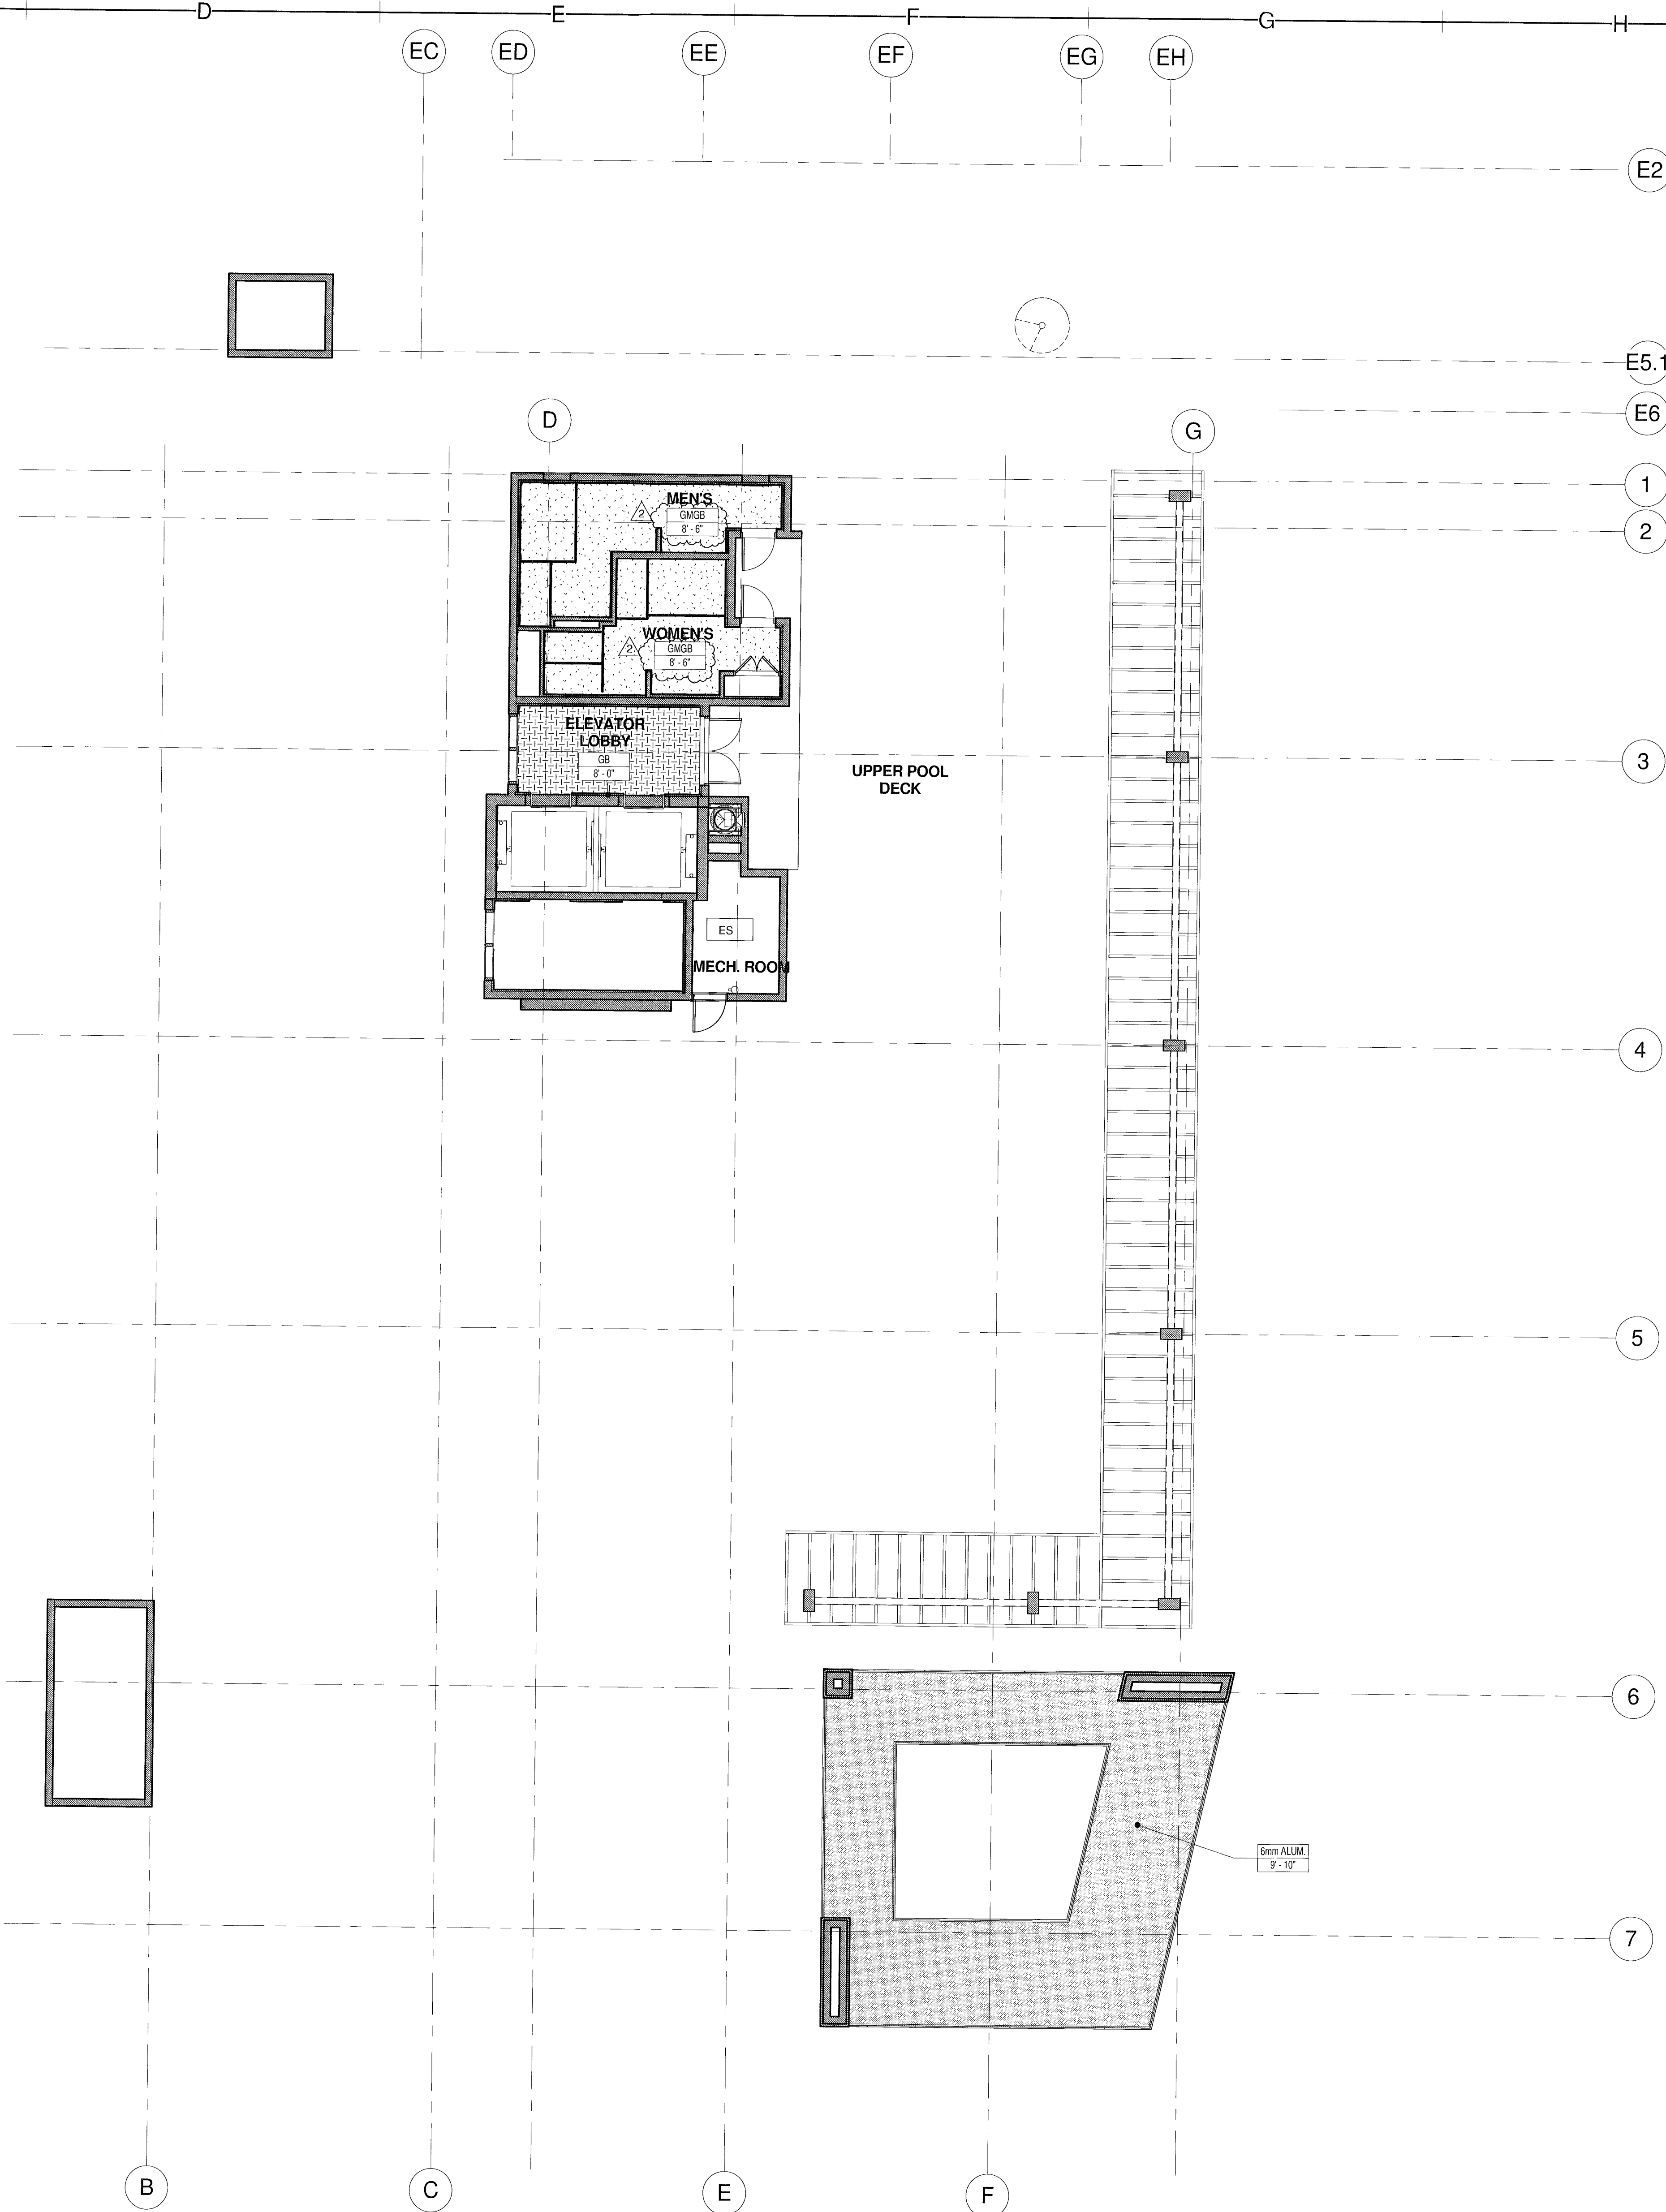

1
A6.06
1/8" = 1'-0"

UPPER POOL DECK REFLECTED CEILING PLAN

REFLECTED CEILING PLAN, SYMBOLS, AND NOTES

- | XXX | CEILING MATERIAL |
|---------|-----------------------------------|
| X' - X" | CEILING HEIGHT ABOVE FINISH FLOOR |
- PENDANT LIGHT
 - WP RECESSED DOWNLIGHT (WP WHEN WATERPROOF)
 - WALL SCONCE
 - SURFACE MOUNTED FIXTURE
 - CEILING MOUNTED EXIT LIGHT
 - WALL MOUNTED EXIT LIGHT
 - SD SMOKE DETECTOR
 - S AUDIBLE / VISIBLE SPEAKER
 - ACCESS PANEL
 - CEILING MOUNT A/C SUPPLY GRILL
 - CEILING MOUNT A/C RETURN GRILL
 - LINEAR DIFFUSER
 - SEMI-RECESSED FIRE SPRINKLER HEAD
 - FIRE SPRINKLER HEAD
 - WALL MOUNTED FIRE SPRINKLER HEAD
 - AT-1 ACOUSTICAL CEILING TILE (2X2)
 - AT-2 ACOUSTICAL CEILING TILE (2X4)
 - AT-3 ACOUSTICAL CEILING TILE (2X4) - DAMAGE RESISTANT
 - ES EXPOSED STRUCTURE
 - GB GYPSUM WALL BOARD
 - GMGB GLASS-MAT GYPSUM WALLBOARD
 - SPRAYED-ON INSULATION
 - 2x2 RECESSED FLUORESCENT LIGHT FIXTURE
 - 2x4 RECESSED FLUORESCENT LIGHT FIXTURE
 - 2x2 SURFACE MOUNTED FLUORESCENT LIGHT FIXTURE
 - 2x4 SURFACE MOUNTED FLUORESCENT LIGHT FIXTURE
 - WALL MOUNTED FLUORESCENT LIGHT FIXTURE
 - EMERGENCY LIGHTING LIGHT FIXTURE (SEE ELECTRICAL DRAWINGS)

- REFLECTED CEILING NOTES:
- G.C. TO COORDINATE ARCHITECTURAL, MECHANICAL, ELECTRICAL, LIGHTING, AND FIRE PROTECTION INSTALLATIONS.
 - SEE LIGHTING AND ELECTRICAL DRAWINGS FOR FIXTURE TYPES & SCHEDULE.
 - ALL CEILING HEIGHTS ARE FROM THE TOP OF THE FINISH FLOOR.
 - SUSPENDED ACOUSTICAL CEILING TILE & GRID SYSTEM IS NOT DESIGNED OR INTENDED TO SUPPORT THE WEIGHT OF ADDITIONAL EQUIPMENT, CABLE, CONDUIT, MECHANICAL EQUIPMENT OR OTHER CONSTRUCTION. ALL SUCH ELEMENTS ARE TO BE INDEPENDENTLY SUPPORTED FROM THE BUILDING STRUCTURE BY AT LEAST TWO OPPOSITE CORNERS.
 - ALL LIGHTS NOT DIMENSIONED SHALL BE CENTERED OR PLACED EQUALLY WITHIN THE CEILING SPACE. FINAL PLACEMENT OF FIXTURES SHALL BE APPROVED BY ARCHITECT & INTERIOR DESIGNER PRIOR TO WIRING FIXTURES. CONTRACTOR SHALL MAKE MINOR ADJUSTMENTS TO LAYOUT WITHOUT ANY ADDITIONAL COST TO THE CONTRACT.
 - HEAVY OR LARGE DECORATIVE LIGHT FIXTURES EXCEEDING 15-20 LBS. REQUIRE ATTACHMENT DETAILS WHICH EXCEED CONVENTIONAL METHODS FOR ATTACHING J-BOXES TO CEILING FRAMING. THEY SHALL BE SUSPENDED FROM STRUCTURAL SLAB FROM AN ENGINEERED METAL FRAMING SYSTEM.
 - SEE MEP DRAWINGS FOR EXACT LOCATION AND SPECIFICATIONS OF FIRE ALARM, FIRE SPRINKLER & MECHANICAL SYSTEMS.
- NOTE:
FOR PUBLIC AREA REFLECTED CEILING ELEVATIONS, DIMENSIONS LIGHT FIXTURES, ETC. SEE INTERIOR DESIGN AND LIGHTING DRAWINGS.
- ALL GUESTROOM BATH DROPPED CEILINGS THROUGHOUT, INCLUDING SHOWERS, TO HAVE 5/8" GLASS-MAT GYPSUM BOARD (MEETING ASTM C1178) ON 1 5/8" GALV. MTL. STUD FRAMING AT 16" O.C.
- ALL EXPOSED CONCRETE CEILINGS TO RECEIVE SKIM COAT PLASTER - PAINTED.
- ALL DROPPED GYPSUM WALLBOARD CEILINGS (OTHER THAN BATHROOM CEILINGS) TO BE 5/8" GYPSUM WALLBOARD ON 1 5/8" GALV. MTL. STUD FRAMING.



ANGLER'S HOTEL
600 WASHINGTON AVENUE, MIAMI BEACH, FLORIDA 33139
DEVELOPED BY: Angler's Boutique Resort LLC

JAN 15 2015


Permit Issue 10-13-14		
REVISIONS		
#	Description	Date
1	CMB Bldg. Dept. Comments	12/16/14
2	CMB Bldg. Dept. comments	01/15/15

12064


A6.06

APPROVED
FOR THE CITY OF MIAMI BEACH
FIRE DEPARTMENT


C:\Users\akriss\Documents\12064_ ANGLERS_HOTEL_akriss.v4
1/30/2015 4:19:40 PM

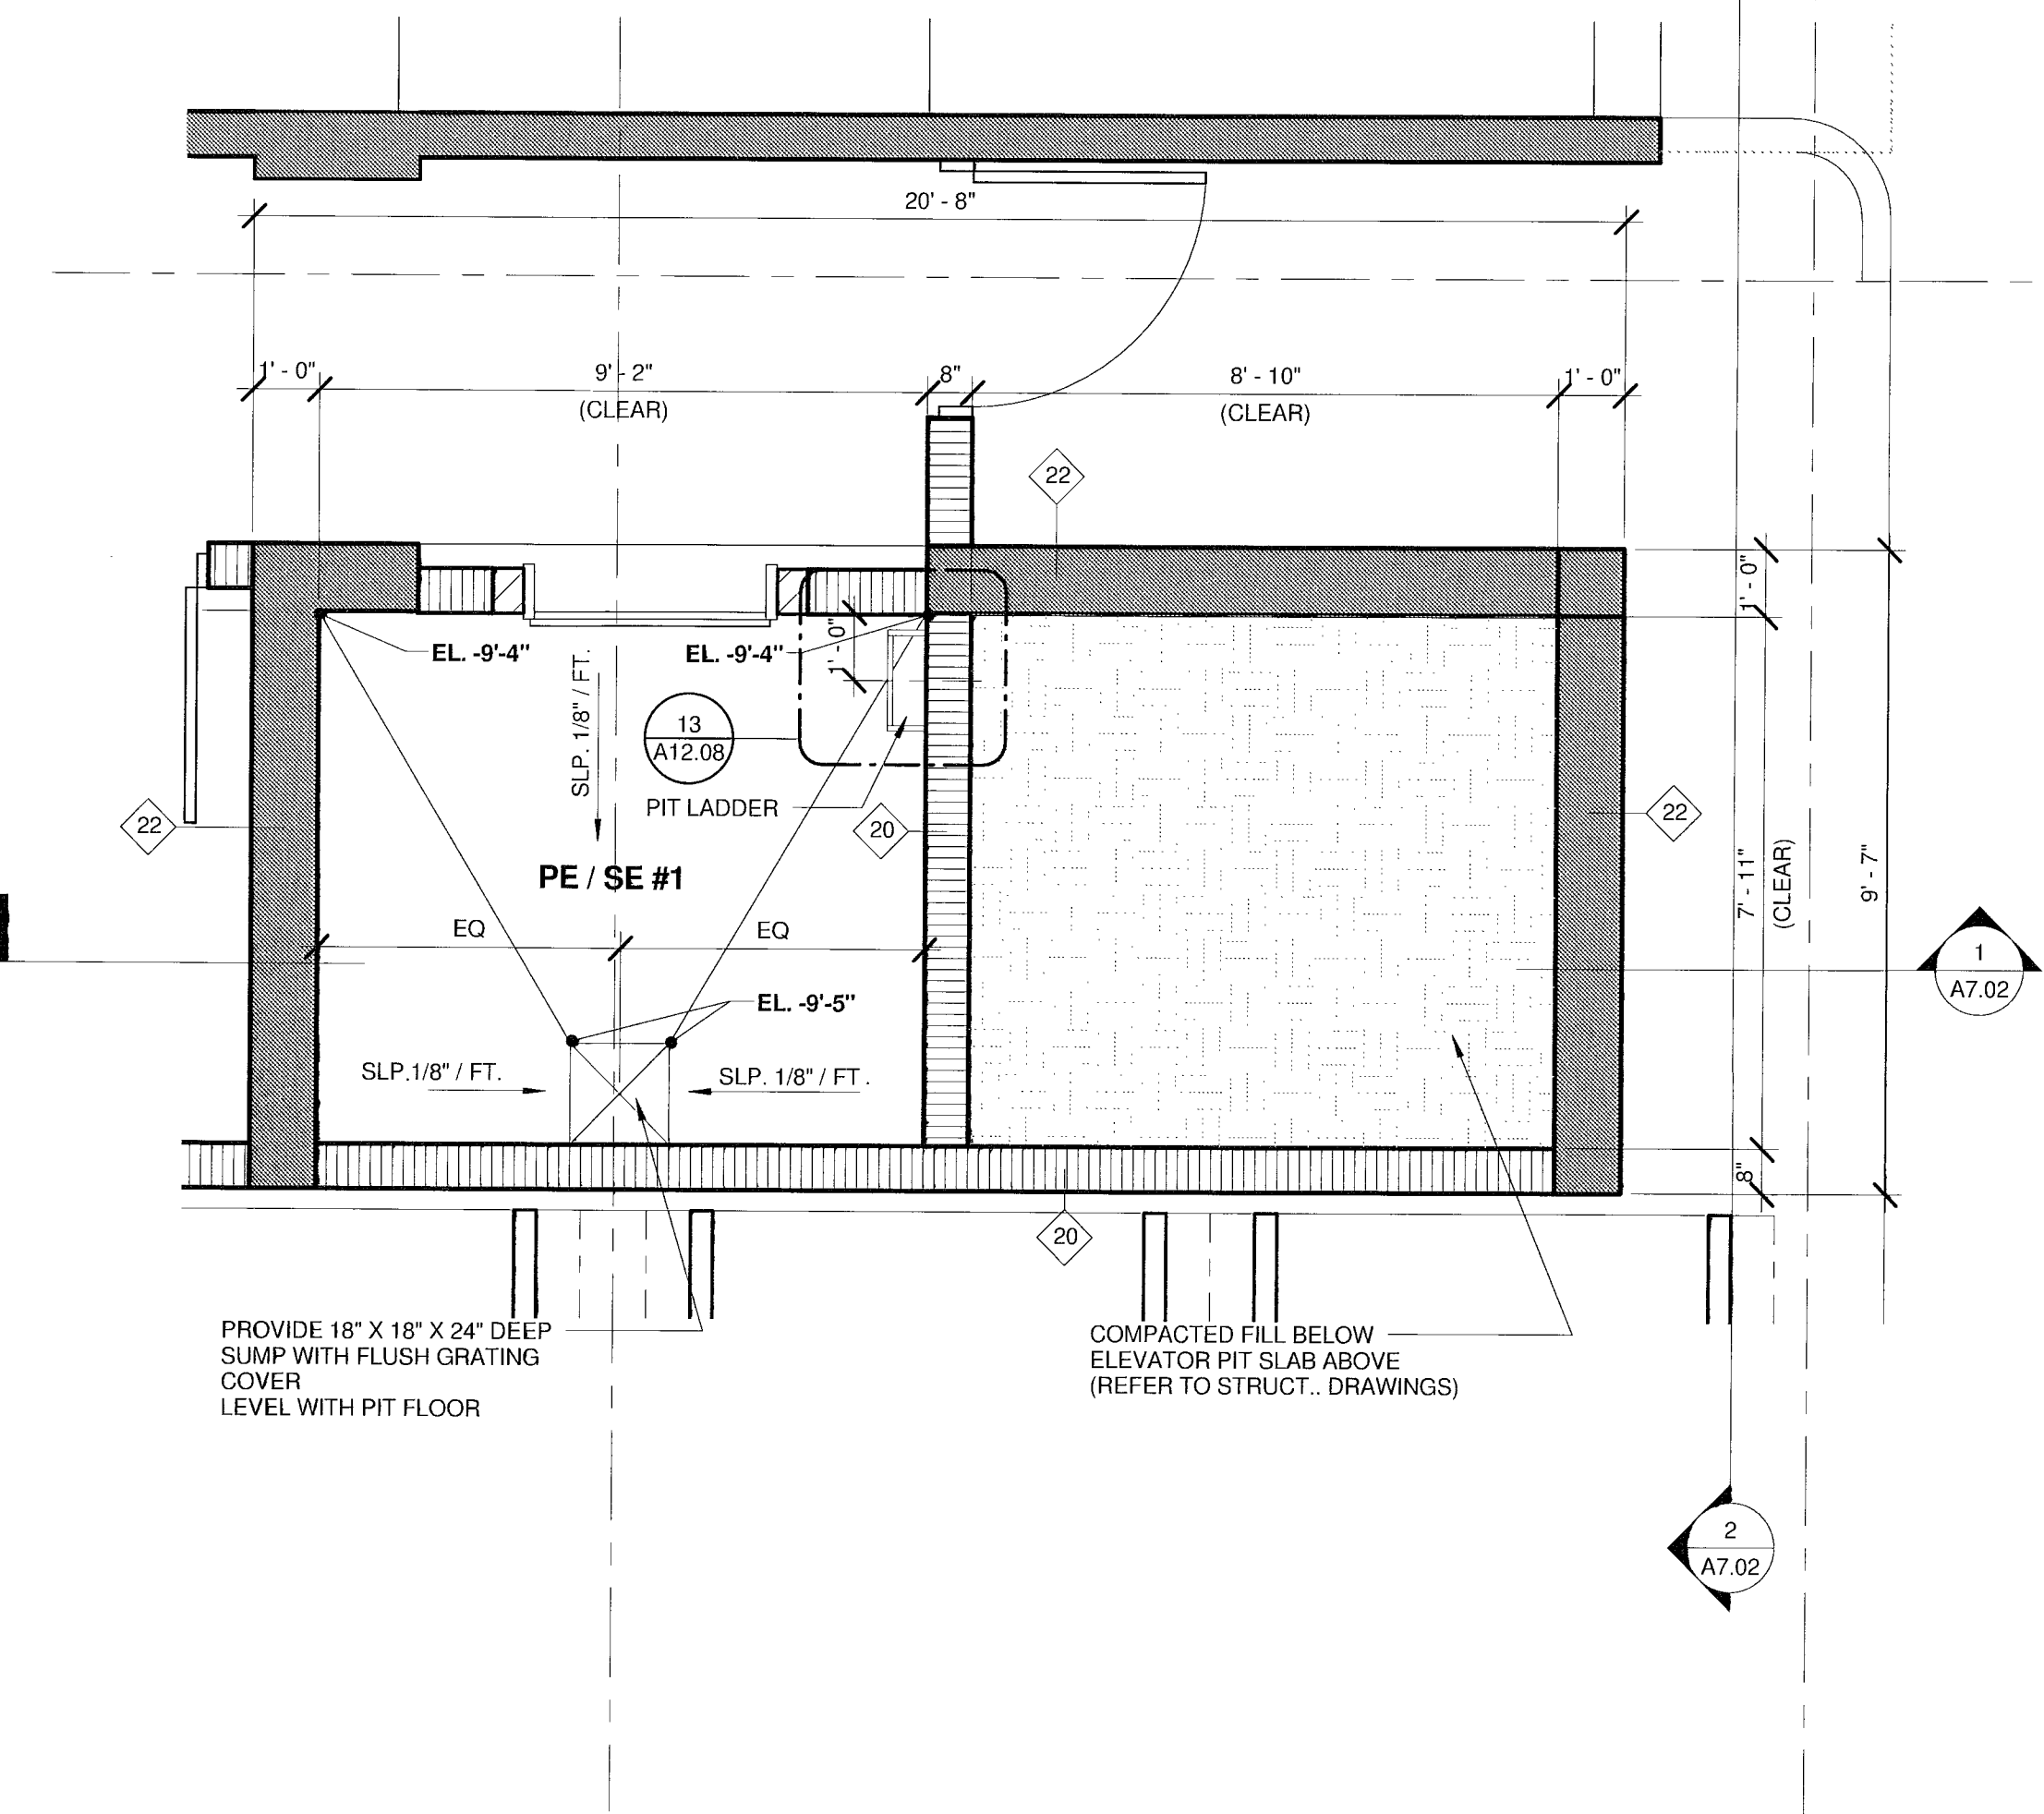


1
A7.00
ELEVATOR CORE - PIT PLAN
3/8" = 1'-0"

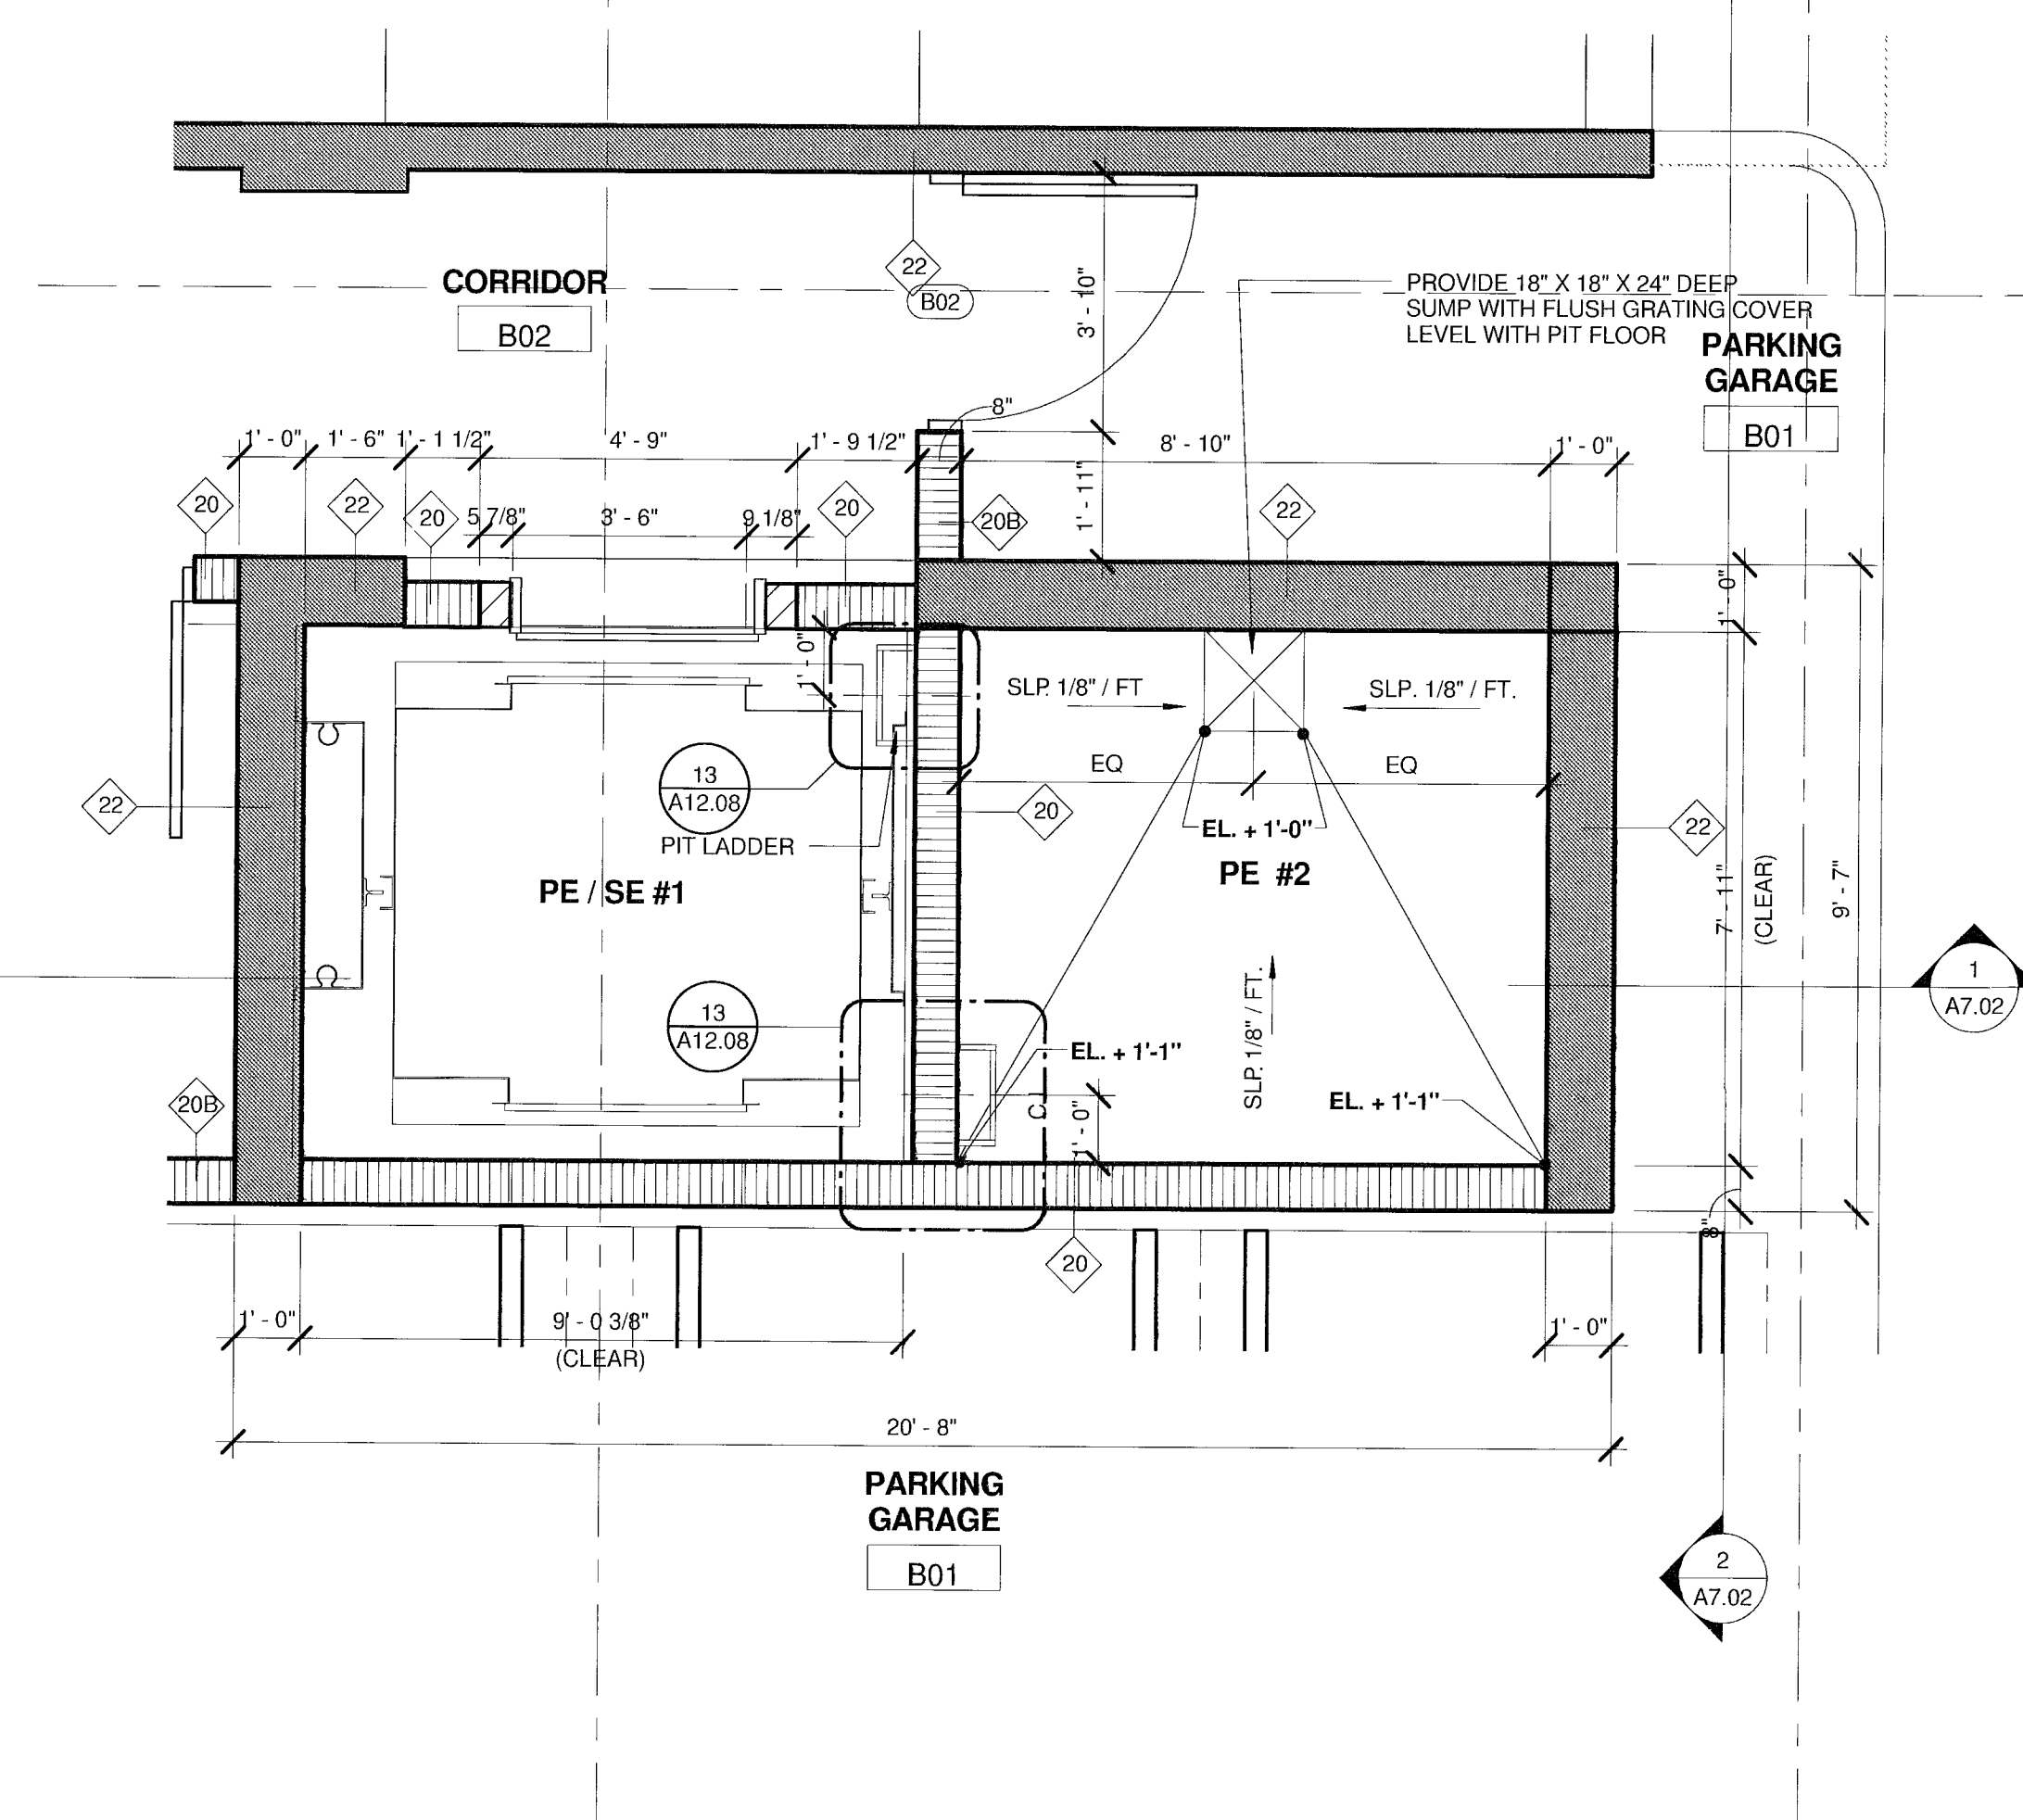

2
A7.00
ELEVATOR CORE - BASEMENT
3/8" = 1'-0"

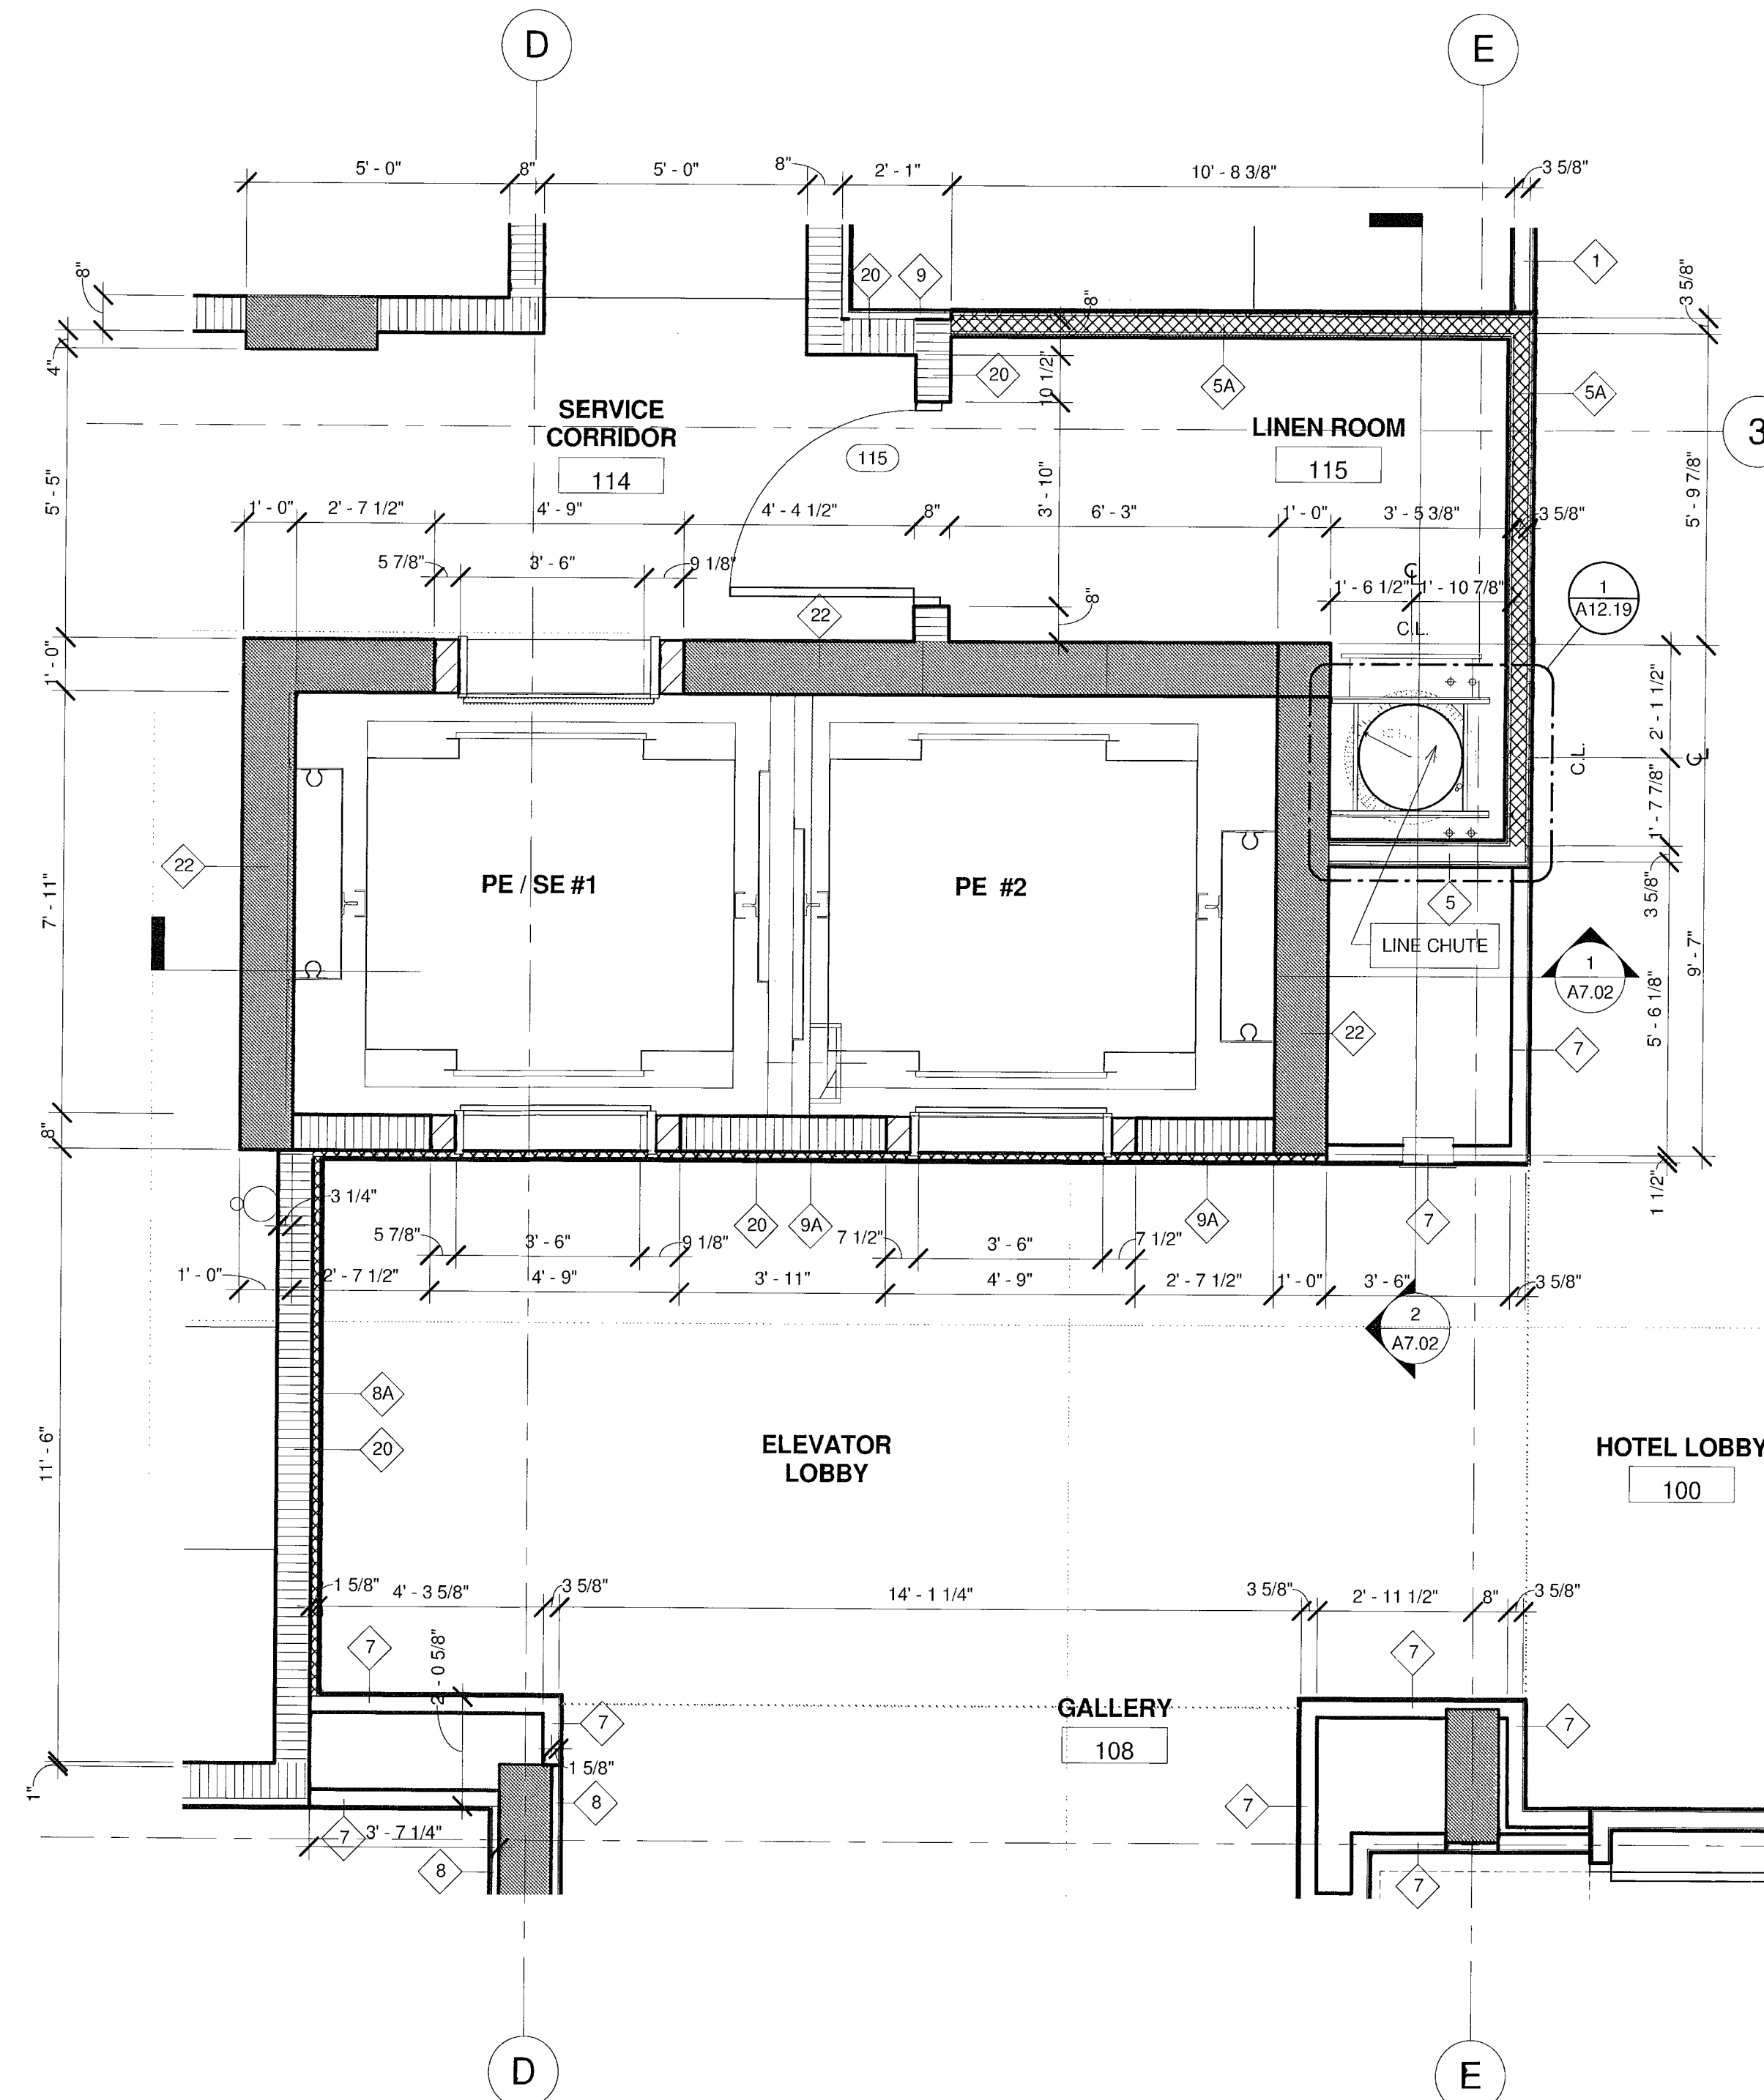

3
A7.00
ELEVATOR CORE - LEVEL 100
3/8" = 1'-0"

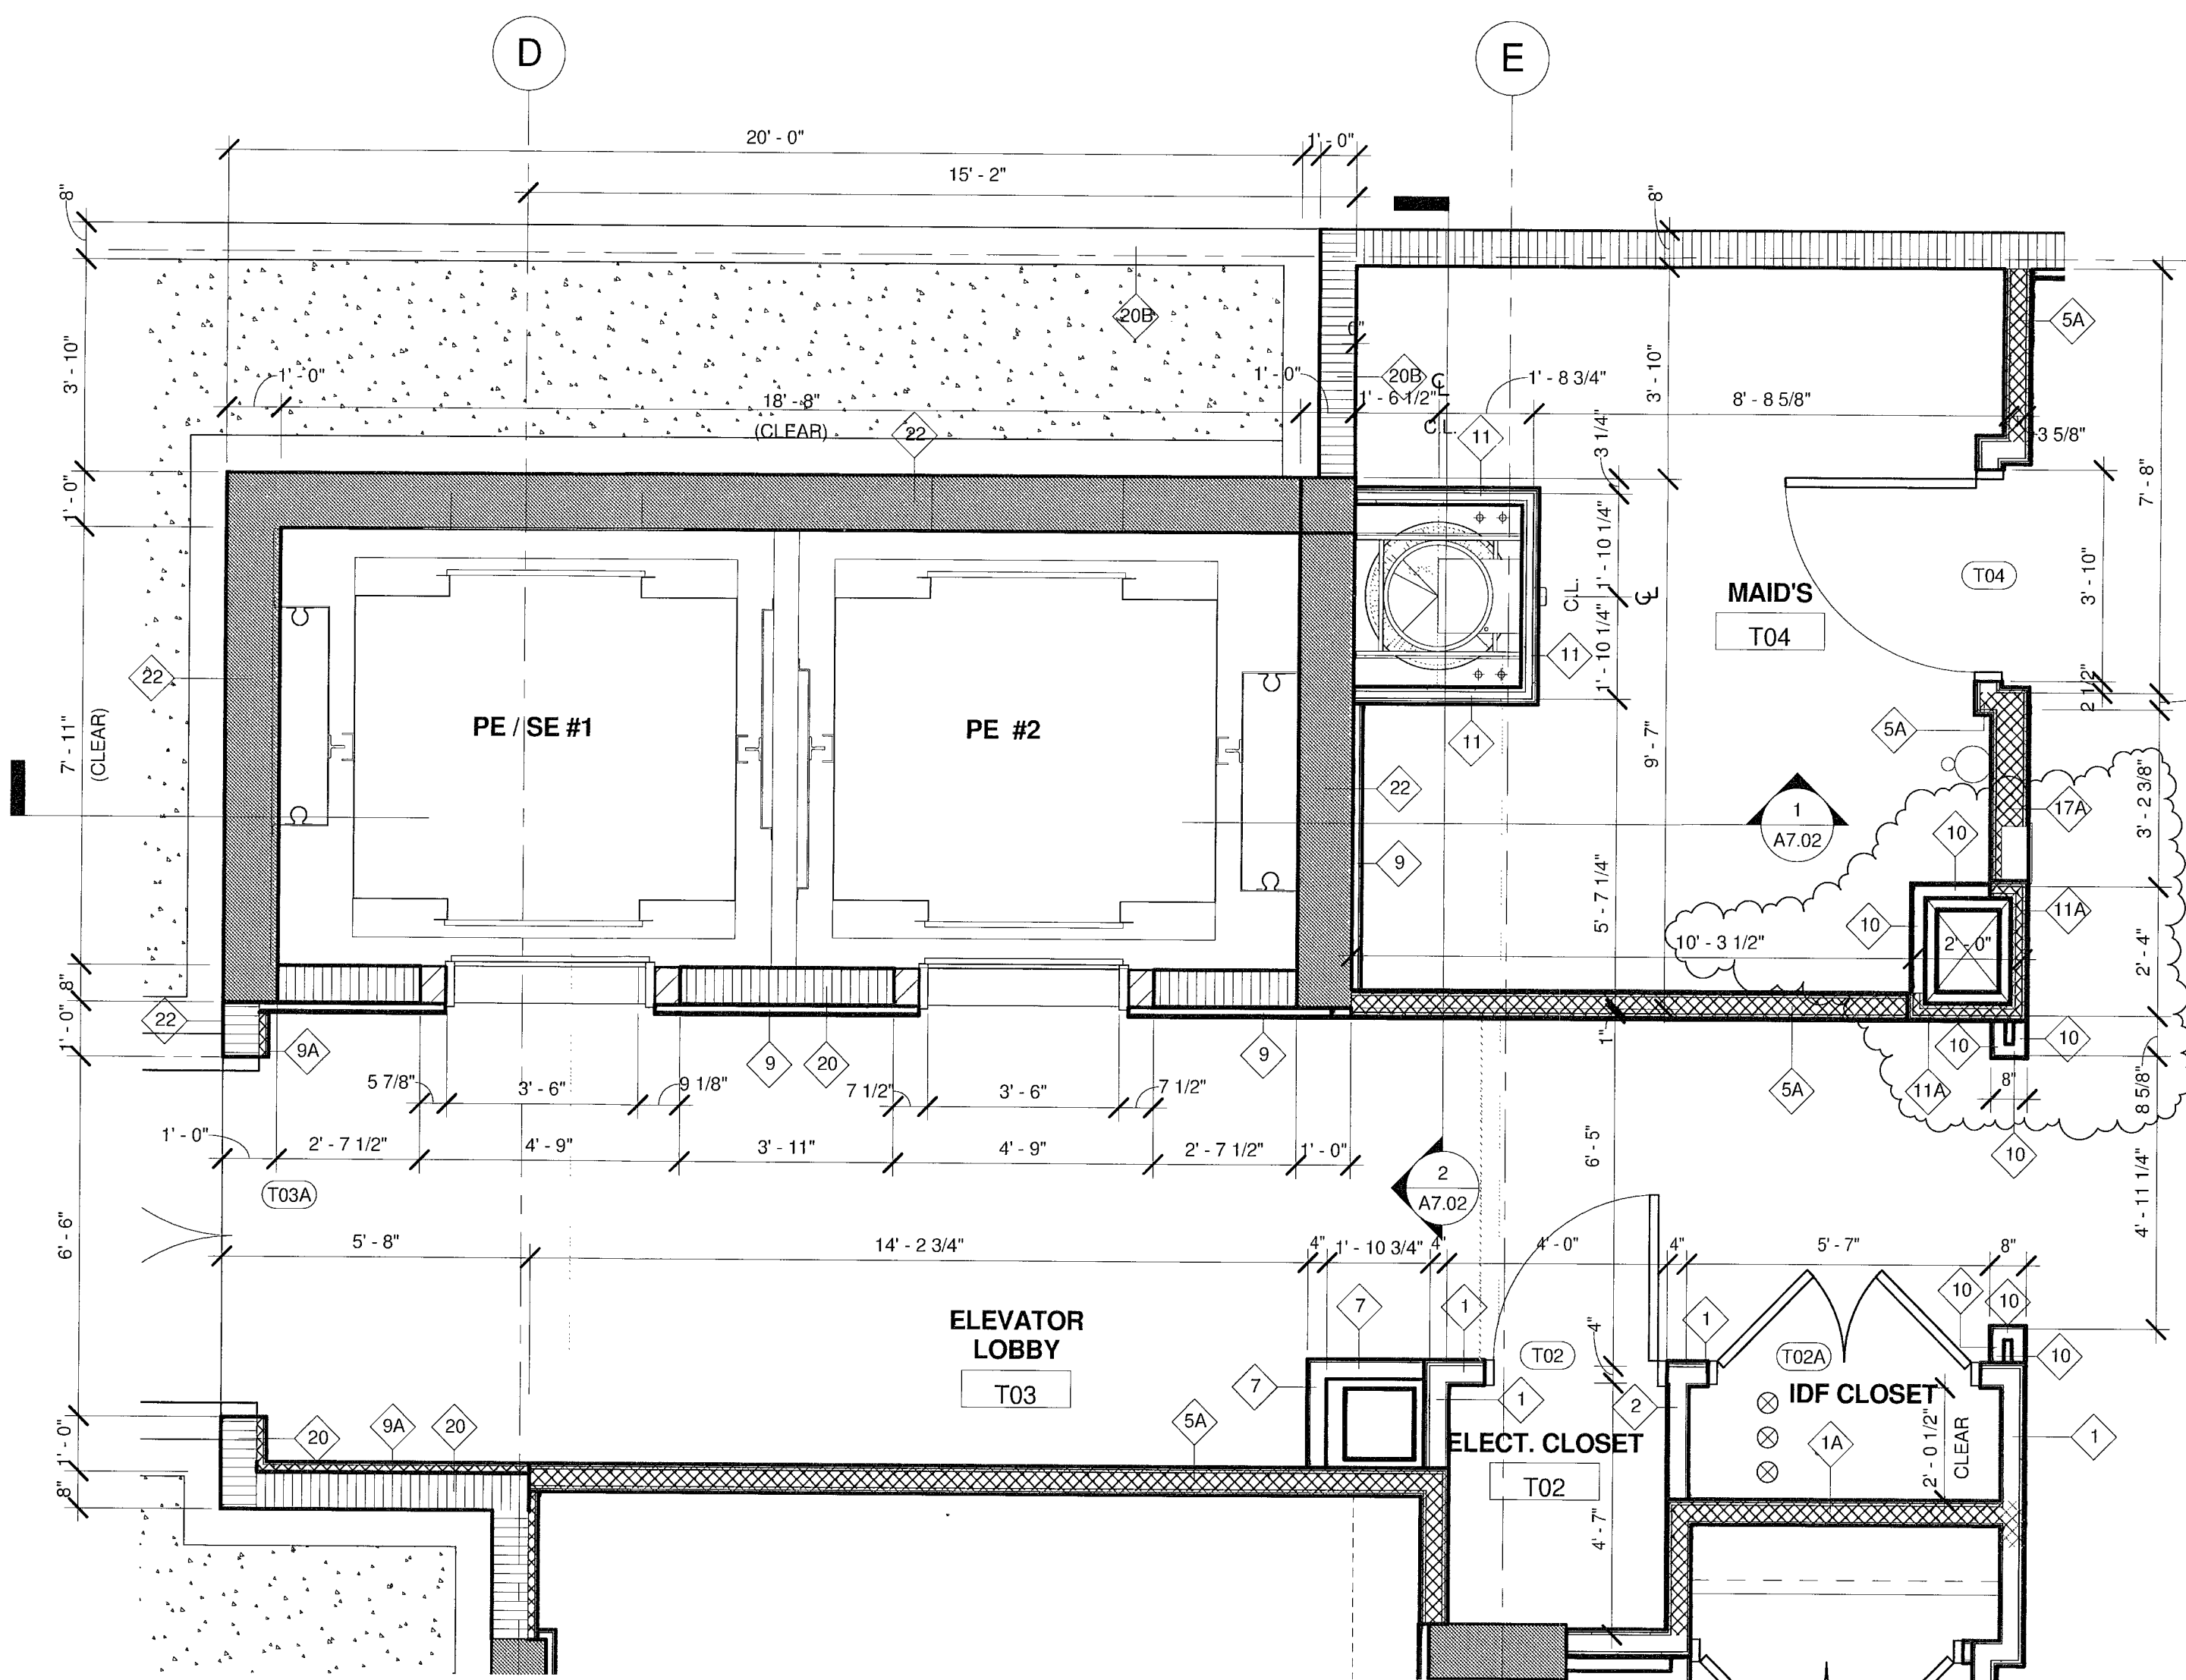

4
A7.00
ELEVATOR CORE - LEVEL 200
3/8" = 1'-0"

NOTE:
ALL ELEVATORS SHALL BE DESIGNED AND INSTALLED IN
ACCORDANCE WITH ASCE 24-05 7.5 AND FEMA TECHNICAL
BULLETIN 4-2010

ELEVATOR GENERAL NOTES:

GENERIC DRAWINGS:

1. THESE DRAWINGS FOR GENERAL INFORMATION ONLY. REQUIREMENTS OF INDIVIDUAL VENDORS MAY VARY.
2. THESE DRAWINGS SHALL BE DISTRIBUTED TO APPROPRIATE CONSULTING AND ENGINEERING FIRMS INCLUDING ARCHITECT, STRUCTURAL, ELECTRICAL AND MECHANICAL ENGINEERS.
3. FIELD VERIFY ALL EXISTING DIMENSIONS.
4. ROUGH OPENING DIMENSIONS FOR ELEVATOR ENTRANCES APPLY ONLY IN THE CASE OF MASONRY OR CONCRETE CONSTRUCTION.
5. VERTICAL STRUCTURAL SUPPORT FOR RAIL BRACKETING IS PROVIDED BY HOISTWAY WALL IN THE CASE OF REINFORCED CONCRETE HOISTWAY CONSTRUCTION.
6. ELEVATOR SHAFT VENTILATION SHALL COMPLY WITH FBC SECTION 3004 AND 13-409 ABC 3.1.

NOTES:

APPLICATION DESIGNED FOR:
OTIS
SCHINDLER
THYSENKRUPP

PIT NOTES:

1. PROVIDE ADEQUATE LIGHTING TO MAINTAIN MIN. 100 LUX (10 FC) ILLUMINATION AT PIT FLOOR.
2. PROVIDE PIT ACCESS LADDERS, LIGHT SWITCHES, LIGHTS, AND GFCI-PROTECTED UTILITY OUTLETS.
3. PROVIDE ONE PIT LADDER, LIGHT SWITCH, LIGHT FIXTURE, AND OUTLET PER ELEVATOR.
4. PROVIDE ADEQUATE STRUCTURAL SUPPORT REQUIRED FOR BUFFER AND RAIL FORCE REACTIONS.

PIT AND OVERHEAD PLANS INDICATE REACTIONS FOR MACHINE ROOM-LESS EQUIPMENT OF VARIOUS ELEVATOR VENDORS. WHERE REACTIONS OF DIFFERENT VENDORS OVERLAP, THE HIGHER REACTION IS INDICATED. REACTIONS FOR ONE VENDOR DO NOT OCCUR WITH THE REACTIONS OF OTHER VENDORS. OVERHEAD PLANS ARE NOT SHOWN FOR VENDORS WITH NO REACTIONS IN THE OVERHEAD.

5. ELEVATOR PIT SHALL COMPLY WITH ASME A17.1-2009 SECTION 2.2.2.2.2.3.3.1 THRU 2.2.2.2.3.3.3.

CONTROL ROOM NOTES:

PROVIDE SELF-CLOSING, SELF-LOCKING CONTROL ROOM ACCESS DOOR. PROVIDE ADEQUATE LIGHTING TO MAINTAIN MIN. 200 LUX (19 FC) ILLUMINATION AT CONTROL ROOM FLOOR. PROVIDE LIGHT(S), LIGHT SWITCH(ES) AND GFCI-PROTECTED UTILITY OUTLET(S). COORDINATE LOCATIONS WITH ELEVATOR CONTRACTOR. FOR MOST VENDORS, CONTROLLER MUST BE WITHIN 80' WIRE RUN LENGTH FROM THE CORRESPONDING MACHINE AT THE TOP OF THE HOISTWAY.

OVERHEAD NOTES:

PROVIDE ADEQUATE LIGHTING TO MAINTAIN MIN. 200 LUX (19 FC) ILLUMINATION AT TOP OF HOISTWAY. PROVIDE LIGHTS, LIGHT SWITCHES AND GFCI-PROTECTED UTILITY OUTLETS. COORDINATE LOCATIONS WITH ELEVATOR CONTRACTOR. PROVIDE STRUCTURAL SUPPORT TO SUSTAIN REACTIONS INDICATED.

APPLICABLE STANDARDS:

1. AMERICAN STANDARD SAFETY CODE FOR ELEVATORS, DUMBWAITERS, ESCALATORS AND MOVING WALKS (ASME A17.1)
2. FLORIDA BUILDING CODE ACCESSIBILITY - 2010 EDITION.
3. FLORIDA BUILDING CODE CHAPTER 30 - 2010 EDITION.
4. NATIONAL ELECTRICAL CODE
5. OTHER SUCH STATE AND LOCAL CODES AS MAY BE APPLICABLE.

EMERGENCY SIGNS:

AN APPROVED PICTORIAL SIGN OF STANDARDIZED DESIGN SHALL BE POSTED ADJACENT TO EACH ELEVATOR CALL STATION ON ALL FLOORS INSTRUCTING OCCUPANTS TO USE THE EXIT STAIRWAYS AND NOT TO USE ELEVATORS IN CASE OF FIRE. THE SIGN SHALL READ: IN FIRE EMERGENCY, DO NOT USE ELEVATOR. USE EXIT STAIRS.

AMBULANCE STRETCHER ELEVATOR:

ELEVATOR CAR TO ACCOMMODATE AMBULANCE STRETCHER - THIS BUILDING MUST BE CONSTRUCTED TO CONTAIN AT LEAST ONE PASSENGER ELEVATOR THAT IS OPERATIONAL FOR BUILDING OCCUPANTS AND FIRE DEPARTMENT EMERGENCY ACCESS TO ALL FLOORS. THE ELEVATOR CAR SHALL BE OF SUCH SIZE AND ARRANGEMENT TO ACCOMMODATE AN AMBULANCE STRETCHER 24 INCHES BY 84 INCHES WITH NOT LESS THAN 5 INCH RADIUS CORNERS. IN THE HORIZONTAL OPEN POSITION AND SHALL BE IDENTIFIED BY THE INTERNATIONAL SYMBOL FOR EMERGENCY MEDICAL SERVICES (STAR OF LIFE). THE SYMBOL SHALL NOT BE LESS THAN 9 INCHES HIGH AND SHALL BE PLACED INSIDE ON BOTH SIDES OF THE HOISTWAY DOOR FRAME.

TRACTION ELEVATOR EQUIPMENT

1 PASSENGER ELEVATOR, 1 SERVICE ELEVATOR

CAPACITY:
3500 # (PASSENGER PE-2)
4000 # (PASSENGER / SERVICE PE-1/SE-1)

CLASS LOADING: PASSENGER CLASS A

CONTRACT SPEED:
ELEVATORS PE-1/SE-1, PE-2: 350 F.P.M.

ROPING SPEED: MANUFACTURER'S STANDARDS

MACHINE: GEARLESS MACHINE ROOM LESS

MACHINE LOCATION: REFER TO DRAWINGS

SUPERVISORY CONTROL: GROUP AUTOMATIC MICROPROCESSOR-BASED SYSTEM

OPERATIONAL CONTROL: DUPLEX SELECTIVE COLLECTIVE MICROPROCESSOR-BASED SYSTEM

MOTOR CONTROL: AC VARIABLE VOLTAGE VARIABLE FREQUENCY, MICROPROCESSOR-BASED WITH DIGITAL CLOSED-LOOP FEEDBACK

POWER CHARACTERISTICS: 480 VOLTS, 3 PHASE, 60 HERTZ

ELEVATOR QUANTITY - DESCRIPTION:

2 - MAIN GUEST ELEVATORS PE-1 AND PE-2
1 - SERVICE ELEVATOR SE-1

STOPS:
7 STOPS PE-1/SE-1
6 STOPS PE-2

OPENINGS:
6 FRONT, 3 REAR; PE-1/SE-1
6 FRONT, 1 REAR; PE-2

TRAVEL: REFER TO PLANS AND SECTIONS

PLATFORM SIZE:
3500 # STANDARD PASSENGER

CLEAR INSIDE SIZE:
3500 # STANDARD PASSENGER : 6'-8" WIDE X 5'-5 1/2" DEEP

ENTRANCE SIZE:
CO 42" W X 84" H (PASSENGER)

ENTRANCE TYPE:
CENTER OPENING

REVIEWED
CITY OF MIAMI BEACH
FIRE DEPARTMENT

**NICHOLS
BROSCH
WURST
WOLFE
& ASSOCIATES, INC.**
Architecture & Planning
100 NW 10th Avenue
Coral Gables, FL 33134
(305) 443-0200
(305) 444-7977
FAX: (305) 443-0080

ANGLER'S HOTEL
600 WASHINGTON AVENUE, MIAMI BEACH, FLORIDA 33139
DEVELOPED BY: Angler's Boutique Resort LLC

JAN 15 2015

[Signature]

Permit Issue
10/13/14

REVISIONS


Description Date

1 CMB Bldg. Dept. Comments 12/16/14


2 CMB Bldg. Dept. Comments 10/15/15

12064


A7.00

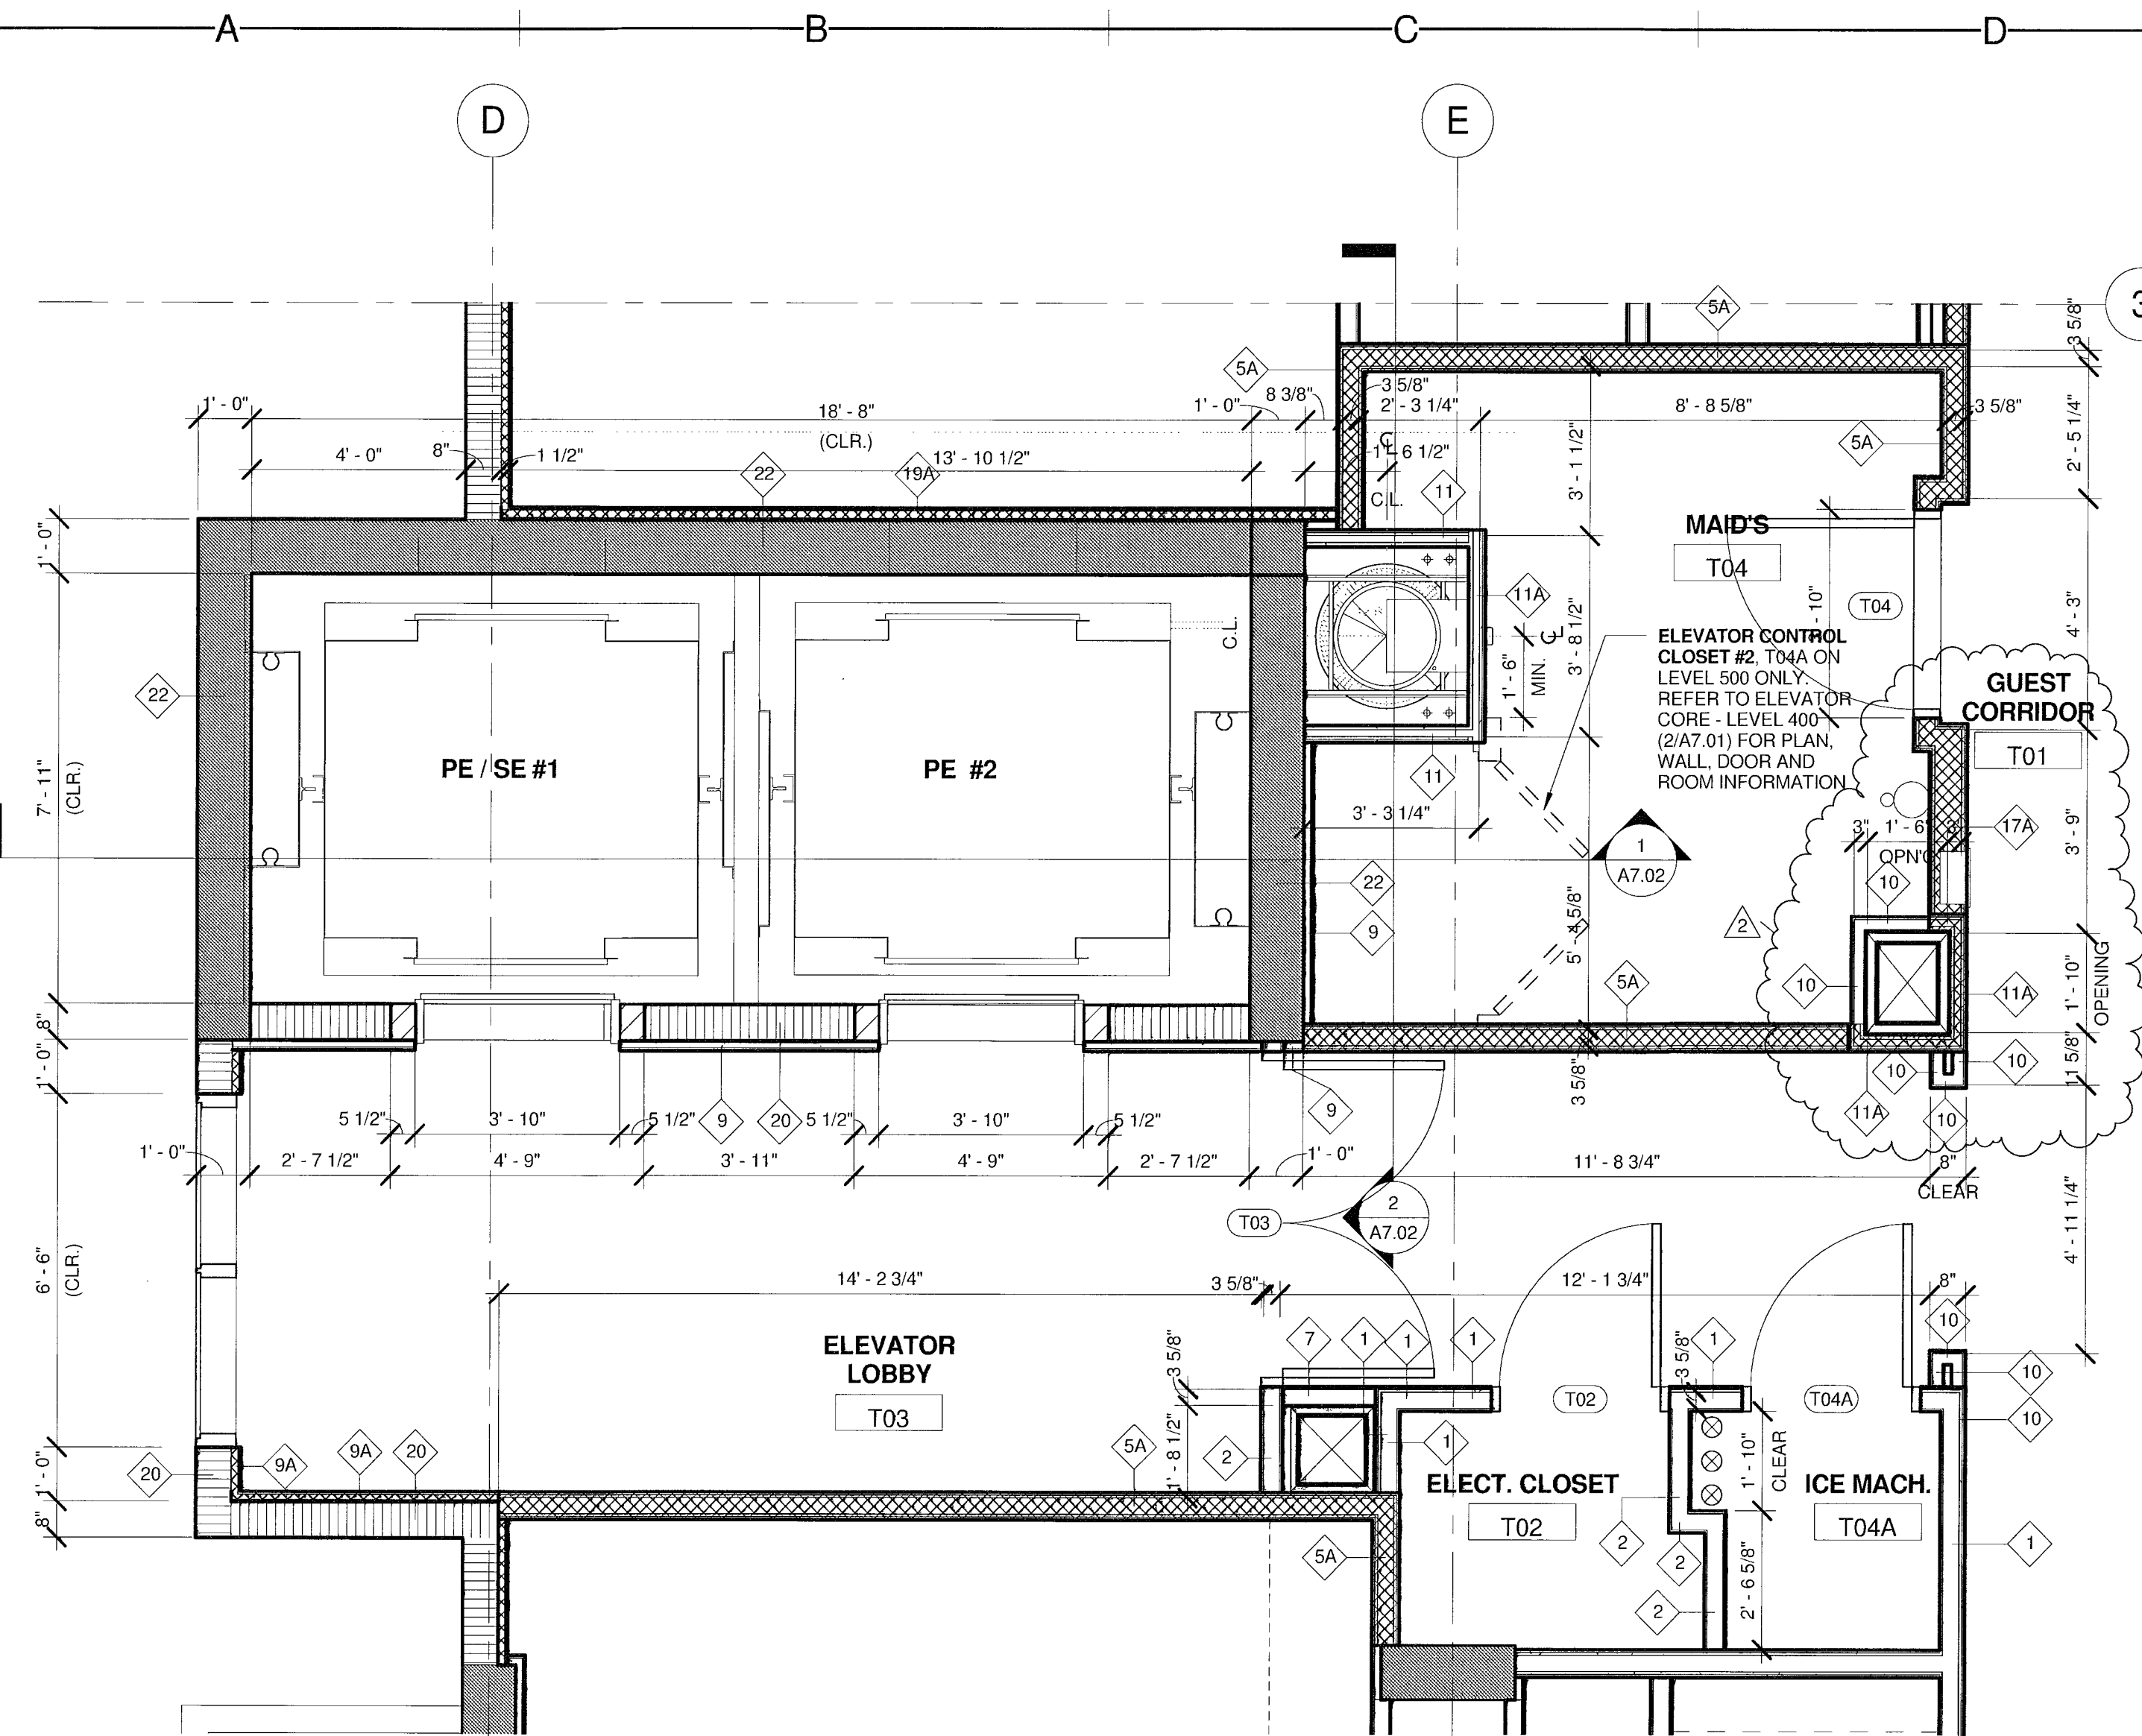


1
A7.01
ELEVATOR CORE - LEVEL 300 & 500
3/8" = 1'-0"

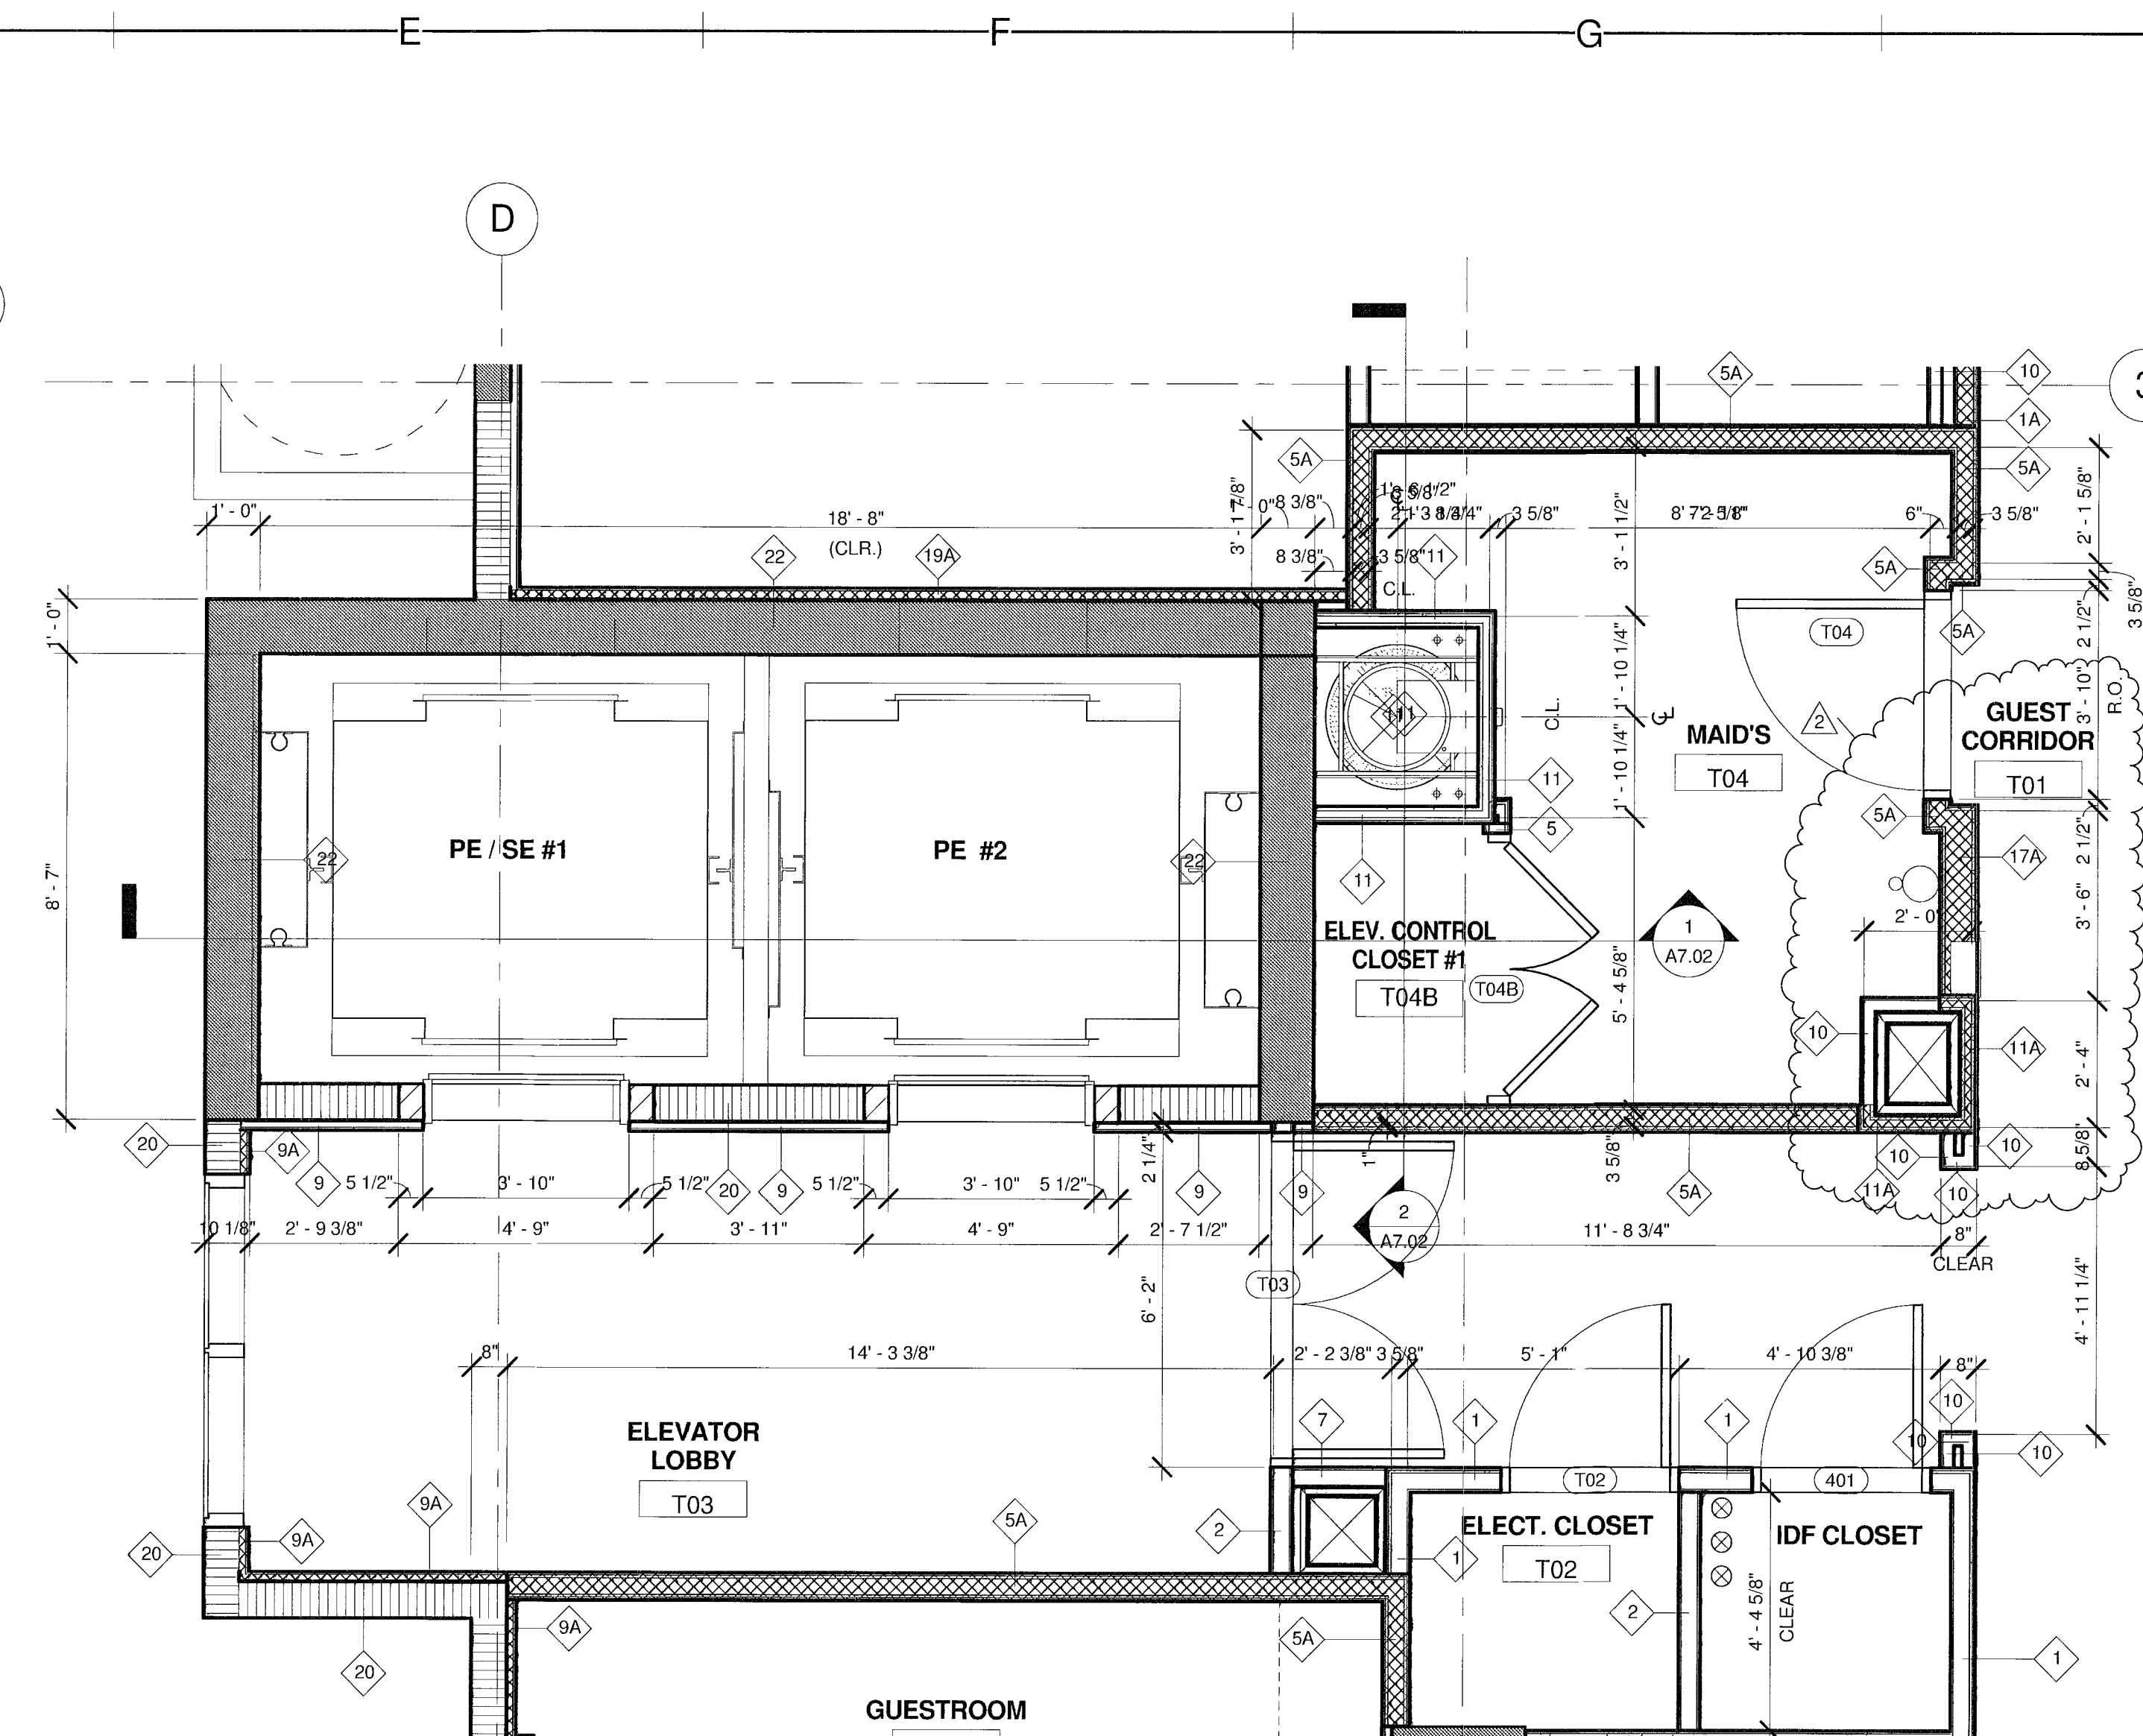

2
A7.01
ELEVATOR CORE - LEVELS 400
3/8" = 1'-0"

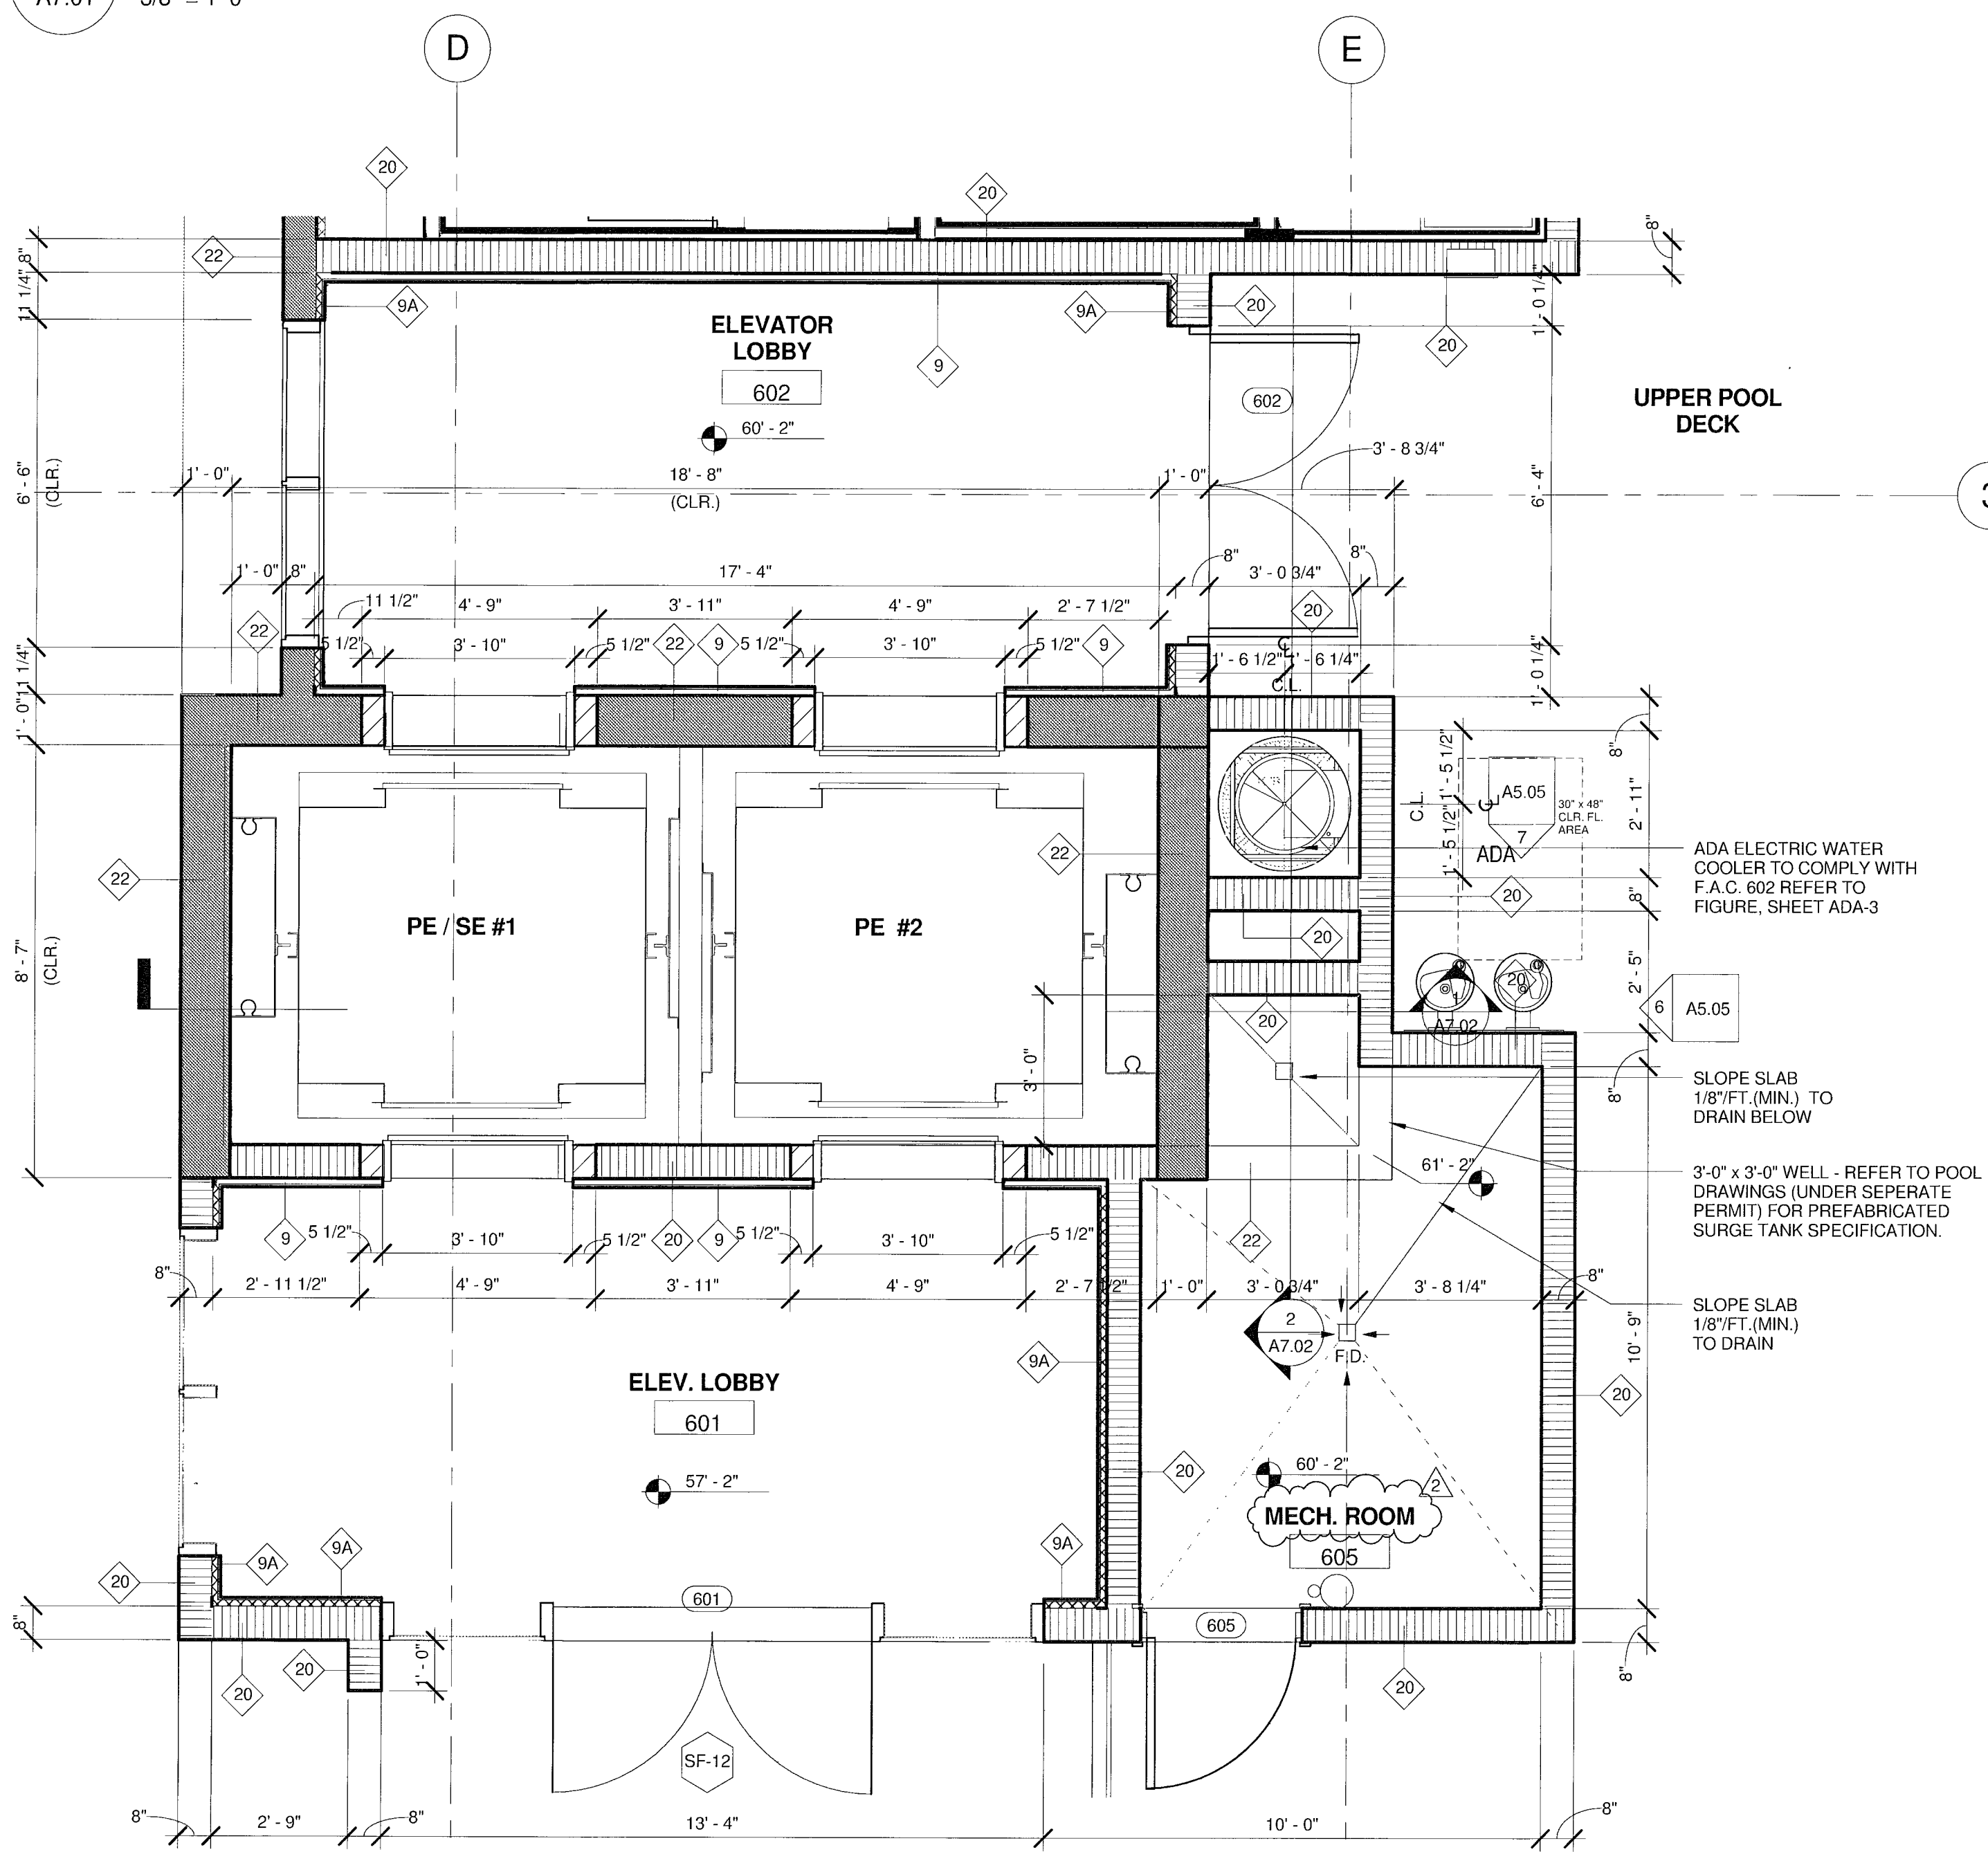

3
A7.01
ELEVATOR CORE - UPPER & LOWER POOL DECK
3/8" = 1'-0"

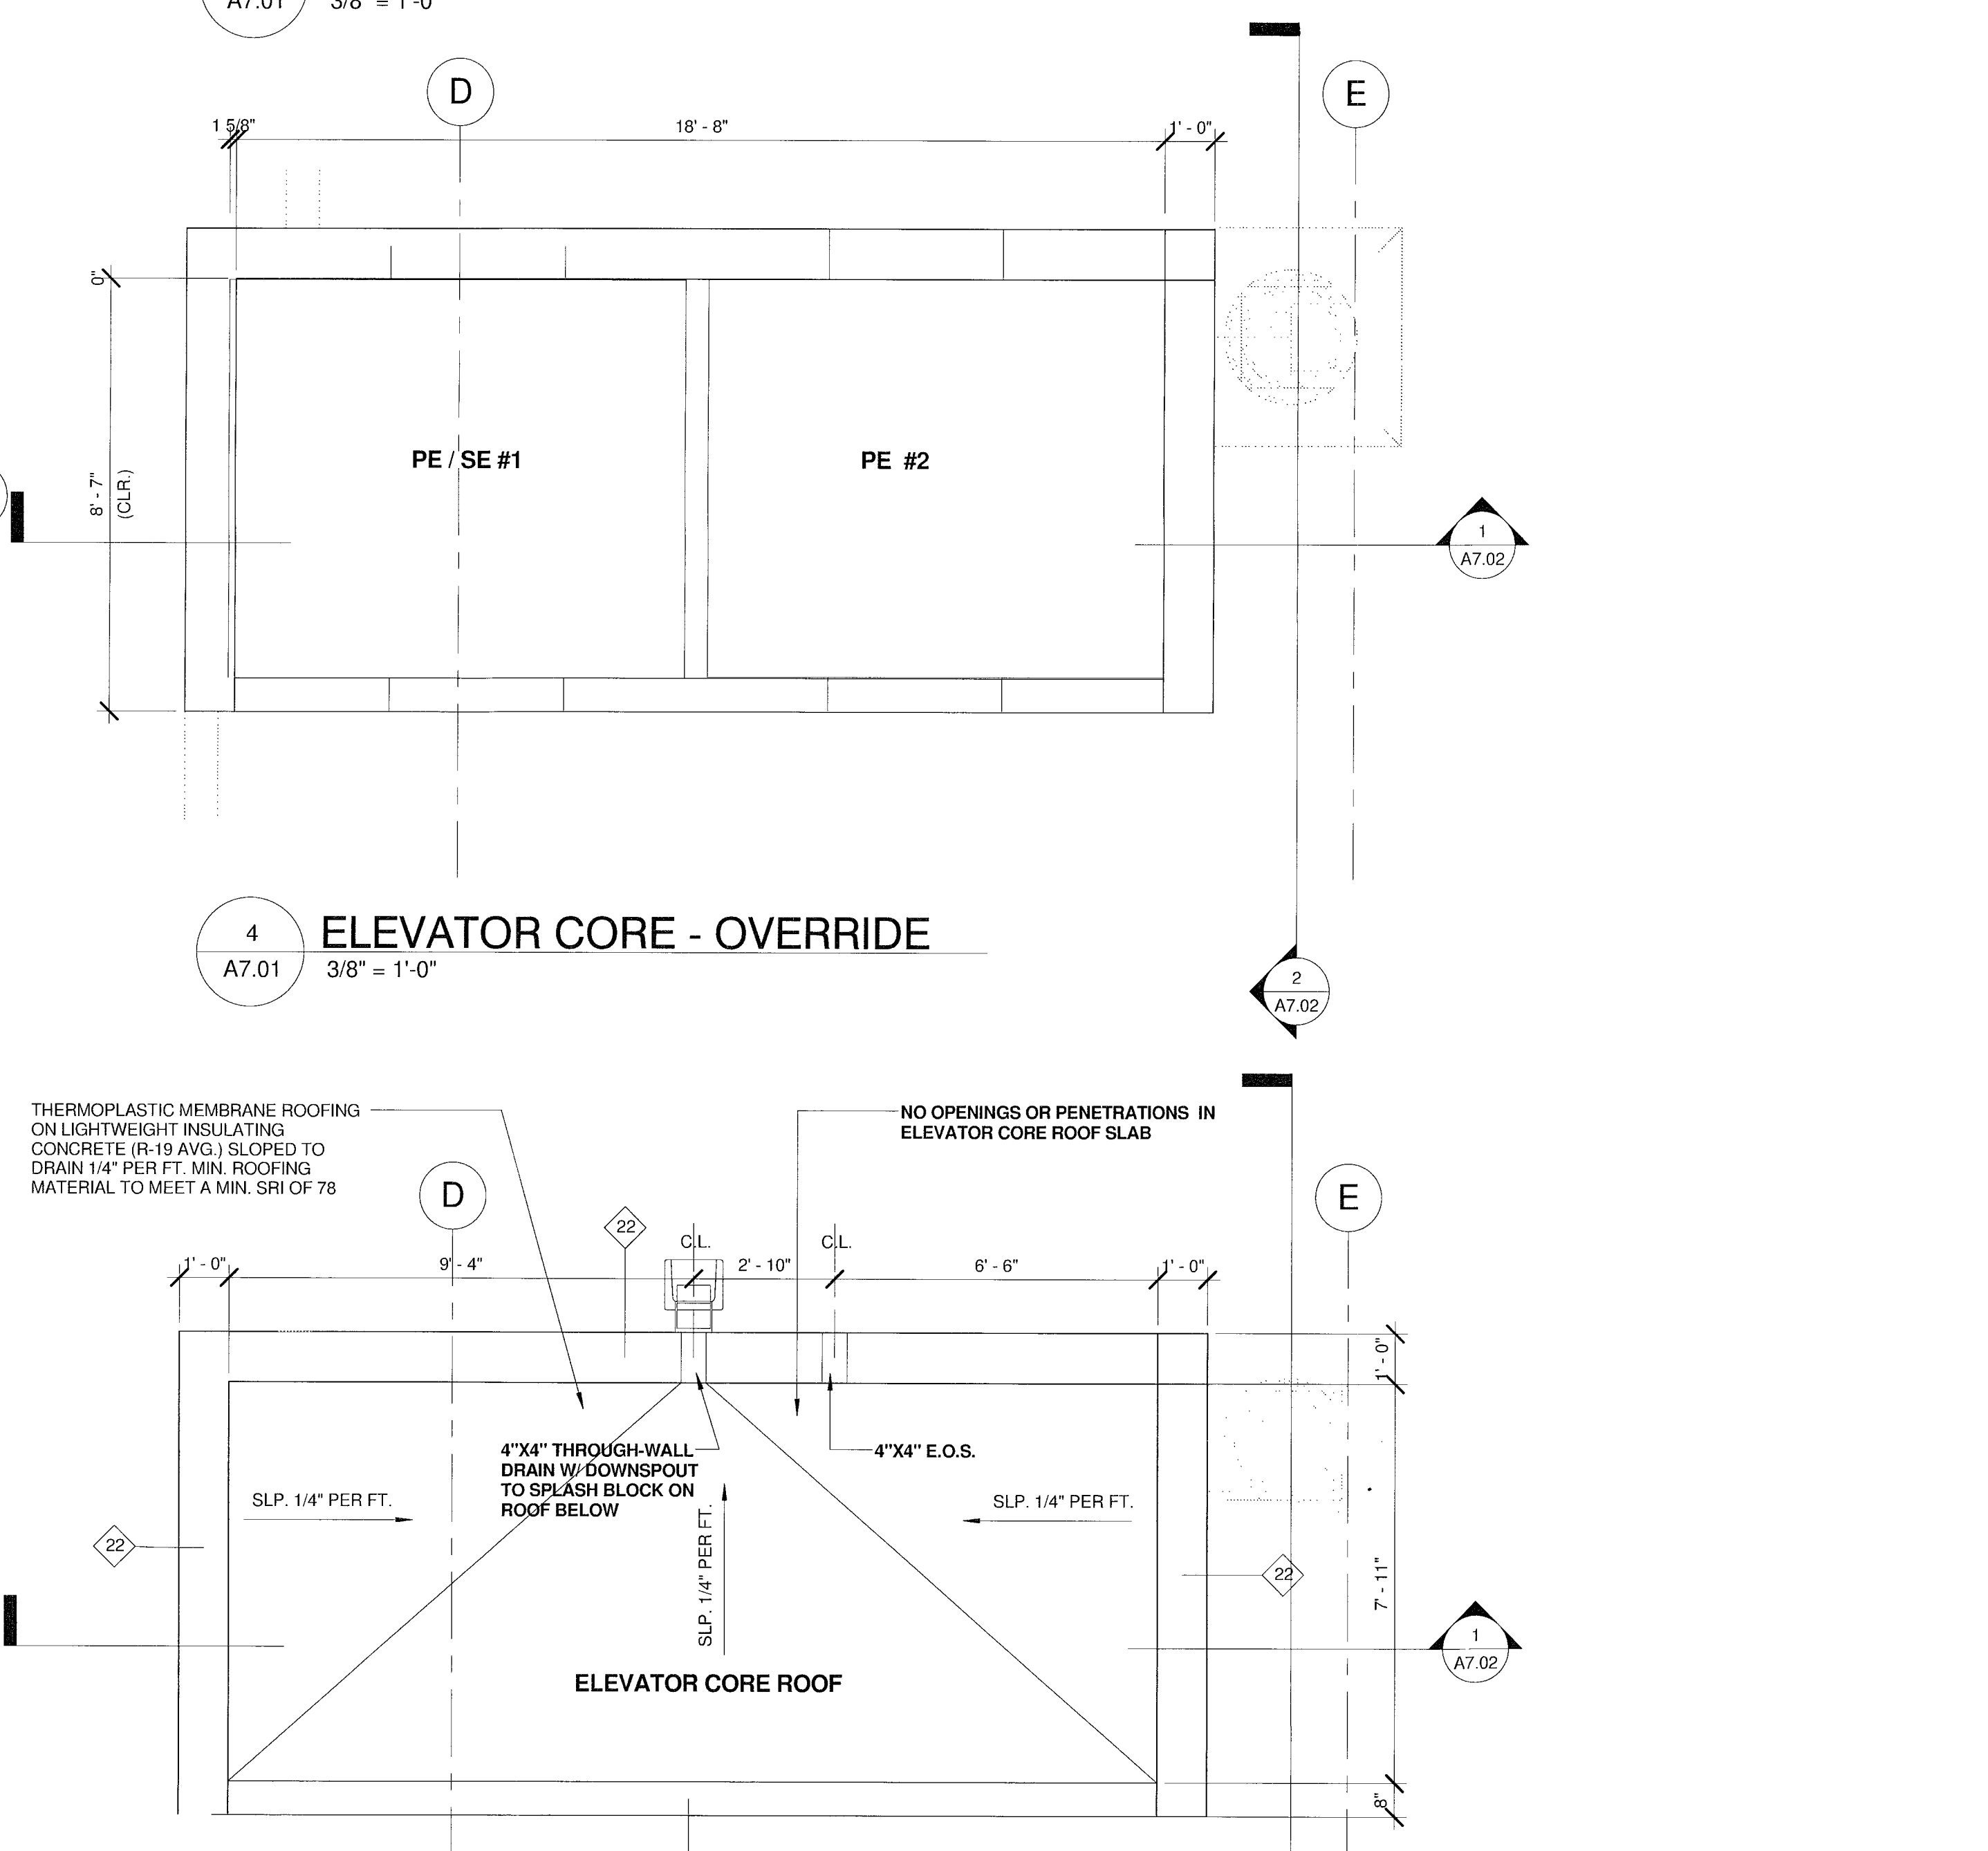

5
A7.01
ELEVATOR CORE ROOF
3/8" = 1'-0"

ELEVATOR GENERAL NOTES:

GENERIC DRAWINGS:

- THESE DRAWINGS FOR GENERAL INFORMATION ONLY. REQUIREMENTS OF INDIVIDUAL VENDORS MAY VARY.
- THESE DRAWINGS SHALL BE DISTRIBUTED TO APPROPRIATE CONSULTING AND ENGINEERING FIRMS INCLUDING ARCHITECT, STRUCTURAL, ELECTRICAL AND MECHANICAL ENGINEERS.
- FIELD VERIFY ALL EXISTING DIMENSIONS.
- ROUGH OPENING DIMENSIONS FOR ELEVATOR ENTRANCES APPLY ONLY IN THE CASE OF MASONRY OR CONCRETE CONSTRUCTION.
- VERTICAL STRUCTURAL SUPPORT FOR RAIL BRACKETING IS PROVIDED BY HOISTWAY WALL IN THE CASE OF REINFORCED CONCRETE HOISTWAY CONSTRUCTION.
- ELEVATOR SHAFT VENTILATION SHALL COMPLY WITH FBC SECTION 9004 AND 13-405.03.

NOTES:

APPLICATION DESIGNED FOR:
OTIS
SCHINDLER
THYSSENKRUPP

PIT NOTES:

- PROVIDE ADEQUATE LIGHTING TO MAINTAIN MIN. 100 LUX (10 FC) ILLUMINATION AT PIT FLOOR.
- PROVIDE PIT ACCESS LADDERS, LIGHT SWITCHES, LIGHTS, AND GFCI-PROTECTED UTILITY OUTLETS.
- PROVIDE ONE PIT LADDER, LIGHT SWITCH, LIGHT FIXTURE, AND OUTLET PER ELEVATOR.
- PROVIDE ADEQUATE STRUCTURAL SUPPORT REQUIRED FOR BUFFER AND RAIL FORCE REACTIONS.

PIT AND OVERHEAD PLANS INDICATE REACTIONS FOR MACHINE ROOM-LESS EQUIPMENT OF VARIOUS ELEVATOR VENDORS. WHERE REACTIONS OF DIFFERENT VENDORS OVERLAP, THE HIGHER REACTION IS INDICATED. REACTIONS FOR ONE VENDOR DO NOT OCCUR WITH THE REACTIONS OF OTHER VENDORS. OVERHEAD PLANS ARE NOT SHOWN FOR VENDORS WITH NO REACTIONS IN THE OVERHEAD.

ELEVATOR PITS SHALL COMPLY WITH ASME A17.1-2009 SECTION 2.2.2.2.3.3.1 THROUGH 2.2.2.2.3.3.6.

CONTROL ROOM NOTES:

PROVIDE SELF-CLOSING, SELF-LOCKING CONTROL ROOM ACCESS DOOR. PROVIDE ADEQUATE LIGHTING TO MAINTAIN MIN. 200 LUX (18 FC) ILLUMINATION AT CONTROL ROOM FLOOR. PROVIDE LIGHT(S), LIGHT SWITCH(ES) AND GFCI-PROTECTED UTILITY OUTLETS. COORDINATE LOCATIONS WITH ELEVATOR CONTRACTOR. FOR MOST VENDORS, CONTROLLER MUST BE WITHIN 80' WIRE RUN LENGTH FROM THE CORRESPONDING MACHINE AT THE TOP OF THE HOISTWAY.

OVERHEAD NOTES:

PROVIDE ADEQUATE LIGHTING TO MAINTAIN MIN. 200 LUX (19 FC) ILLUMINATION AT TOP OF HOISTWAY. PROVIDE LIGHTS, LIGHT SWITCHES AND GFCI-PROTECTED UTILITY OUTLETS. COORDINATE LOCATIONS WITH ELEVATOR CONTRACTOR. PROVIDE STRUCTURAL SUPPORT TO SUSTAIN REACTIONS INDICATED.

APPLICABLE STANDARDS:

- AMERICAN STANDARD SAFETY CODE FOR ELEVATORS, DUMBWAITERS, ESCALATORS AND MOVING WALKS (ASME A17.1)
- FLORIDA BUILDING CODE ACCESSIBILITY - 2010 EDITION.
- FLORIDA BUILDING CODE CHAPTER 30 - 2010 EDITION.
- NATIONAL ELECTRICAL CODE
- OTHER SUCH STATE AND LOCAL CODES AS MAY BE APPLICABLE.

EMERGENCY SIGNS:

AN APPROVED PICTORIAL SIGN OF STANDARDIZED DESIGN SHALL BE POSTED ADJACENT TO EACH ELEVATOR CALL STATION ON ALL FLOORS INSTRUCTING OCCUPANTS TO USE THE EXIT STAIRWAYS AND NOT TO USE ELEVATORS IN CASE OF FIRE. THE SIGN SHALL READ: IN FIRE EMERGENCY, DO NOT USE ELEVATOR. USE EXIT STAIRS.

AMBULANCE STRETCHER ELEVATOR:

ELEVATOR CAR TO ACCOMMODATE AMBULANCE STRETCHER. THIS BUILDING MUST BE CONSTRUCTED TO CONTAIN AT LEAST ONE PASSENGER ELEVATOR THAT IS OPERATIONAL FOR BUILDING OCCUPANTS AND FIRE DEPARTMENT EMERGENCY ACCESS TO ALL FLOORS. THE ELEVATOR CAR SHALL BE OF SUCH SIZE AND ARRANGEMENT TO ACCOMMODATE AN AMBULANCE STRETCHER 24 INCHES BY 84 INCHES WITH NOT LESS THAN 6 INCH RADIUS CORNERS, IN THE HORIZONTAL OPEN POSITION AND SHALL BE IDENTIFIED BY THE INTERNATIONAL SYMBOL FOR EMERGENCY MEDICAL SERVICES (STAR OF LIFE). THE SYMBOL SHALL NOT BE LESS THAN 3 INCHES HIGH AND SHALL BE PLACED INSIDE ON BOTH SIDES OF THE HOISTWAY DOOR FRAME.

TRACTION ELEVATOR EQUIPMENT

1 PASSENGER ELEVATOR, 1 SERVICE ELEVATOR

CAPACITY:

3500 # (PASSENGER PE-2)
4000 # (PASSENGER / SERVICE PE-1/SE-1)

CLASS LOADING: PASSENGER CLASS A

CONTRACT SPEED:

ELEVATORS PE-1/SE-1, PE-2: 350 F.P.M.

ROPING SPEED: MANUFACTURER'S STANDARDS

MACHINE: GEARLESS MACHINE ROOM LESS

MACHINE LOCATION: REFER TO DRAWINGS

SUPERVISORY CONTROL: GROUP AUTOMATIC MICROPROCESSOR-BASED SYSTEM

OPERATIONAL CONTROL: DUPLEX SELECTIVE COLLECTIVE

MICROPROCESSOR-BASED SYSTEM

MOTOR CONTROL: AC VARIABLE VOLTAGE VARIABLE FREQUENCY. MICROPROCESSOR-BASED WITH DIGITAL CLOSED-LOOP FEEDBACK

POWER CHARACTERISTICS: 480 VOLTS, 3 PHASE, 60 HERTZ

ELEVATOR QUANTITY - DESCRIPTION:

2 - MAIN GUEST ELEVATORS PE-1 AND PE-2
1 - SERVICE ELEVATOR SE-1

STOPS:

7 STOPS PE-1/SE-1
6 STOPS PE-2

OPENINGS:

6 FRONT, 3 REAR; PE-1/SE-1
6 FRONT, 1 REAR; PE-2

TRAVEL: REFER TO PLANS AND SECTIONS

PLATFORM SIZE:

3500 # STANDARD PASSENGER

CLEAR INSIDE SIZE:

3500 # STANDARD PASSENGER: 6'-8" WIDE X 5'-5 1/2" DEEP


ENTRANCE SIZE:

CO 42" W X 84" H (PASSENGER)

ENTRANCE TYPE:

CENTER OPENING

REVIEWED
CITY OF MIAMI BEACH
FREE DEPARTMENT

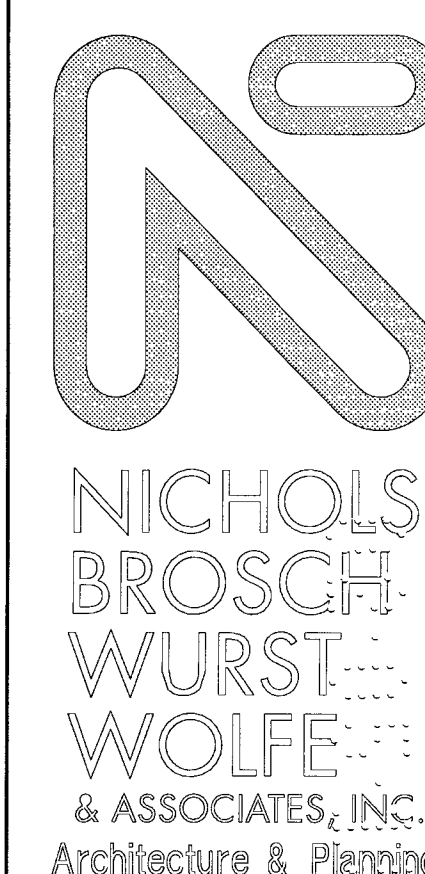

ANGLER'S HOTEL
600 WASHINGTON AVENUE, MIAMI BEACH, FLORIDA 33139
DEVELOPED BY: Angler's Boutique Resort LLC

JAN 15 2015

[Signature]

Permit Issue
10-13-14


REVISIONS

#	Description	Date
2	CMB Bldg. Dept. comments	01/15/15


12064

A7.01

C:\Users\akriss\Documents\1206 - ANGLER'S HOTEL_akriss.rvt
1/30/2015 4:19:32 PM

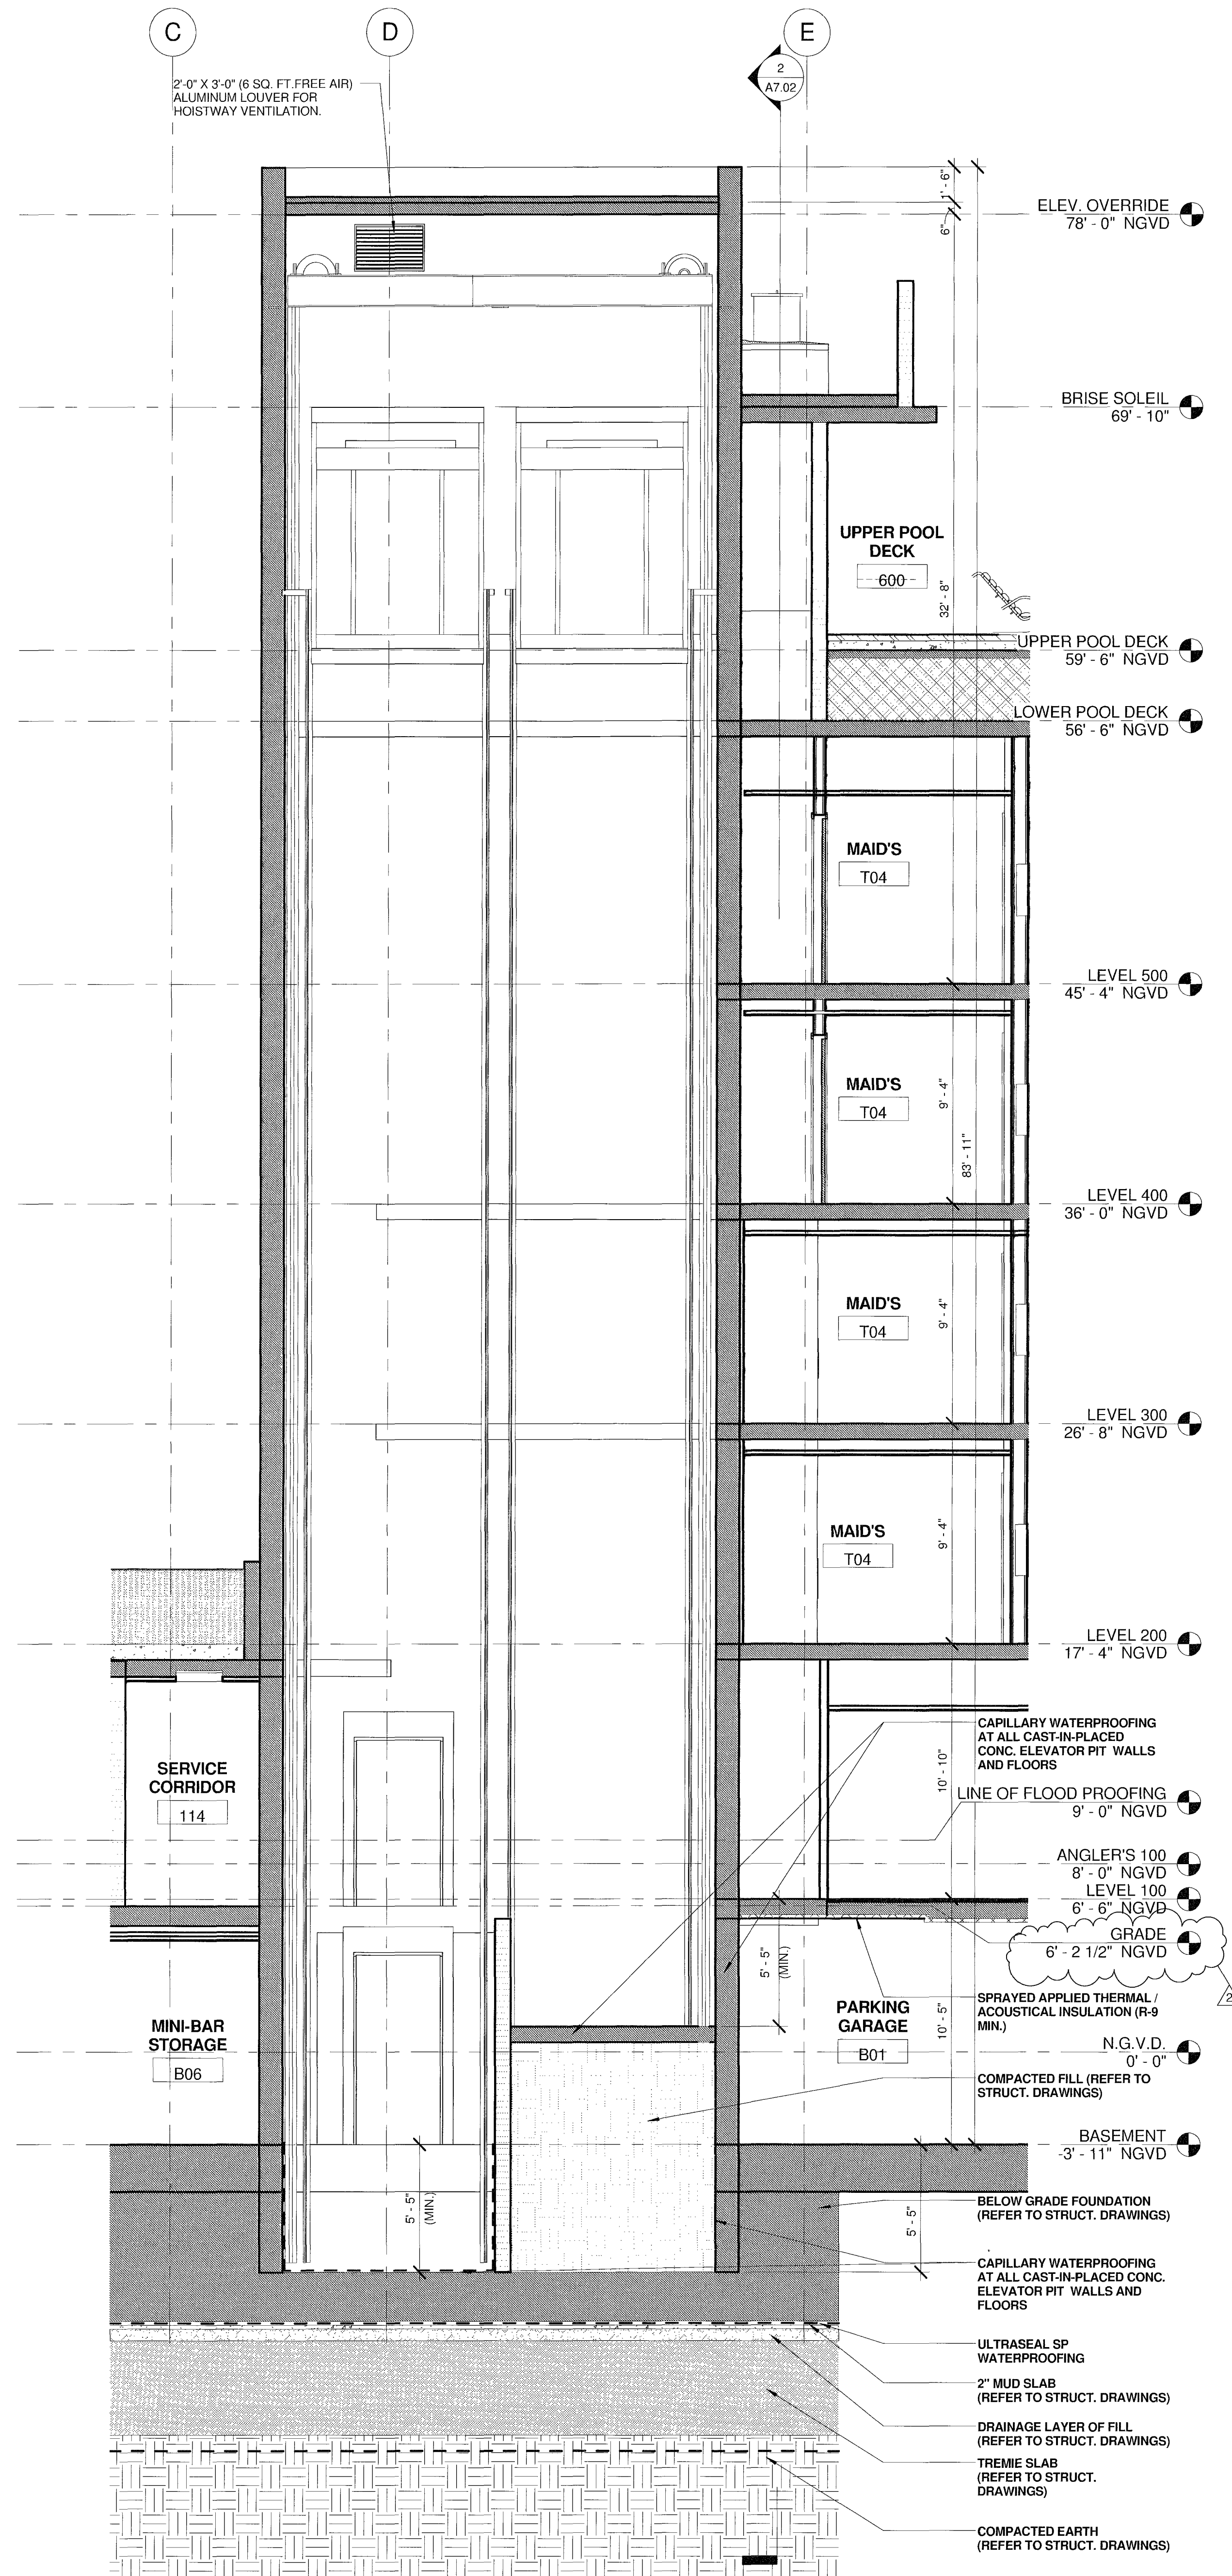

1 SECTION - ELEVATOR CORE
A7.02 1/4" = 1'-0"

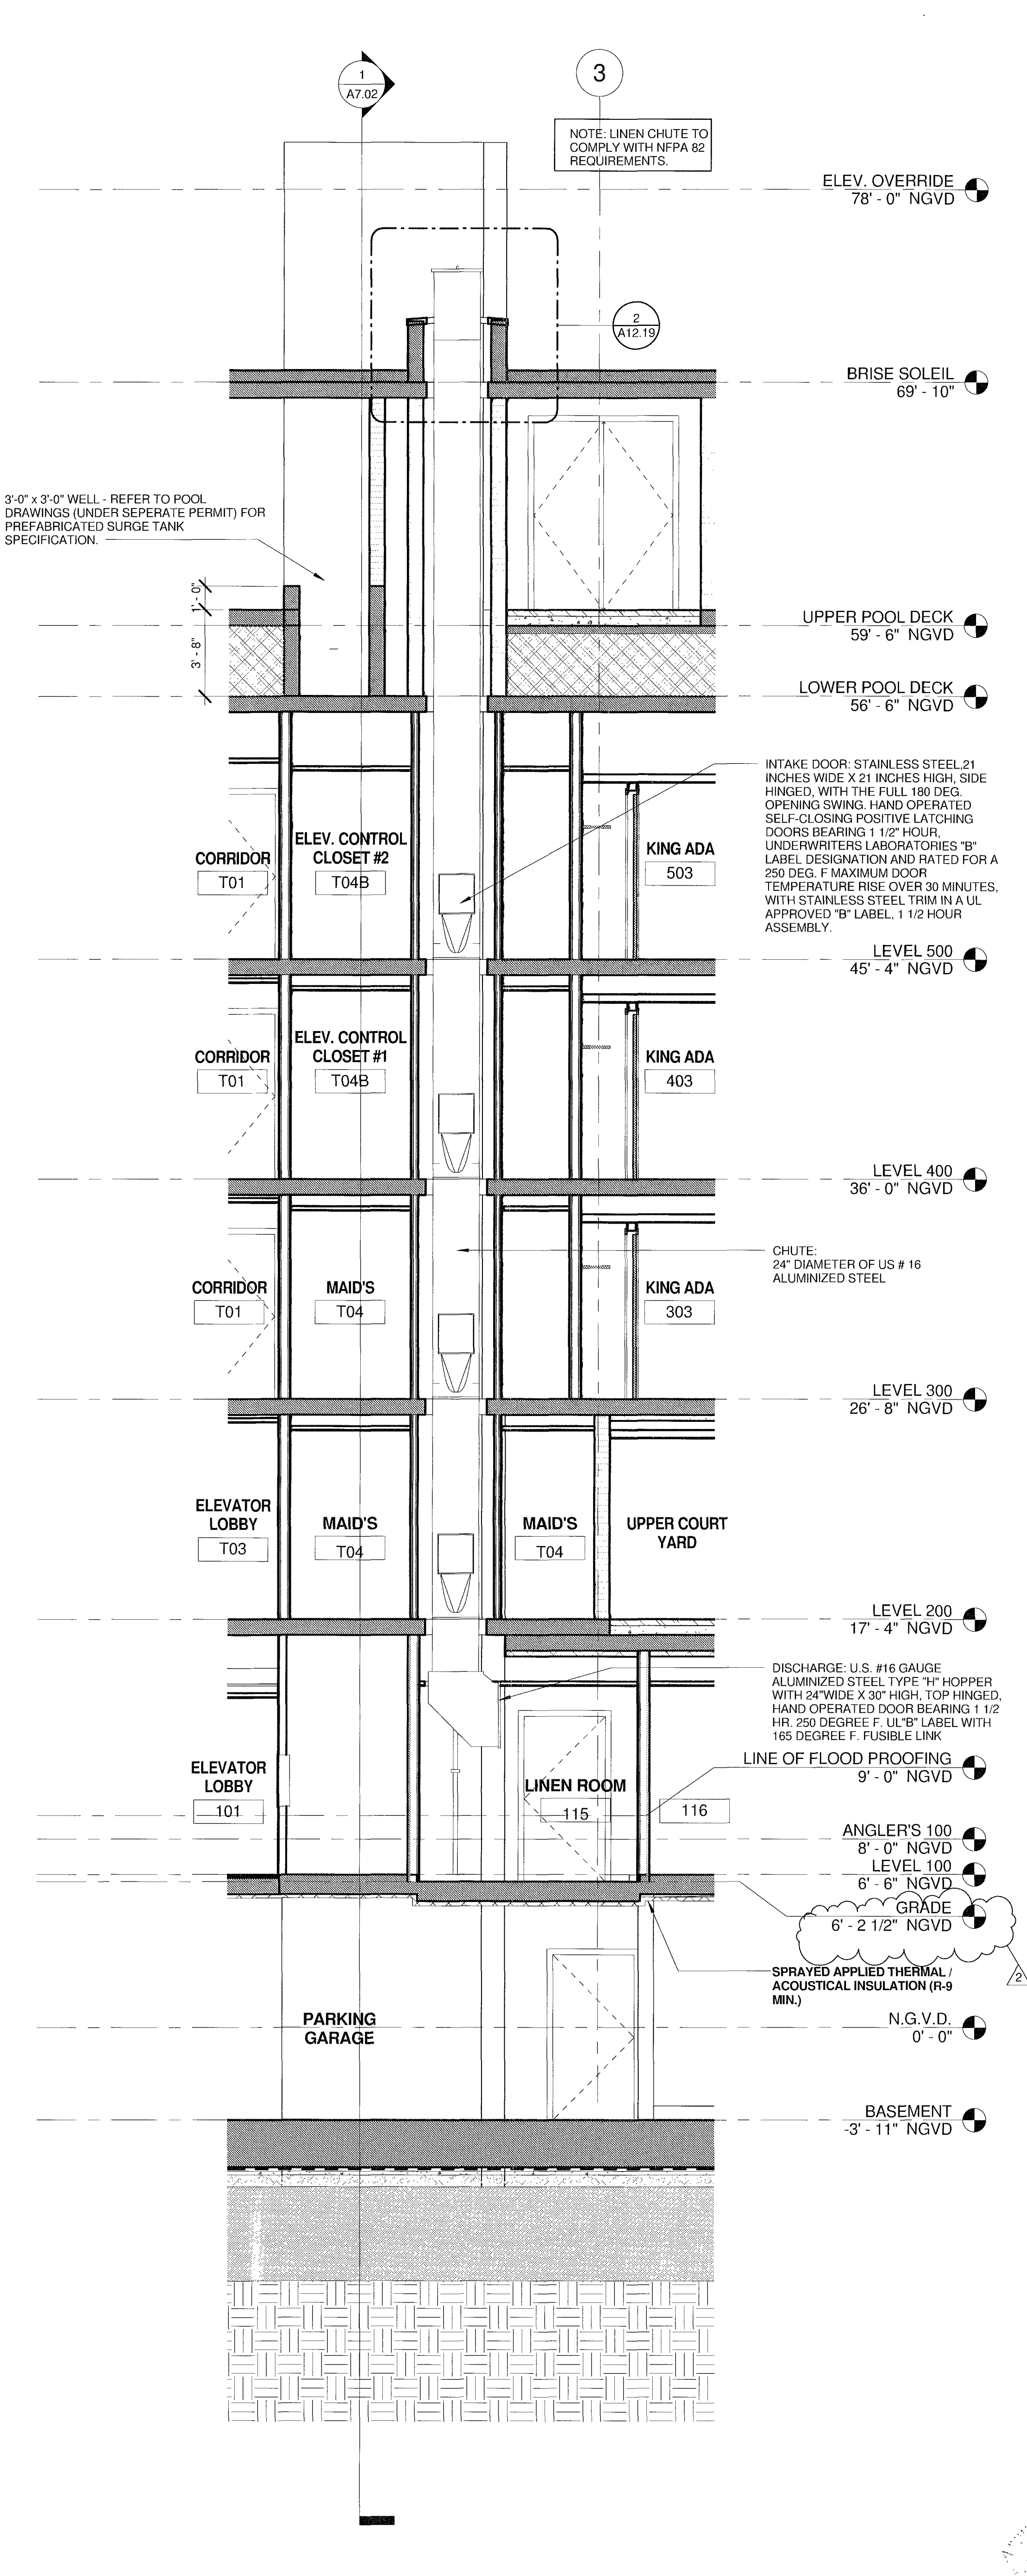

2 SECTION-LINEN CHUTE
A7.02 1/4" = 1'-0"

JAN 15 2015

AKR

Permit Issue
10-13-14

REVISIONS

#	Description	Date
2	CMB Bldg. Dept. comments	01/15/15

12064

A7.02

GUARDRAIL TO STOP
AT UNDERSIDE OF
FLOOR SLAB ABOVE.
HANDRAIL CONT'S
THROUGHOUT STAIR
RUN; HANDRAIL WALL
MOUNTED AT TOP OF
STAIR RUN AND
MOUNTED ON
GUARDRAIL AT THE
BOT. OF STAIR RUN.

1
A7.03
STAIR 01 - LEVEL 000
3/8" = 1'-0"

2
A7.03
STAIR 01 - LEVEL 100
3/8" = 1'-0"

3
A7.03
STAIR 01 - LEVEL 200
3/8" = 1'-0"

4
A7.03
STAIR 01 - LEVEL 300
3/8" = 1'-0"

5
A7.03
STAIR 01 - LEVEL 400
3/8" = 1'-0"

6
A7.03
STAIR 01 - LEVEL 500
3/8" = 1'-0"

7
A7.03
STAIR 01 - POOL DECK
3/8" = 1'-0"

8
A7.03
STAIR 01 - ROOF PLAN
3/8" = 1'-0"

STAIR GENERAL NOTES

TYPICAL FOR ALL STAIRS PROVIDING EGRESS FROM BUILDING
UNLESS OTHERWISE NOTED.

HANDRAILS:

- SHALL BE 1 1/2" DIA. STEEL UNLESS OTHERWISE NOTED.
- HEIGHT SHALL BE 36" ABOVE NOSING.
- SHALL EXTEND 12" PAST NOSING AT TOP AND BOTTOM OF LANDING.
- CLEAR SPACE BETWEEN A HANDRAIL AND A WALL OR GUARDRAIL SHALL BE 1 1/2" MIN.
- HANDRAILS TO COMPLY WITH SECTION 1012 OF THE F.B.C.

GUARDRAILS:

- SHALL BE 1 1/2" DIA. STEEL UNLESS OTHERWISE NOTED.
- SHALL BE 42" ABOVE NOSING.
- SHALL HAVE 1" PICKETS, O.C. TO REJECT A 4" DIA. SPHERE (TYP.)
- BOTTOM SHALL REJECT A 2" DIA. SPHERE (TYP.).
- AT CENTER OF STAIR THERE SHALL BE AN ADDITIONAL CONT. HANDRAIL, CONFORMING TO HANDRAIL CRITERIA ABOVE.
- HANDRAILS MAY NOT BE SHOWN IN SECTION. REFER TO PLANS.
- REFER TO SHEET A12.08 FOR TYPICAL DETAILS.
- GUARDRAILS SHALL COMPLY WITH SECTION 1013 OF THE F.B.C.
- EGRESS WIDTH OF STAIR IS THE CLEAR DIMENSION FROM THE INSIDE WALL OR GUARDRAIL TO THE OPPOSITE SIDE INSIDE WALL OR GUARDRAIL.

EXIT ENCLOSURES:

- EXIT ENCLOSURES TO COMPLY W/ FBC SECTION 1022.
- EXIT ENCLOSURE SIGNAGE TO COMPLY W/ FBC SECTION 1022.8


SIGNAGE:

PROVIDE STAIR IDENTIFICATION PER FBC 1009.6.4:
AN APPROVED SIGN SHALL BE LOCATED AT EACH FLOOR LEVEL LANDING IN ALL ENCLOSED STAIRWAYS OF BUILDINGS FOUR OR MORE STORIES IN HEIGHT. THE SIGN SHALL INDICATE THE FLOOR LEVEL, AND THE AVAILABILITY OF ROOF ACCESS FROM THAT STAIRWAY AND IDENTIFICATION OF THE STAIRWAY. THE SIGN SHALL ALSO STATE THE FLOOR LEVEL OF AND DIRECTION TO EXIT DISCHARGE. THE SIGN SHALL BE LOCATED APPROXIMATELY 5 FEET (1524mm) ABOVE THE FLOOR LANDING IN A POSITION WHICH IS READILY VISIBLE WHEN THE DOOR IS IN THE OPEN OR CLOSED POSITION. THE FLOOR LEVEL DESIGNATION SHALL ALSO BE TACTILE IN ACCORDANCE WITH THE FLORIDA BUILDING CODE, ACCESSIBILITY.

SIGNAGE REQUIREMENTS AS PER FBC 1022.8.1:
STAIRWAY IDENTIFICATION SIGNS SHALL COMPLY WITH ALL OF THE FOLLOWING REQUIREMENTS:

1. THE SIGN SHALL BE A MINIMUM SIZE OF 18 INCHES BY 12 INCHES (457 MM BY 305 MM).
2. THE LETTERS DESIGNATING THE IDENTIFICATION OF THE STAIR ENCLOSURE SHALL BE A MINIMUM OF 1 1/2 INCHES (38MM).
3. THE NUMBER DESIGNATING THE FLOOR LEVEL SHALL BE A MINIMUM OF 5 INCHES (127MM) IN HEIGHT AND LOCATED IN THE CENTER OF THE SIGN.
4. ALL OTHER LETTERING AND NUMBERS SHALL BE A MINIMUM OF 1 INCH (25MM) IN HEIGHT.
5. CHARACTERS AND THEIR BACKGROUND SHALL HAVE A NONGLARE FINISH. CHARACTERS SHALL CONTRAST WITH THEIR BACKGROUND, WITH EITHER LIGHT CHARACTERS ON A DARK BACKGROUND OR DARK CHARACTERS ON A LIGHT BACKGROUND.
6. WHEN SIGNS REQUIRED BY SECTION 1022.8 ARE INSTALLED IN INTERIOR EXIST ENCLOSURES OF BUILDINGS SUBJECT TO SECTION 1024, THE SIGNS SHALL BE MADE OF THE SAME MATERIALS AS REQUIRED BY SECTION 1024.4.

C:\Users\mhiciano\Documents\Revit\2\cal
4/6/2016 12:51:30 PM3_HOTEL_jrv-home_mhiciano.rvt

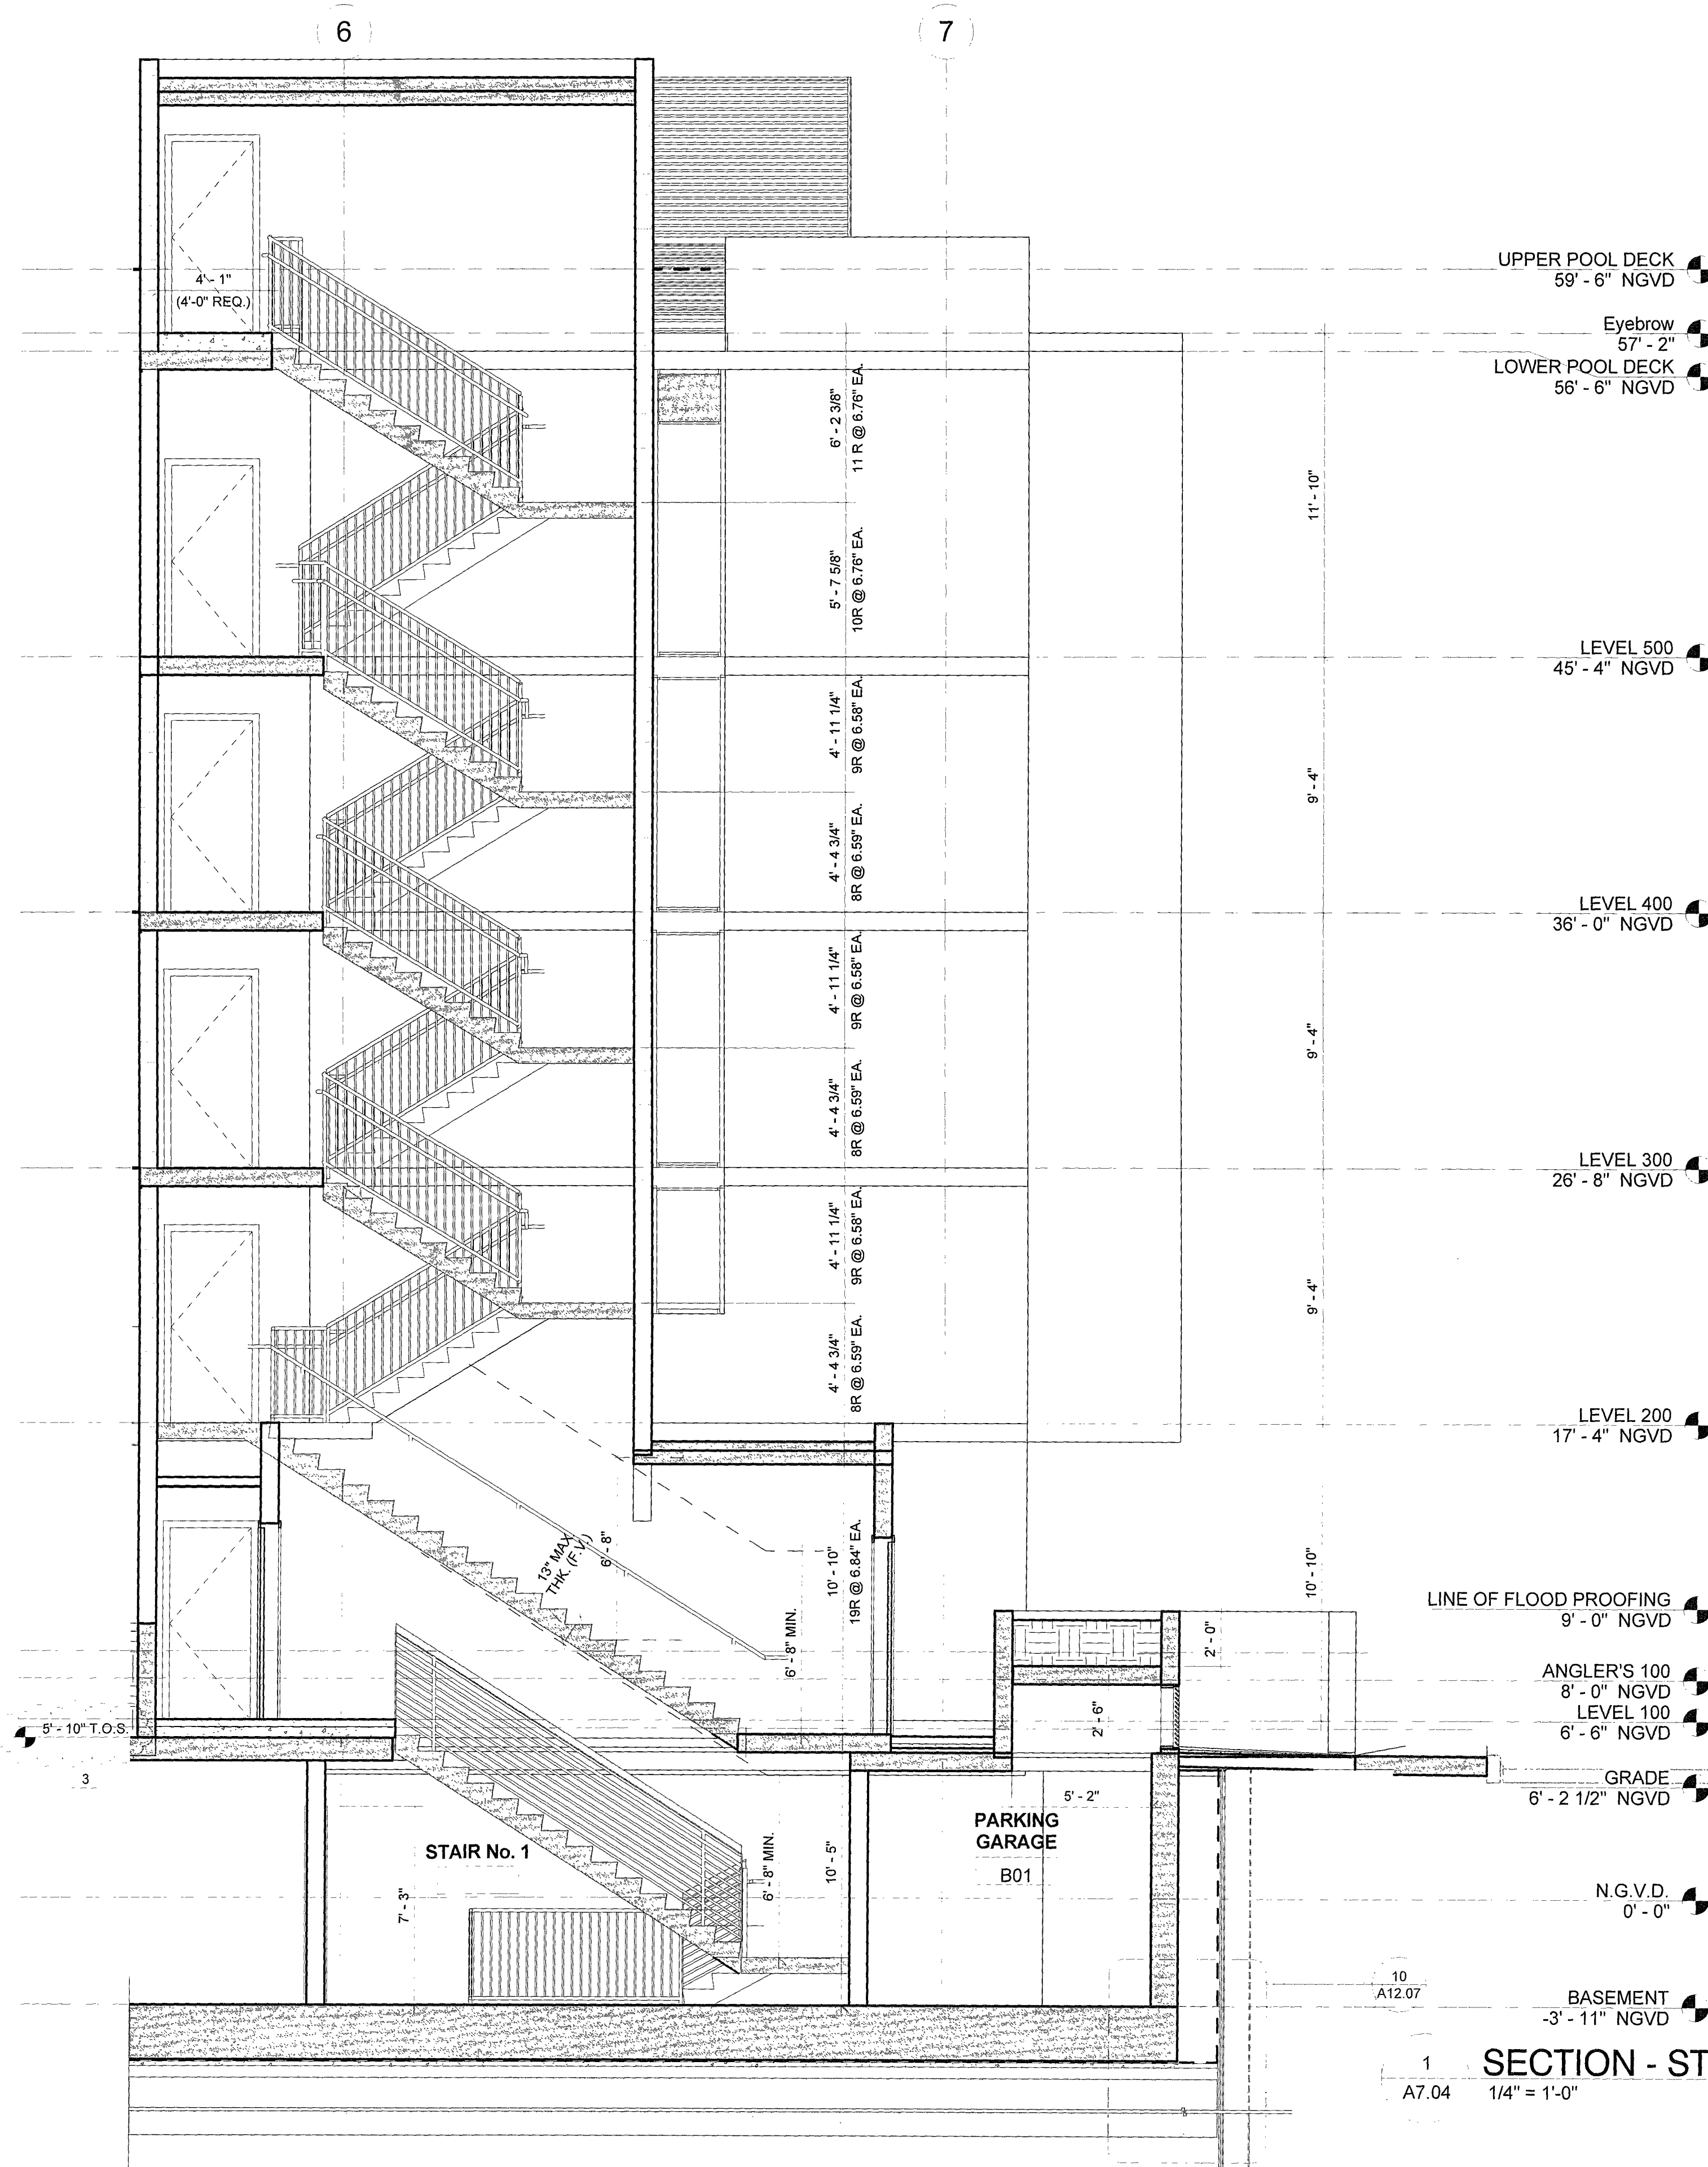

STAIR GENERAL NOTES

TYPICAL FOR ALL STAIRS PROVIDING EGRESS FROM BUILDING
UNLESS OTHERWISE NOTED.

HANDRAILS:

- SHALL BE 1 1/2" DIA. STEEL UNLESS OTHERWISE NOTED.
- HEIGHT SHALL BE 36" ABOVE NOSING.
- SHALL EXTEND 12" PAST NOSING AT TOP AND BOTTOM OF LANDING.
- CLEAR SPACE BETWEEN A HANDRAIL AND A WALL OR GUARDRAIL SHALL BE 1 1/2" MIN.
- HANDRAILS TO COMPLY WITH SECTION 1012 OF THE F.B.C.

GUARDRAILS:

- SHALL BE 1 1/2" DIA. STEEL UNLESS OTHERWISE NOTED.
- SHALL BE 42" ABOVE NOSING.
- SHALL HAVE 1" PICKETS, O.C. TO REJECT A 4" DIA. SPHERE (TYP.).
- BOTTOM SHALL REJECT A 2" DIA. SPHERE (TYP.).
- AT CENTER OF STAIR THERE SHALL BE AN ADDITIONAL CONT. HANDRAIL, CONFORMING TO HANDRAIL CRITERIA ABOVE.
- HANDRAILS MAY NOT BE SHOWN IN SECTION. REFER TO PLANS.
- REFER TO SHEET A12.08 FOR TYPICAL DETAILS.
- GUARDRAILS SHALL COMPLY WITH SECTION 1013 OF THE F.B.C.
- EGRESS WIDTH OF STAIR IS THE CLEAR DIMENSION FROM THE INSIDE WALL OR GUARDRAIL TO THE OPPOSITE SIDE INSIDE WALL OR GUARDRAIL.

EXIT ENCLOSURES:


- EXIT ENCLOSURES TO COMPLY W/ FBC SECTION 1022.
- EXIT ENCLOSURE SIGNAGE TO COMPLY W/ FBC SECTION 1022.8

SIGNAGE:

PROVIDE STAIR IDENTIFICATION PER FBC 1009.6.4:
AN APPROVED SIGN SHALL BE LOCATED AT EACH FLOOR LEVEL LANDING IN ALL ENCLOSED STAIRWAYS OF BUILDINGS FOUR OR MORE STORIES IN HEIGHT. THE SIGN SHALL INDICATE THE FLOOR LEVEL AND THE AVAILABILITY OF ROOF ACCESS FROM THAT STAIRWAY AND IDENTIFICATION OF THE STAIRWAY. THE SIGN SHALL ALSO STATE THE FLOOR LEVEL OF AND DIRECTION TO EXIT DISCHARGE. THE SIGN SHALL BE LOCATED APPROXIMATELY 5 FEET (1524mm) ABOVE THE FLOOR LANDING IN A POSITION WHICH IS READILY VISIBLE WHEN THE DOOR IS IN THE OPEN OR CLOSED POSITION. THE FLOOR LEVEL DESIGNATION SHALL ALSO BE TACTILE IN ACCORDANCE WITH THE FLORIDA BUILDING CODE, ACCESSIBILITY.

SIGNAGE REQUIREMENTS AS PER FBC 1022.8.1:
STAIRWAY IDENTIFICATION SIGNS SHALL COMPLY WITH ALL OF THE FOLLOWING REQUIREMENTS.

1. THE SIGN SHALL BE A MINIMUM SIZE OF 18 INCHES BY 12 INCHES (457 MM BY 305 MM).
2. THE LETTERS DESIGNATING THE IDENTIFICATION OF THE STAIR ENCLOSURE SHALL BE A MINIMUM OF 1 1/2 INCHES (38MM).
3. THE NUMBER DESIGNATING THE FLOOR LEVEL SHALL BE A MINIMUM OF 5 INCHES (127MM) IN HEIGHT AND LOCATED IN THE CENTER OF THE SIGN.
4. ALL OTHER LETTERING AND NUMBERS SHALL BE A MINIMUM OF 1 INCH (25MM) IN HEIGHT.
5. CHARACTERS AND THEIR BACKGROUND SHALL HAVE A NONGLARE FINISH. CHARACTERS SHALL CONTRAST WITH THEIR BACKGROUND, WITH EITHER LIGHT CHARACTERS ON A DARK BACKGROUND OR DARK CHARACTERS ON A LIGHT BACKGROUND.
6. WHEN SIGNS REQUIRED BY SECTION 1022.8 ARE INSTALLED IN INTERIOR EXIST ENCLOSURES OF BUILDINGS SUBJECT TO SECTION 1024, THE SIGNS SHALL BE MADE OF THE SAME MATERIALS AS REQUIRED BY SECTION 1024.4.

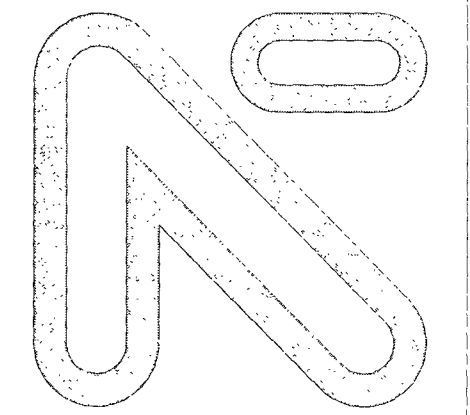

NICHOLS
BROSCH
WURST
WOLFE
& ASSOCIATES, II PC.
Architecture & Planning
111 SW 10th Avenue
Fort Lauderdale, FL 33304
(954) 466-2012
FAX: (954) 466-2012

ANGLER'S HOTEL
600 WASHINGTON AVENUE, MIAMI BEACH, FLORIDA 33139
DEVELOPED BY: Angler's Boutique Resort LLC

APR 23 2015
APR 23 2015

Permit Issue
10-13-14

REVISIONS

#	Description	Date
2	CMB Bldg. Dept. Comments	01/15/15
3	CMB Bldg. Dept. Comments	03/25/15

12064

A7.04